



**To:** Public Works and Transportation Committee  
**From:** Tom Stewart  
Director of Public Works Operations  
**Re:** 2011 Annual Water Quality Report

**Date:** July 10, 2012  
**File:**

**Staff Recommendation**

That the 2011 Annual Water Quality Report dated July 10, 2012 be received for information.

Tom Stewart  
Director of Public Works Operations  
(604-233-3301)

Att. 1

<b>REPORT CONCURRENCE</b>	
<b>CONCURRENCE OF GENERAL MANAGER</b> 	
<b>REVIEWED BY SMT SUBCOMMITTEE</b>	<b>INITIALS:</b> 
<b>REVIEWED BY CAO</b>	<b>INITIALS:</b> 

## Staff Report

### Origin

In 2001, the Province of British Columbia enacted the Drinking Water Protection Act, which provided the Minister of Health with the authority to implement and enforce standards for water supply systems in British Columbia. In May 2003, regulations to be implemented under the Drinking Water Protection Act were adopted by the legislature as the Drinking Water Protection Regulation.

### Analysis

The Drinking Water Protection Regulation requires water purveyors in BC to possess an Operating Permit, which in effect, confirms that the Drinking Water Officer (DWO) for the area has approved the water supply. The DWO is given the authority to monitor water purveyors to ensure they are providing safe drinking water through compliance with the British Columbia Drinking Water Protection Regulation (BCDWPR), and any other conditions of the Operating Permit. The Government of Canada has developed the Guidelines for Canadian Drinking Water Quality (GCDWQ) to assist in understanding water quality considerations. The requirement to monitor and address the parameters outlined in the GCDWQ that are not listed in the BCDWPR is at the discretion of the Drinking Water Officer.

Under the BCDWPR, the City of Richmond is required to:

- Develop and maintain a process to notify the Medical Health Officer (MHO) and the Drinking Water Officer (DWO) of situations or conditions that render or could render the water unfit to drink;
- Implement and maintain a plan for collecting, shipping and analyzing water samples in compliance with the direction set by the DWO and;
- Implement and maintain a plan for reporting monitoring results to the DWO and to water users

The foregoing requirements are satisfied by the attached Annual Water Quality Report.

Highlights of the 2011 Annual Water Quality Report include:

- Richmond residents enjoyed high quality reliable drinking water in 2011
- 1,936 water samples were collected to ensure water quality in 2011. All samples passed
- Test results confirm the high quality of the water and our continuous improvement over previous years, primarily due to additional water utility funding, resulting in additional proactive water main replacement prior to actual failure
- 34.9M cubic metres of water were purchased in 2011 (4.5% decrease from 2010).
- Water maintenance programs and capital improvements projects funded through Water Utility rates.
- Richmond's two mobile water supply units that are used in many community events to promote tap water usage

- Richmond's Mobile Emergency Response unit capable of producing over 55,000 litres of potable water per day (over 14,000 gpd) from non potable sources (i.e. river/ditch water)
- Project WET – an educational program and partnership between the Richmond School Board and Public Works was fully subscribed by elementary school students to learn about the benefits of water conservation

These and many other initiatives are detailed in the attached "2011 Annual Water Quality Report".

### **Financial Impact**

None

### **Conclusion**

This plan has been reviewed and endorsed by the MHO (Medical Health Officer of Vancouver Coastal Health Authority) for the City of Richmond and satisfies Provincial requirements under the Drinking Water Protection Act.



Doug Anderson

Manager, Water Services.  
(604-233-3334)  
DA:da



# City of Richmond 2011 Annual Water Quality Report




## Contents

Executive Summary .....	3
Introduction .....	5
Metro Vancouver Water District .....	6
Water Distribution System Overview .....	8
Water Quality Monitoring .....	10
Challenges and Issues .....	17
Current and Proposed Work .....	18
Annual System Maintenance .....	19
Mobile Emergency Response Unit .....	21
Water Conservation Programs .....	22
Public Notification .....	25
Operator Qualifications and System Classification .....	25
Conclusion .....	28
Appendices .....	29

## Typical Household Water Usage

Fixture/Appliance	Litres Used
Fast drips	750 litres used per week
Steady stream	3785 litres per week
Toilet flush	6 to 30 litres per flush
Fraction of leaking toilets	up to 30%
Showering	5.7-18.9 litres per minute
Bathtub	115 to 190 litres per full tub
Washing machine	170 to 190 litres per cycle
Dishwasher	40 to 55 litres per minute
Kitchen faucet	7.6 to 11.3 litres per minute
Bathroom faucet	7.6 to 11.3 litres per minute
Slow & stead drips	280 litres per week
Car washing	Approximately 400 litres per car
Lawn watering	10 to 35 litres per minute

Table from Metro Vancouver 2012 [www.metrovancouver.org](http://www.metrovancouver.org)

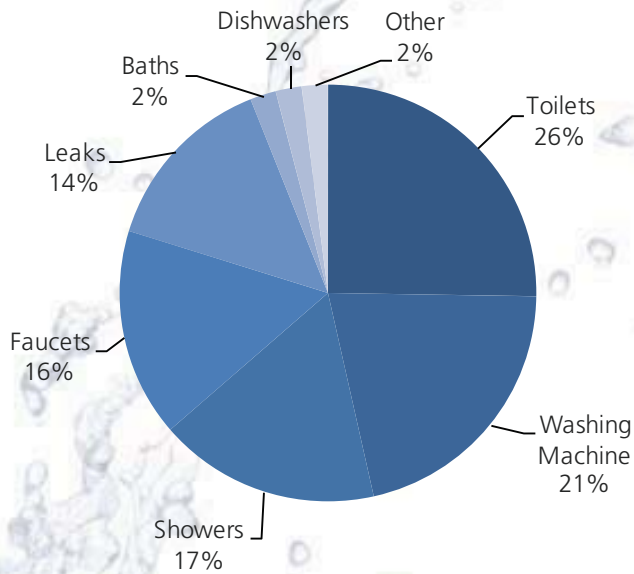

## Executive Summary

The purpose of this report is to fulfill the requirements set out in the Drinking Water Protection Act by giving an overview of the water distribution system, detailing the maintenance conducted on our infrastructure components, describing some of the unique features of our system, and summarizing the results of our water quality testing program.

### **In summary, City of Richmond Water Services staff undertook the following in 2011:**

- maintained 14 Pressure Reducing Valve stations
- replaced 7,500 metres of water main to provide for increased fire flows and longer service life
- maintained 4,618 fire hydrants to ensure water is available during an emergency
- repaired 35 water main breaks without compromising the integrity of the water distribution system
- conducted 1,936 microbiological tests
- detected no faecal coliform in any test
- provided about 34,9000,000 cubic metres of the highest quality water to nearly 199,000 residents
- reduced water consumption from 2010 by nearly 4.5% through water conservation measures
- hosted over 200 students from Richmond elementary schools as part of our annual educational program: Project WET
- discovered and repaired 22 non-visible underground leaks through our Leak Detection Program

For 2011, Richmond City residents were once again provided with some of the best drinking water in the world. We take our role as a water purveyor very seriously and are proud to be the guardian of such a precious resource.

We trust you'll find the information presented in this report to be of interest and hope you enjoy reading it as much as we enjoyed preparing it.



**PWT - 26**



## Introduction

In, 2002, the City of Richmond implemented a Drinking Water Quality Monitoring Program. This monitoring program was developed in accordance with the Water Quality Monitoring and Reporting Plan for Metro Vancouver and Member Municipalities, the Guidelines for Canadian Drinking Water Quality (GCDWQ), with input from the Vancouver Coastal Health Authority.

The Vancouver Coastal Health Authority requires that the City of Richmond provides the Annual Drinking Water Quality Report so that the City of Richmond's Water Services Division can receive an operating permit. Richmond's Medical Health Officer (MHO) has reviewed the report. As requested, this report will be made public. It provides important information concerning Richmond's water distribution system and water quality for Richmond residents.

As a water purveyor, Richmond must comply with provincial legislation, including the British Columbia Drinking Water Protection Act (BCDWPA), and British Columbia Drinking Water Protection Regulations (BCDWPR). Information is also compared to the federal Guidelines for Canadian Drinking Water Quality (GCDWQ). Under these various pieces of legislation the City of Richmond was required to:

- Develop a process to notify the MHO of any condition that could render drinking water unsafe.
- Implement a sampling program that adequately represents all areas within the City.
- Meet the requirements of the BCDWPA, and ensure test results are immediately available to the MHO.
- Receive an annual construction permit for the construction, installation and extension of the water distribution system.
- Ensure the City's water distribution system is classified under the criteria for the Environmental Operators Certification Program and that Water Services staff are certified to the same level as the distribution system.
- Produce an annual public report detailing the results of the City's water quality monitoring program.





*97% of the world's water is saline. Another 2% is ice (glaciers). That leaves 1% available for drinking, community needs, agriculture and industry.*



*To see if your toilet is leaking, put a few drops of food colouring in the tank. Wait a few minutes, if the water in the bowl colours, you know you have a leak. Remember to fix it after you find it.*

## Metro Vancouver Water District

In 2011, the City of Richmond purchased approximately 34.9 million cubic meters of drinking water from the Metro Vancouver Water District (formerly GVWD). This represents a 4.5% decrease over the 2010 water purchase. This method of supply is similar for all other jurisdictions within the Regional District.

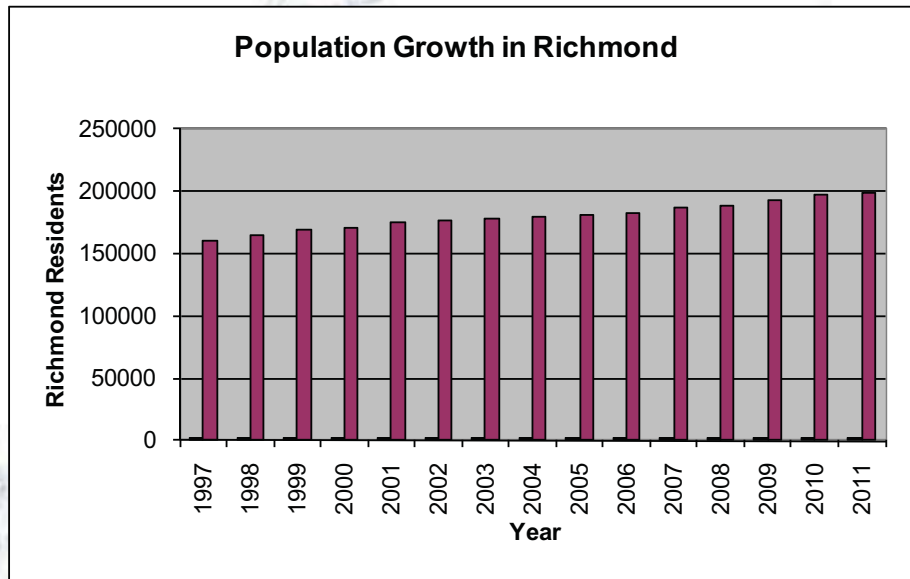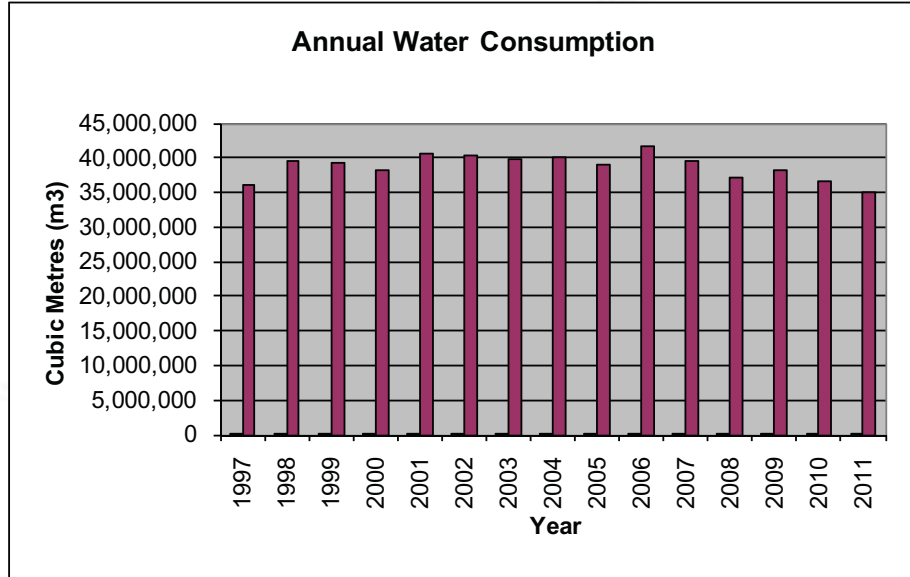

\*BC Stats, Ministry of Labour and Citizens' Services, September 2011

Three watersheds supply regional water: The Capilano Reservoir, the Seymour Reservoir, and the Coquitlam Reservoir. The Capilano and Seymour Reservoirs combined, supply 70% of the water for the region. The Coquitlam Reservoir supplies the remaining 30%. Richmond receives the majority of its water from the Capilano and Seymour reservoir.

Water from these reservoirs can be directed through a series of valves and transmission water mains to any City or Municipality within the Metro Vancouver region.

During periods of turbidity (cloudy water), a reservoir may be taken out of service if turbidity levels become elevated. Water is then supplied by the remaining reservoirs. This was the situation in October 2011, when the turbidity levels at the Capilano Reservoir became elevated due to a series of mudslides caused by heavy rainfall. The Capilano supply was taken out of service and Richmond's water was supplied from the Seymour Reservoir. The Capilano supply remained out of service until early March of 2012 and consequently Richmond received filtered water supplied through the Seymour/Capilano Water Filtration Plant. The plant has the capacity to filter up to 1.8 billion liters of water per day.




*Less than 1% of water treated for potable use is consumed. The rest is put down the drains and into the sewerage system for treatment.*

### Source Water Quality

Source water is provided directly from the watersheds by Metro Vancouver. Source water is tested for a number of microbiological, chemical, and physical parameters. For information related to source water, refer to The Greater Vancouver Water District Quality Control Annual Report, 2010, available from the Metro Vancouver's website (this is the most recent information available at this time),

[www.metrovancouver.org/about/publications/Publications/2010WaterQualityAnnualReportVolume1.pdf](http://www.metrovancouver.org/about/publications/Publications/2010WaterQualityAnnualReportVolume1.pdf)

[www.metrovancouver.org/about/publications/Publications/2010WaterQualityAnnualReportVolume2.pdf](http://www.metrovancouver.org/about/publications/Publications/2010WaterQualityAnnualReportVolume2.pdf)

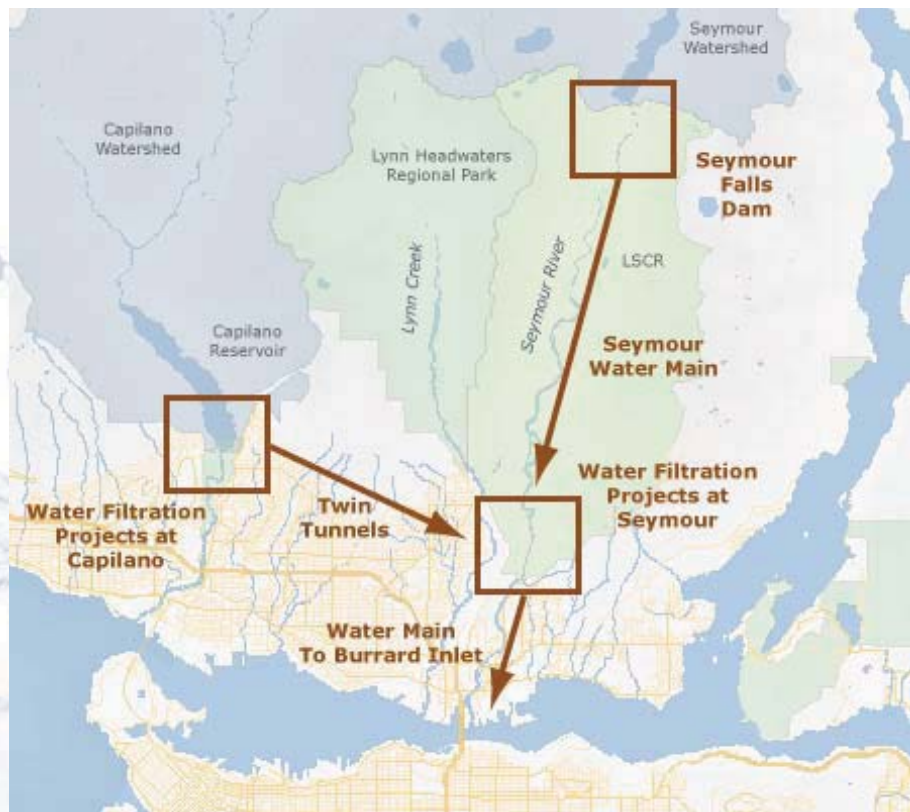

Seymour Capilano Water Utility Projects



*When you go to a restaurant and they give you that complimentary glass of water, remember, it takes another 2 glasses to wash it. Decline if you do not plan to drink it.*


## Water Distribution System Overview

The City of Richmond's water distribution system begins at 14 separate connections points along Metro Vancouver's transmission mains. At each connection point there is a City owned pressure reducing valve chamber. The City's responsibility for water quality begins at this chamber and ends at the residential/commercial property line. An outline of the City's water supply and distribution system is provided below

**Table 1 – Overview of Richmond's Water Distribution Network**

Water Assets	2011 Count
Water Works Valves	7196
Water Works Hydrants	4618
Water Works PRV Chambers	14
Water Works Pigging Chambers	7
Water Works Caps	515
Water Mains	641.00 Km
Water Connections Total	34,170

The City maintains 14 pressure-reducing valve stations (PRV's). These stations decrease the transmission pressure of Metro Vancouver's mains to Richmond's operating pressure. Ten of these facilities are connected to a remote telemetry system (S.C.A.D.A.) that provides real time data on water quality, pressure, and volume. It also allows certified Water Services staff to react to problems quickly and effectively, 24 hours a day, seven days a week. The S.C.A.D.A. monitoring equipment will eventually be installed in the four remaining PRV stations to ensure early detection and prompt response to any problems with the water distribution system. In early 2011, the City's Engineering and Public Works staff embarked on a project to install meters at all 14 PRV stations so that the City would have an accurate way of measuring the amount of water it receives from the Metro Vancouver Transmission System. These meters were primarily installed as the first step in implementing a new Water Loss Management Program.

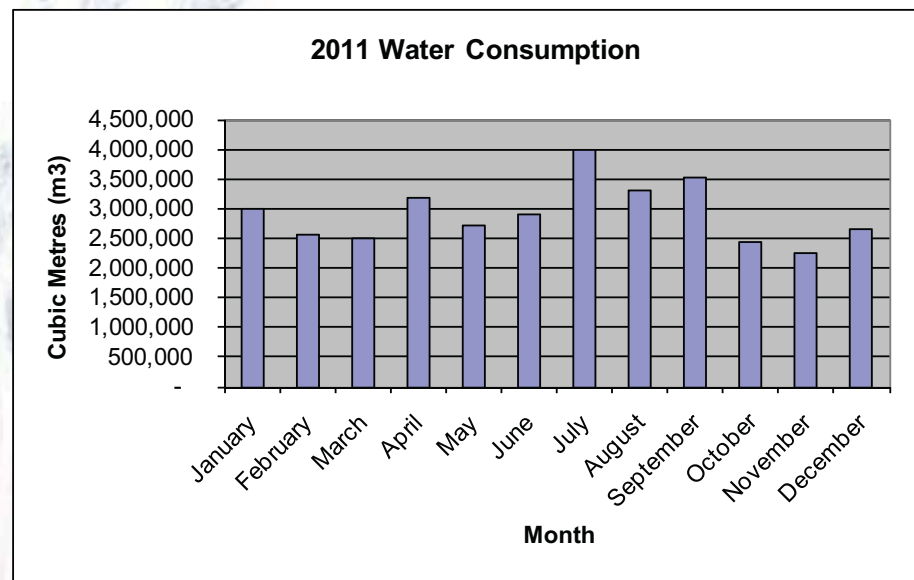

The graph indicates the monthly water consumption in Richmond. It is presumed that most municipalities in North America lose anywhere from 12% to 15% of their potable water to undiscovered, underground leakage. The Water Loss Management Program will allow City Engineering and Water Services staff to determine the total amount of water consumed through normal operational programs and practices such as single family residential, multi family residential and commercial metering programs. While combining these programs with water main flushing, parks and median irrigation, and Richmond Fire Rescue water usage for fire fighting and training purposes, it is reasonable to assume that the unidentified portion of the annual water consumption may well be attributed to water loss within the distribution system. In the past, the City of Richmond had no way of confirming that the amount of water billed for by Metro Vancouver annually matched the amount of water received by Richmond's distribution system.



*Don't leave the water running when you brush your teeth or shave. A tap runs at approximately 9 litres per minute. If it takes 10 minutes to shave in the morning and 3 to brush your teeth, that's about 120 litres of water in 13 minutes of your morning routine.*



Inside the pressure-reducing valve station



Pressure-reducing valve station that connects to S.C.A.D.A. telemetry system




City of Richmond's water quality sampling site



Water Services employee taking water sample

## Water Quality Monitoring

In 2011, the City of Richmond collected samples on a weekly basis at 39 dedicated sampling sites. These sites are strategically located throughout the City to give a good representation of the City's water quality across the distribution network. In 2011, 1,936 water samples were collected by Richmond Water Services staff and sent for analysis at Metro Vancouver Laboratories. These sample results were reviewed by the Vancouver/Richmond Coastal Health Authority to ensure the drinking water met the standards outlined in the BCDWPR.

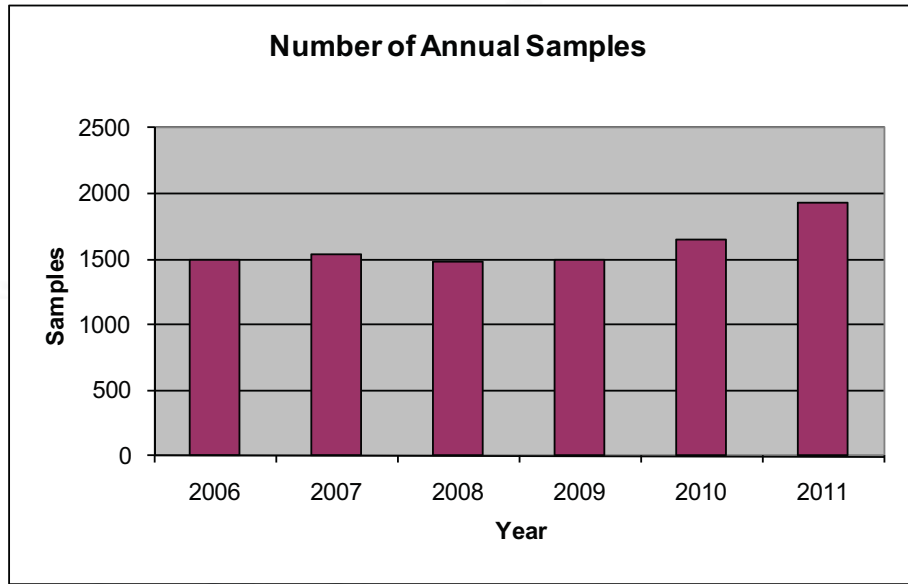

## Bacteriological Tests

The City of Richmond and Metro Vancouver conduct bacteriological tests for total coliform, fecal coliform and heterotrophic plate counts (HPC). The presence of these organisms in drinking water indicates that the water may be contaminated and may contain potentially harmful bacteria, viruses or parasites. Beginning on April 1, 2006, the BC Drinking Water Protection Regulations required additional monitoring for *Escherichia coli* (*E. coli*).


## Total Coliforms

Total coliform bacteria reproduce in water, soil, or the digestive systems of animals. The presence of total coliforms indicates water may have been contaminated and that the disinfection process is inadequate.

In distribution systems where more than 10 samples are collected in a given sampling period, as is the case in Richmond, no consecutive samples from the same site or no more than 10% of samples should show the presence of total coliform bacteria.

Testing for total coliforms should be carried out in all drinking water systems. The number, frequency, and location of samples for total coliform testing will vary according to the type and size of the system and jurisdictional requirements.

Provincial standards state that no sample can contain more than 10 total coliforms per 100 milliliters, and that 90 percent of samples in a 30-day period must have zero coliform organisms.

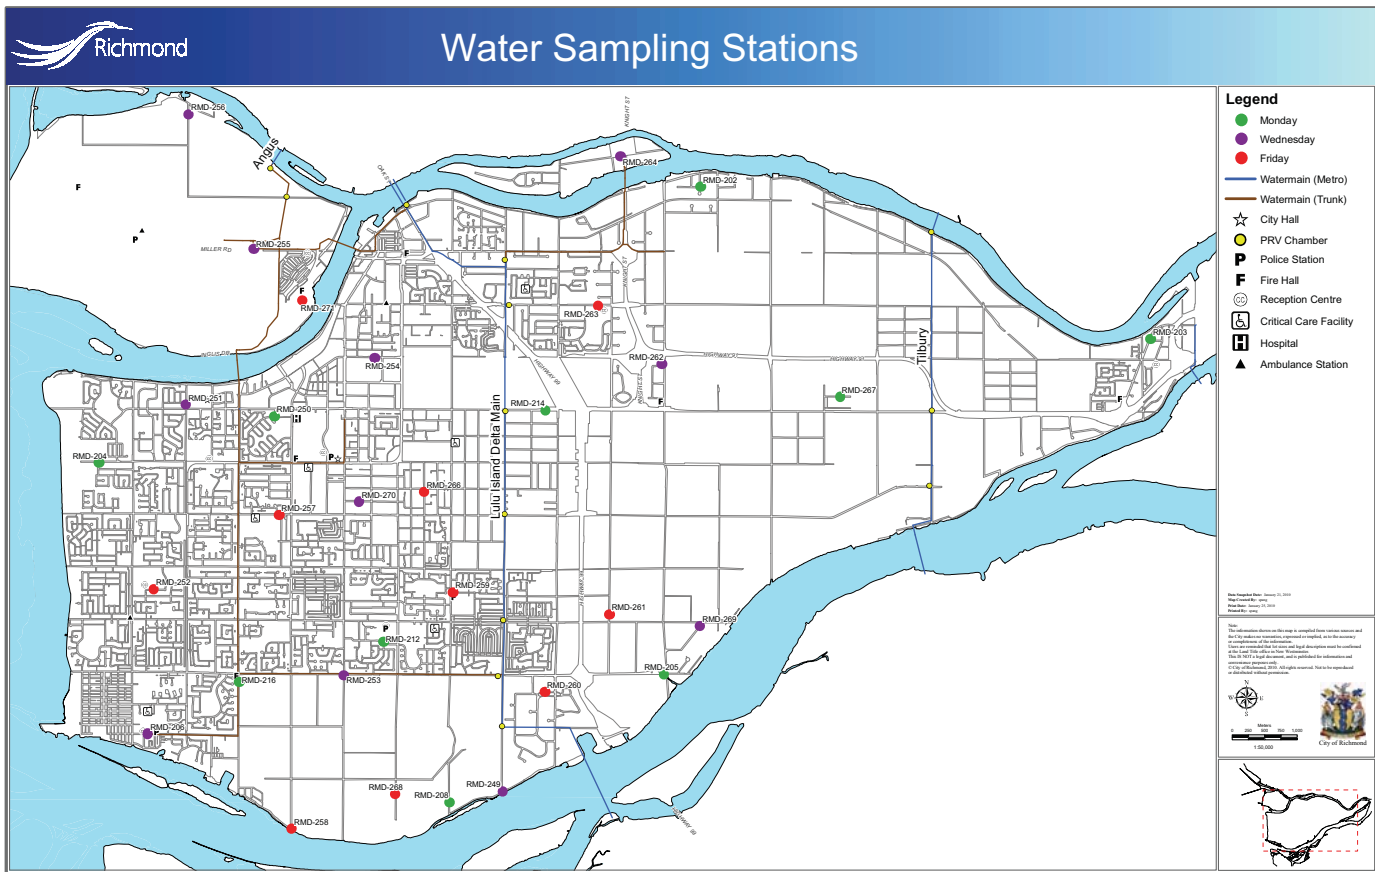

## Fecal Coliforms

Fecal coliforms are present in large numbers in the feces and intestinal tracts of humans and other warm-blooded animals, and can enter water bodies from human and animal waste. They are key indicators of sewerage contamination. Due to diseases and parasites, which are spread through sewerage, provincial standard state there can be no detectable fecal coliforms per 100ml sample.

## Results

In 2011, 1,936 water samples were collected by City staff and analyzed by Metro Vancouver Laboratory staff. All samples met drinking water requirements for fecal and total coliforms. The City of Richmond was in compliance with BCDWPR for bacteria in 2011.

## Failed samples

The standard response to a failed water sample, should there be one, is to:

1. Re-sample at the site
2. Flush the water main extensively
3. Re-sample

The water main is then isolated to one feed until test results confirm compliance with BCDWPR regulation.



*Check your quarterly water bill to track usage and get a feel of the impact of consumption habits.*

### Heterotrophic Plate Count

HPC tests measure aerobic heterotrophic bacteria. This test is useful in monitoring the effectiveness of disinfection and in determining changes in water quality during treatment and distribution. HPC tests indicate the onset of bacterial re-growth within the distribution system commonly due to stagnant water contained in dead end and low flow water mains. In 2011,

none of 1,936 (33 samples of the total of 1936 samples were not tested for HPC levels) exceeded regulated levels for HPC's at >500 CFU/mls. One sample registered 480 CFU/mls and as a precautionary measure, Water Services staff flushed the corresponding section of water main until a satisfactory result was obtained and verified through additional sampling procedure. No results indicated increased levels of fecal or total coliform bacteria in any samples collected and analyzed.

### Physical Parameters

Water in Richmond's distribution system is tested for the physical parameters of turbidity and temperature at the same time as bacteriological testing. Information is also collected on the taste and odour of Richmond's water by actively tracking water quality complaints.

### Turbidity

Metro Vancouver is responsible for the quality of Richmond's source water. Turbidity, a measure of water clarity, was monitored on a regular basis in 2011. Turbidity is measured in Nephelometric Turbidity Units (NTU). In 2001 the Chief Medical Health Officer (CMHO) made it a requirement that the Metro Vancouver Water District must meet the British Columbia Drinking Water Protection Regulation's (BCDWPR) criteria for drinking water quality. The guideline for turbidity (cloudiness) was established at  $\leq 1$  NTU. Early in 2006, Health Canada published a new guideline for turbidity, which includes requirements for unfiltered water sources. The new guideline allows for turbidity levels up to 5 NTUs providing source water protection, monitoring, and water treatment requirements are met including increased levels of residual chlorine. We are concerned about turbidity because studies have shown that as turbidity increases, the risk of gastrointestinal illness increases. Increased turbidity compromises the drinking water disinfection process.

In general, sites with elevated turbidity are located in sections of the distribution network where there is low demand on the water system or where dead end water mains exist. During the year, when sampling indicates a turbidity level greater than >5 NTU's, affected water mains in the test area are flushed, and re-tested until a satisfactory result is obtained.

The pictures to the left demonstrates the differences between a fish swimming in water with low turbidity compared to a fish swimming in water with high turbidity. Occurrences of high turbidity in supply reservoirs are usually a direct result of storm water run off during periods of heavy rainfall within the watershed.



This photo demonstrates low turbidity



This photo demonstrates high turbidity



In 2011, all but one sample out of the 1,936 samples collected from the City's water distribution system met the aesthetic objective of  $\leq 5$  NTU at the tap. The section of water main which had a reading of 6.6 NTU was extensively flushed and retested to confirm that the elevated turbidity level had been removed.

The original BCDWPR requirement that turbidity levels are  $\leq 1$  NTU was not met for 6 of 1,936 samples tested in 2011. There is a marked decrease in the number of recorded elevated turbidity events in 2011 compared to the same time period in 2010 when the numbers were 11 of 1489 samples. In 2008, there were 59 of 1483 samples with NTUs  $> 1$ . In 2007, there were 259 samples out 1543 samples, which indicated turbidity levels above 1 NTU.

Year	HPC CFU/mls $> 5$ NTUs
2006	25 of 1491
2007	6 of 1543
2008	1 of 1483
2009	3 of 1489
2010	0 of 1649
2011	1 of 1936

The majority of elevated results in 2011 were only slightly higher than 1 NTU, and were lower than 5 NTU'S which did not pose any serious threat to the water quality. The decrease in samples of  $> 1$  NTU can be attributed to distribution system maintenance practice performed by Richmond Water Services staff, but the impact of the new Seymour/Capilano Filtration Plant must once again be acknowledged as a major contributor in the control of turbidity in the water distribution system. As we move towards 2013, the turbidity problem will be further reduced as more filtered water is delivered to the region from the reservoirs. However, the full potential of the filtration plant will not be realized until 2013, when the tunnels which will deliver water from the Capilano water shed to the filtration plant at the Seymour water shed are put into service.



*Keep a pitcher of water in the refrigerator instead of running the tap for cold drinks.*



Know where your master water shut-off valve is located. This could save litres of water and damage to your home if a pipe were to burst.



Seymour Capilano Water Filtration Projects



Seymour Falls Dam Upgrade

### Temperature

High temperatures in the distribution system can affect the residual level of chlorine and can contribute to bacterial re-growth. Typically, the temperature of drinking water in the distribution system rises during summer months. Samples exceeded the aesthetic guideline of 15 °C 49 times out of 1,936 samples with temperatures as high as 20 °C were recorded. The majority of these elevated temperatures were recorded during the summer months.



Capilano Water Filtration Projects



*Try to avoid using recreational water toys that require a constant flow of water.*

### Taste and Odour

Taste and odour are only monitored in response to customer complaints. Records indicate that 11 complaints were received regarding taste and 5 complaints were received regarding odour in 2011. These complaints generally relate to high levels of residual chlorine in that part of the system at that particular time. Residents who complained about taste or odour problems were advised to flush their internal system. If the problem was not resolved, Water Services staff were dispatched to the location where they flushed the corresponding sections of water main until a satisfactory result was obtained and verified through laboratory analysis.

### Chemical Parameters

The City of Richmond in partnership with Metro Vancouver tests for the following Chemical parameters; chlorine residual, trihalomethanes (THM), haloacetic acids (HAA), and pH. Periodic testing is also performed to determine heavy metals levels in the water system.

### Free Chlorine Residual

Chlorine residual is a measurement of the disinfecting agent remaining in the distribution system at the point of delivery to the customer. Ensuring proper levels of chlorine in the distribution system is essential in protecting Richmond's water supply from bacteriological contamination or re-growth. In recent years, the City has made great progress in improving chlorine residuals by implementing various flushing programs. In 2011, the majority of all samples met the guideline for adequate chlorine residual in the water distribution system. Some samples taken in the east end of Richmond did fall below the minimum chlorine residual level but never reached the point where there was no residual present. Richmond Water Services staff recognized the deficiency immediately in the water sample results and flushing of the affected sections of water main was immediately carried out until the chlorine residual was elevated to a more satisfactory level.



*Run the washing machine and dishwasher only with a full load. This could save 3,700 litres per month.*

There were 2 sites in Richmond that had been identified as problem areas for maintaining adequate chlorine residual levels on a regular basis. The Water Services division had installed environmentally friendly automatic flushing units which flush the water main at pre-scheduled times to help maintain adequate chlorine residual levels at all times. At one of these sites staff were able to remove the automatic flushing station because the water system was modified at Triangle Road in the first quarter of 2011. The flushing unit is no longer required at this site.

The automatic units are used to minimize the labor costs associated with manual flushing procedures.

### **Disinfection By-Products**

Disinfection by-products are potentially harmful compounds produced by the reaction of a water disinfectant (such as chlorine or ozone) with naturally occurring organic matter in water. Two common chlorination by-products are Trihalomethanes (THMs) and Haloacetic Acids (HAAs). In drinking water, THMs can enter the human body via multiple routes of exposure. These include ingestion by consuming water and inhalation and skin absorption from showering and bathing. THMs are not actually regulated and are only a guideline as they only come under GCDWQ with an interim maximum acceptable concentration (IMAC) of 100 ppb (parts per billion). The 100 ppb level for THMs is based on an annual average. High levels on a particular day are not of concern unless they are consistently high over a period of time. Typically, THM levels will be highest in the summer and lowest in the winter months. In 2011, the City utilized the Metro Vancouver laboratory to perform quarterly tests for HAA's and THM's. These were carried out at representative sampling sites in accordance with a joint Metro Vancouver/Richmond monitoring plan. In 2011, all results were within acceptable levels as defined in the GCDWQ. (Appendix 5)

Currently there are no regulations or guidelines for HAA in Canada; a maximum level of 60 ppb (parts per billion) has recently been adopted in the United States.

### **pH Value**

The measurement of acidity is known as pH. A pH below 7.0 is considered acidic, above 7.0 is considered basic, with 7.0 being neutral. In 2011, Metro Vancouver treated water recorded a pH of 6.1 to 7.0 meeting the aesthetic objective. It is recognized that acidic water will accelerate the corrosion of metal pipes, often causing blue-green staining in household fixtures.

The new Seymour-Capilano filtration plant includes pH adjustment and corrosion control in its treatment processes. It is expected that the pH of drinking water will rise in the coming years as the filtration plant reaches its full potential in 2013. This will extend the lifespan of water plumbing systems and enhance water quality.

### **Metals**

The City's water quality program also includes testing for metals, such as copper, iron, lead, and zinc. All results were within GCDWQ limits for 2011. Complete test results are included in Appendix 6.

## Challenges and Issues

The City of Richmond faces a number of challenges to maintain the water distribution system, including:

- Annual Water main flushing programs. These programs prevent the build up of sediment deposits and discourage bacterial re-growth. The only flushing performed in 2011 was on a demand basis when water quality did not reach the required standard. Specific water mains were flushed based on water quality analysis results provided by the staff at Metro Vancouver Laboratories. It is anticipated that the new filtration plant will further minimize the need to flush water mains. The target is to develop a five year flushing program, during which 20% of the water distribution system will be flushed each year. The start date for this program is scheduled for the Spring of 2013.
- Water main breaks remain a possible source of contamination. Assessment of the appropriate level for the water main replacement program is currently on going by the City's Engineering Planning and Water Services sections.
- Richmond has a large number of dead end and low flow water mains, this leads to reduced levels of chlorine and increased HPC counts. Weekly and monthly flushing programs minimize these water quality issues. City staff intend to eliminate dead end water mains by creating looped systems wherever possible in the future.
- Service connection failures occur periodically in various locations within the City. Water service connection failures continue to be a maintenance issue. This is mostly attributed to service piping materials that have not met projected service life or have reached the end of anticipated life expectations. In 2011, the Water Services division continued to perform upgrades to water service lines in areas where these material problems have been identified.
- A number of Water Services staff, currently employed by the City of Richmond, will be eligible for retirement in the next three years. A strong focus on staff training is on going to ensure a succession plan is in place. High priority has been set around staff training and development.



*Match the water level to the size of the load when doing laundry.*



Water Services crew installing a large residential/commercial water supply line.



Water Services crew upgrading an existing supply line



*Did you know that the City of Richmond Water Services section installs water lines a minimum of 450mm below ground so they won't freeze in cold conditions?*

## **Current and Proposed Work**

In 2011, the following work was completed to ensure the quality of water provided to customers by the City:

- Continued progress on the metering projects for both single and multi family residential customers.
- On-going water main replacement program.
- PRV station upgrades, both for seismic retrofitting and installation of S.C.A.D.A systems. In 2011, the replacement of the Nelson Road and Westminster Highway PRV station was completed as part of the new Nelson Road interchange project.
- A program to upgrade water supply lines where there has been on-going maintenance issues. This includes the installation of water meters at these sites to support the water metering program.

### **The following work is planned for 2012:**

- Continued residential water meter installations through the volunteer programs, capital projects and planned maintenance programs.
- Continued meter installations at multi family complexes.
- \$7 million in water main upgrades through the Capital Water Main Replacement program.
- On-going additional PRV station upgrades.
- Continued implementation of a comprehensive water loss management and leak detection program to ensure effective financial management of Richmond's Water Distribution System.

## Annual System Maintenance

The following annual maintenance functions were undertaken by the City of Richmond to maintain water quality in distribution system in 2011.

### Water Sampling and Analysis

2011 Budget: \$74,300.00

Sampling and analysis are conducted on an on-going basis in conjunction with Metro Vancouver. Sampling results are reviewed by the MHO. The City takes approximately 1936 water samples in a year.

### S.C.A.D.A

2011 Budget: \$179,500.00

This program currently provides for maintenance and operation of the City's Supervisory Control And Data Acquisition system. S.C.A.D.A allows for the collection of real-time data related to water quality and the City's water distribution system in general.

### Water Main Flushing

2011 Budget: \$260,800.00

The Water Services Division conducts various flushing programs to remove sediment in order to maintain water quality. These programs are scheduled on an on-going basis throughout the year. Targeted flushing in a number of areas has greatly improved levels of chlorine residual. The City continues to explore ways to improve residual chlorine levels through water modeling, the replacement of dead end water mains, and the installation of automated flushing stations. In 2011 \$171,269.75 of the allotted budget amount (63.72%) was expended to fund these flushing programs.



*Did you know that the water temperature in the pipes is approximately 9 degrees?*



Pressure reducing valve (PRV) stations are monitored by S.C.A.D.A.



Water Services staff flushing the main line as part of the low flow flushing program



*Did you know that most of the average household's indoor water usage is from the toilet?*

- Toilets 25%
- Washing machines 21%
- Showers 17%
- Faucets 16%
- Leaks 14%
- Baths 2%
- Dishwashers 2%
- Other 2%

### **Demand Water Main Flushing**

2011 Budget \$59,900.00

This program covers unscheduled flushing of water mains due to Customer Service requests related to degraded water quality caused by bacteria, turbidity, or other water quality issues. The City responded to 83 water quality complaints in 2011. This number is down from 119 incidents in 2010. In 2011 \$25,811.55 of the allotted budget amount (43.09%) was expended to fund these demand flushing situations.

### **Cross-Connection Control**

2011 Budget: \$38,300.00

This program is designed to prevent contamination from entering the system via uncontrolled "cross-connections". The installation of back flow prevention devices and the review of new plumbing installations protect the public from this threat. The use of fire hydrants for construction is also a potential source of backflow. To prevent contamination, City staff are required to install a "backflow prevention" device before a hydrant is used for any type of construction work. City Meter Shop staff also test backflow devices installed on internal plumbing systems at all City owned facilities.

### **Blow Off/Scour Valve Installations**

2011 Budget: \$30,700.00

This program is for the installation of blow off valves throughout the City. These valves are located on streets where no fire hydrant is available for flushing, and water quality may become an issue. The current service level for this program budgets for the installation of 4 blows off valves per year. These valves allow for effective operation of our annual flushing program.

### **Water Main Replacement**

2011 Budget: \$7,600,000

To reflect the 100-year life of Richmond's water distribution system comprising of asbestos cement, plastic (C-900) and steel water mains, an annual expenditure of approximately \$7.5M is required to maintain the replacement cycle. Provisions have been made in the long-range financial plan to maintain this level of funding within the next few years.



## Mobile Emergency Response Unit

The Water Services division has a mobile unit for use during major emergencies caused by cross contamination events or natural disasters. This unit is capable of taking a non-potable water supply such as Minoru Lake or water from the Fraser River, which has a very high saline content through a combination of five stage filtration processes to produce potable water. The unit is capable of producing 21,000 gallons of potable water per day from non-saline, non-potable supplies or 14,000 gallons of potable water per day from water supplies, which have a saline content. This unit is one of only two such units in British Columbia and is the only unit in British Columbia capable of filtering water from the Fraser River if necessary. This unit can also be used to assist staff when chlorination and de-chlorination of new and existing water infrastructure prior to activation.



*Did you know that Water Services section specialists use acoustic instruments to hear and detect water leaking underground?*



Inside the Mobile Emergency Response Unit



The Tap Water Station display



Water Services crew setting up the Tap Water Station



The donated rain barrels by Coca-cola



Standard City of Richmond rain barrel

## Water Conservation Programs

### Tap Water Initiative

In 2010, Metro Vancouver initiated its tap water usage promotion. The intent of this initiative is to make the public aware of the locations of all municipal drinking fountains so that the public can refill water bottles or simply get a drink of water. It is hoped that this initiative will work towards reducing and eventually eliminating the need for the public to purchase bottled water, which will, in turn help to protect the environment. To support this initiative the City of Richmond Water Services division purchased two Tap Water Stations similar to those that belong to the City of Vancouver. In 2011, these units were made available at all City endorsed functions and community events taking place at various locations around Richmond. The stations received many positive comments from members of the public who attended the events.

### Toilet Rebate

The City of Richmond's Toilet Rebate Program provides a utility tax rebate of \$100.00 to homeowners who install a low-flush toilet. Single and multi-family homeowners are eligible to apply for a lifetime maximum of two rebates per household. Industrial, commercial and other non-residential properties are not eligible at this time.

The purpose of the toilet rebate program is to encourage homeowners to replace high volume toilets with low-flush toilets to conserve water and to reduce costs. Homeowners will enjoy a reduction in their utility bill while contributing to a sustainable water conservation initiative.

### Rain Barrel

The rain barrel program promotes water conservation and sustainability by collecting and storing water for outdoor usage such as watering your garden. Using rainwater will reduce the amount of tap water you use, therefore, saving money on your utility bill. Other benefits include:

- decreasing water demand during peak summer months and using it as a backup water source for outdoor usage during times of drought,
- decreasing the strain on water treatment facilities and municipal drainage systems during storms,
- reducing the amount of water entering the sewerage treatment facility,
- maintaining healthy plants and lawn because rainwater is chlorine-free, and
- preventing drainage problems around your home's foundation.

Rain barrels may be purchased at the City's Recycling Depot by Richmond residents only. The City offers 45 gallon barrels (202 litres) and 50 gallon barrels (225 litres) for \$20.00. In 2011 the City of Richmond entered into an agreement with Coca Cola. Through the agreement Coca Cola provides the City with empty product barrels. The City retrofits the barrels for use as rain barrels. These barrels are available to the public at a cost of \$12.50. All rain barrels require a water diverter unit (\$16.00) to hook up to the downspout of the water runoff from the roof.

## Single Family and Multi-Family Water Meter Programs

This voluntary water meter program was endorsed by Richmond City Council in 2003, and is designed as a strategy for fairness and equity of water use. The City of Richmond is working with Neptune Technology Group (Canada) Ltd. to implement a program that will allow residents to pay only for the actual amount of water they use, rather than being billed on the flat-rate system.

### Why does Richmond have a Voluntary Water Meter Program?

In the face of rising water rates, Richmond residents wanted a more equitable way of paying for their water use. In response to these requests, the City developed the Water Meter Program.

#### Features:

- An installation process is required, costs estimates for your home would be determined by the City.
- Quarterly payments: When you switch to a water meter, your bill is divided over four smaller payments, one every three months, instead of paying everything at the beginning of the year. This enables you to track water usage more closely.
- Free water conservation devices: To help save you water and money, all volunteers qualify for a water conservation kit, which includes the following:
  - Low-flow showerhead
  - Low-flow faucet aerators (for kitchens and bathrooms)
  - Toilet leak detection dye tablets

For more information, please contact:  
Richmond Water Meter Program: 604-271-9700  
[www.watermeter.ca](http://www.watermeter.ca)

## Project WET

Project WET is an interactive elementary school water education program aimed at teaching students about the importance of water. Largely targeted for grades four to seven, this program is designed to inform, educate and entertain students on the importance of water quality and supply.

Project WET is an exciting partnership program between the City of Richmond and the Richmond School Board. The acronym "WET" stands for "Water Education Team". Our main objective is to promote higher-level thinking skills while learning about the fundamentals of water consumption, conservation, quality and waste in an interactive and fun environment.

#### Four Key Elements of the Project WET are:


1. Water as a System—Tracing how water falls on the local mountains in the form of rain or snow, making its way through the water infrastructure system and arriving in our homes when we turn on the tap.
2. Water Conservation and Water Quality—Why water conservation and water quality are important, what the City is doing to sustain our water capacity and what students can do to help.



Water Meter Installation



Installed water meter

  
*Did you know that more plants die from over-watering than from under-watering? Be sure to only water plants when necessary and choose low-water-use plants for year-round landscape colour in order to save up to 2,000 litres per year.*



*Did you know that reusing the water from your fish tank to water your plants is providing your plant with a free fertilizer since it is rich in nitrogen and phosphorous?*

3. Why Drainage is so Important—The storm system carries runoff to the river, in compliment with an essential ditch-drainage system in Richmond. Students will learn how these drainage systems work and the importance of keeping toxic materials out of ditches and storm sewers.
4. Richmond is a Unique Island—Richmond is the only city in North America completely surrounded by dykes. Students will learn why dykes are critical in Richmond and how important it is to maintain them.



Staff demonstrating the City's water systems



Staff educating students on acoustics

## Public Notification

At the direction of the Richmond medical health officer (MHO), water quality advisories can be issued to the general public at large, small local areas, or issued recommending that immuno-compromised persons or the elderly and very young should boil, filter, or distil drinking water from surface sources. A sample of the drinking water quality advisory is included in Appendix 7.



*Did you know that weeds compete with other plants for nutrients, light and water?*

## Operator Qualifications and System Classification

Provincial drinking water standards require certification of both potable water systems and staff. This classification is done through the Environmental Operators Certification Program (EOCP). The Walkerton outbreak, which occurred in May 2000 serves as an illustration of the need to ensure system operators are properly trained. Operators need to know not only how to supply safe water on a day-to-day basis, but also how to respond to sudden source contamination, industrial spills, equipment failures, water main breaks, vandalism, and other emergencies.

### System Classification

System classification involves the evaluation of a water system, to determine and rank its complexity. Levels of complexity range from “Small System”, to Class I through Class IV. Richmond is classified as a Class III water distribution system.

### Operators Certification

“Section 12” of the Drinking Water Protection Act proclaims a person is qualified to operate, maintain or repair a water supply system if the person is certified by the Environmental Operators Certification Program (EOCP) to the same level as the system they operate. The implementation date for a Class III system was January 1, 2007.

Currently, all full-time staff with the exception of one person and many of the temporary full-time staff have achieved the EOCP certifications at the level 1 or higher. In the City of Richmond, currently 3 full-time staff have a Level III certificate.

### Benefits of a Certification Program

With water and wastewater employees being properly trained and certified, the public, the corporation, regulatory agencies, and managers can be confident that water services and sewer and drainage staff have the skills, knowledge, abilities, experience, and judgment to competently perform their job.

#### Certified employees can:

- Maximize the performance of water and wastewater infrastructure
- Minimize health risks and environmental concerns
- Optimize operational cost
- Protect infrastructure investment

#### Certification has resulted in:

- Improved safety and reduced accident rates.



*Did you know that installing aerators with flow restrictors on faucets and installing low-flow showerheads significantly reduce water consumption?*

- Compliance with water/pollution control legislation.
- Enhanced career opportunities for certified operators, ease of hiring, promotion, and establishing of salary levels based on certification.
- Minimum qualification standards requiring operators to pass a comprehensive exam.
- A focus on the development of training materials based on "need to know" criteria.
- A means of recognition of peers, owners, and managers of the water distribution system.

### **Operator Training**

Through obtaining certification, members of staff are able to gain a better understanding of the work they perform, giving staff the confidence to make informed decisions. In 2011, the training budget was \$75,000 for the Water Services division. All staff are encouraged to take the courses, which will enable them to advance to higher levels. In addition, participation in additional training seminars and courses is encouraged with fees paid by the City, upon successful completion.

### **Security Measures**

In preparation for the 2010 Winter Olympic Games security was enhanced at all of the City's PRV stations to insure that access to these facilities was only available to authorized personnel. On-going upgrades to the City's S.C.A.D.A system include security intrusion alarms. This program will continue until all sites are protected.

### **Emergency Response Plan**

In the event of possible contamination of the water system, the City of Richmond, Metro Vancouver, and regional health authority have developed a number of emergency response plans.

**If contamination of the water system is suspected, water services staff must:**

- Ensure safety of response crew.
- Notify the appropriate agencies and City personal (Table 4).
- Isolate the actual or suspected contamination, and determine its source.
- Provide water samples to the Metro Vancouver Lab.
- Flush water from an uncontaminated source to purge actual or suspected contaminant, following procedures for de-chlorination and the proper disposal of water.
- Through the continuous feed method, inject sodium chloride 12% into the contaminated water main with a dosage of 300 mg/l or 300 ppm.
- This dosage should be maintained for 3 hours after which the chlorine should be removed and neutralized with sodium thiosulphate to ensure no environmental impact.
- Provide additional water samples to the Metro Vancouver Lab for re-testing.

Depending on the nature of the contamination, the Medical Health Officer (MHO) may decide to leave the water main in service and issue a boil water advisory, or may instruct the City to provide alternative water to those

affected. Once water samples are confirmed as being within normal water quality standards within the affected sections of the water distribution system, the water mains can be placed back in service. See Appendix 7 for specific emergency response plans.

**Table 2 – Agency Notification for Situations Drinking Water Safety**

Situation	Notifying Agency	Agency Notified	Time Frame For Notification
Fecal positive sample	City of Richmond Metro Vancouver Lab	City of Richmond / MHO	Immediate
Chemical/biological contamination	City of Richmond Metro Vancouver Lab	City of Richmond / MHO	Immediate
Turbidity > 5 NTU	City of Richmond Metro Vancouver Control Centre Metro Vancouver Lab	City of Richmond / MHO	Immediate
Disinfection failure primary or secondary disinfection	City of Richmond Metro Vancouver Control Centre Metro Vancouver Lab	City of Richmond / MHO	Immediate, where BC DWPR or GCDWQ guidelines may not be met
Loss of pressure due to high demand	City of Richmond Metro Vancouver Control Centre	MHO City of Richmond Metro Vancouver Control Centre	Immediate
Water main break where the pressure drops below 20 psi.	City of Richmond Metro Vancouver Control Centre	MHO City of Richmond	Immediate



## Conclusion

Richmond residents enjoyed very high quality drinking water in 2011. While colour, temperature, and low pH can cause occasional aesthetic problems, the protected nature of the Metro Vancouver watersheds allows the City to supply water to residents with a low potential for microorganism contamination.

In previous years, portions of the distribution system have experienced lower than desirable chlorine residual values. However, the extent of these conditions has improved greatly with the implementation of weekly and monthly flushing, installation of automated flushing points, and active replacement of water services and water main infrastructure.

In addition, turbidity in sections of the water distribution system has been an issue. To combat these problems, staff continue to employ best management practices in the operation and maintenance of the water system. The completion of the Seymour-Capilino Filtration Plant has significantly reduced the level of turbidity in Metro Vancouver source water and prevented any drinking water advisories, like the one experienced in November 2006.

The City achieved a milestone in 2006 by meeting "Section 12" of the Drinking Water Protection Act. This ensures that water service staff have been certified by the EOCP, to the same level as the distribution system. Experienced and highly trained Water Services staff are well equipped to operate and maintain all aspects of the water system from source to property line.

The City of Richmond has steadily improved and upgraded its water distribution system, with water sample test results indicating a significant improvement in water quality over the past number of years. The City of Richmond remains diligent in ensuring this system is maintained to the high standards expected by Richmond residents, and that its contingency plans, in the event of an emergency, are thorough and up to date.

The City appreciates the good working relationship with Vancouver Coastal Health Authority and acknowledges them as important partners in maintaining high quality drinking water throughout the City of Richmond.

Doug Anderson  
*Manager, Water Services*  
City of Richmond  
604-233-3334  
danderson@richmond.ca



## **Appendicies**

APPENDIX 1: DRINKING WATER/WATER QUALITY WEBSITES AND REFERENCES

APPENDIX 2: COMPLETE 2010 CITY OF RICHMOND WATER QUALITY RESULTS

APPENDIX 3: CITY OF RICHMOND S.C.A.D.A AND PREASURE TESTING SITES

APPENDIX 4: CITY OF RICHMOND WATER SAMPLING SITES

APPENDIX 5: 2011 THM AND HAA TEST RESULTS

APPENDIX 6: CITY OF RICHMOND: 2011 HEAVEY METAL TESTING RESULTS

APPENDIX 7: SAMPLE DRINKING WATER QUALITY ADVISORY

APPENDIX 8: SPECIFIC EMERGENCY RESPONSE PLANS

## **APPENDIX 1: DRINKING WATER/WATER QUALITY WEBSITES AND REFERENCES**

1. Health Canada Drinking Water Guid Lines  
[www.hc-sc.gc.ca/ewh-semt/water-eau/drink-potab/index\\_e.html](http://www.hc-sc.gc.ca/ewh-semt/water-eau/drink-potab/index_e.html)
2. Provincial Drinking Water Protection Act (2003)  
[www.qp.gov.bc.ca/statreg/reg/D/200\\_2003.htm#section8](http://www.qp.gov.bc.ca/statreg/reg/D/200_2003.htm#section8)
3. Greater Vancouver Regional District – Source Water Quality and Supply  
[www.gvrd.ca/water/index.htm](http://www.gvrd.ca/water/index.htm)
4. Richmond Health Services (Regional Health Authority)  
[www.rhss.bc.ca/bins/index.asp](http://www.rhss.bc.ca/bins/index.asp)
5. British Columbia Water Works Association  
[www.bcwwa.org/](http://www.bcwwa.org/)
6. American Water Works Association  
[www.awwa.org/](http://www.awwa.org/)
7. Metro Vancouver  
[www.metrovancouver.org](http://www.metrovancouver.org)

## APPENDIX 2: COMPLETE 2010 CITY OF RICHMOND WATER QUALITY RESULTS

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-251	5951McCallan Rd.	5-Jan-11	0.86	<1	<2	6	<1	0.13
RMD-273	Opp. 8331 Fairfax Place	5-Jan-11	0.77	<1	<2	7	<1	0.19
RMD-252	9751 Pendleton Rd.	5-Jan-11	0.83	<1	<2	7	<1	0.14
RMD-274	10920 Springwood Court	5-Jan-11	0.76	<1	<2	9	<1	0.21
RMD-250	6071 Azure Rd.	5-Jan-11	0.94	<1	<2	7	<1	0.13
RMD-271	3800 Cessna Drive	5-Jan-11	0.83	<1	<2	9	<1	0.16
RMD-272	751 Catalina Cres.	5-Jan-11	0.80	<1	<2	6	<1	0.15
RMD-255	6000 Blk. Miller Rd.	5-Jan-11	0.87	<1	<2	5	<1	0.31
RMD-256	1000 Blk. McDonald Rd.	5-Jan-11	0.78	<1	<2	7	<1	0.15
RMD-254	5300 No. 3 Rd.	5-Jan-11	0.79	<1	<2	6	<1	0.14
RMD-270	8200 Jones Rd.	5-Jan-11	0.83	<1	<2	6	<1	0.14
RMD-253	11051 No 3 Rd.	5-Jan-11	0.87	<1	<2	6	<1	0.17
RMD-257	6640 Blundell Rd.	7-Jan-11	0.88	<1	<2	5	<1	0.16
RMD-266	9380 General Currie Rd.	7-Jan-11	0.82	<1	<2	5	<1	0.10
RMD-259	10020 Amethyst Ave.	7-Jan-11	0.81	<1	<2	5	<1	0.14
RMD-268	13800 No. 3 Rd. (off Garden City)	7-Jan-11	0.86	<1	<2	5	<1	0.13
RMD-263	12560 Cambie Rd.	7-Jan-11	0.75	<1	<2	5	<1	0.15
RMD-278	6651 Fraserwood Place	7-Jan-11	0.04	<1	8	7	<1	0.22
RMD-279	Opp. 20371 Westminster Hwy.	7-Jan-11	0.16	<1	14	6	<1	0.30
RMD-264	13100 Mitchell Rd.	7-Jan-11	0.79	<1	<2	6	<1	0.19
RMD-204	3180 Granville Ave.	10-Jan-11	0.82	<1	<2	6	<1	0.13
RMD-206	4251 Moncton St.	10-Jan-11	0.84	<1	<2	6	<1	0.11
RMD-216	11080 No. 2 Rd.	10-Jan-11	0.81	<1	<2	5	<1	0.10
RMD-258	7000 Blk. Dyke Rd.	10-Jan-11	0.80	<1	<2	4	<1	0.12
RMD-212	Opp. 8880 Williams Rd.	10-Jan-11	0.85	<1	<2	5	<1	0.13
RMD-260	11111 Horseshoe Way	10-Jan-11	0.84	<1	<2	4	<1	0.12
RMD-208	13200 No. 4 Rd.	10-Jan-11	0.85	<1	<2	6	<1	0.13
RMD-261	9911 Sidaway Rd.	10-Jan-11	0.8	<1	<2	4	<1	0.10
RMD-205	13851 Steveston Hwy.	10-Jan-11	0.86	<1	<2	6	<1	0.31
RMD-262	13799 Commerce Pkwy.	10-Jan-11	0.82	<1	<2	4	<1	0.10
RMD-267	17240 Fedoruk	10-Jan-11	0.77	<1	<2	6	<1	0.13
RMD-249	23000 Blk. Dyke Rd.	10-Jan-11	0.33	<1	<2	7	<1	0.53
RMD-277	Opp. 11280 Twigg Place	10-Jan-11	0.67	<1	<2	6	<1	0.14
RMD-275	5180 Smith Cres.	10-Jan-11	0.37	<1	<2	7	<1	0.52
RMD-276	22271 Cochrane Drive	10-Jan-11	0.29	<1	<2	7	<1	0.42
RMD-203	23260 Westminster Hwy.	10-Jan-11	0.42	<1	<2	7	<1	0.52
RMD-202	1500 Valemont Way	10-Jan-11	0.63	<1	<2	6	<1	0.28
RMD-214	11720 Westminster Hwy.	10-Jan-11	0.90	<1	<2	5	<1	0.17

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-251	5951McCallan Rd.	12-Jan-11	0.82	<1	<2	6	<1	0.17
RMD-273	Opp. 8331 Fairfax Place	12-Jan-11	0.72	<1	2	7	<1	0.18
RMD-252	9751 Pendleton Rd.	12-Jan-11	0.79	<1	<2	7	<1	0.13
RMD-274	10920 Springwood Court	12-Jan-11	0.58	<1	<2	9	<1	0.15
RMD-250	6071 Azure Rd.	12-Jan-11	0.67	<1	<2	7	<1	0.14
RMD-271	3800 Cessna Drive	12-Jan-11	0.60	<1	<2	9	<1	0.14
RMD-272	751 Catalina Cres.	12-Jan-11	0.78	<1	2	7	<1	0.12
RMD-255	6000 Blk. Miller Rd.	12-Jan-11	0.81	<1	<2	5	<1	0.31
RMD-256	1000 Blk. McDonald Rd.	12-Jan-11	0.75	<1	<2	6	<1	0.13
RMD-254	5300 No. 3 Rd.	12-Jan-11	0.80	<1	<2	6	<1	0.12
RMD-270	8200 Jones Rd.	12-Jan-11	0.77	<1	2	6	<1	0.11
RMD-269	14951 Triangle Rd.	12-Jan-11	0.82	<1	<2	7	<1	0.16
RMD-253	11051 No 3 Rd.	12-Jan-11	0.65	<1	<2	5	<1	0.14
RMD-257	6640 Blundell Rd.	14-Jan-11	0.85	<1	<2	5	<1	0.15
RMD-258	7000 Blk. Dyke Rd.	14-Jan-11	0.73	<1	<2	6	<1	0.18
RMD-268	13800 No. 3 Rd. (off Garden City)	14-Jan-11	0.73	<1	<2	6	<1	0.13
RMD-259	10020 Amethyst Ave.	14-Jan-11	0.77	<1	<2	7	<1	0.12
RMD-266	9380 General Currie Rd.	14-Jan-11	0.63	<1	<2	5	<1	0.12
RMD-260	11111 Horseshoe Way	14-Jan-11	0.87	<1	<2	5	<1	0.14
RMD-261	9911 Sidaway Rd.	14-Jan-11	0.9	<1	<2	5	<1	0.17
RMD-263	12560 Cambie Rd.	14-Jan-11	0.73	<1	<2	6	<1	0.17
RMD-262	13799 Commerce Pkwy.	14-Jan-11	0.85	<1	2	6	<1	0.12
RMD-264	13100 Mitchell Rd.	14-Jan-11	0.69	<1	<2	7	<1	0.14
RMD-277	Opp. 11280 Twigg Place	14-Jan-11	0.67	<1	<2	9	<1	0.13
RMD-278	6651 Fraserwood Place	14-Jan-11	0.03	<1	30	8	<1	0.29
RMD-279	Opp. 20371 Westminster Hwy.	14-Jan-11	0.12	<1	8	7	<1	0.30
RMD-204	3180 Granville Ave.	17-Jan-11	0.81	<1	<2	5	<1	0.15
RMD-206	4251 Moncton St.	17-Jan-11	0.87	<1	<2	5	<1	0.13
RMD-216	11080 No. 2 Rd.	17-Jan-11	0.89	<1	<2	5	<1	0.14
RMD-212	Opp. 8880 Williams Rd.	17-Jan-11	0.78	<1	<2	6	<1	0.18
RMD-208	13200 No. 4 Rd.	17-Jan-11	0.87	<1	2	5	<1	0.12
RMD-205	13851 Steveston Hwy.	17-Jan-11	0.74	<1	220	5	<1	0.15
RMD-267	17240 Fedoruk	17-Jan-11	0.89	<1	<2	5	<1	0.13
RMD-249	23000 Blk. Dyke Rd.	17-Jan-11	0.57	<1	<2	6	<1	0.49
RMD-276	22271 Cochrane Drive	17-Jan-11	0.33	<1	<2	5	<1	0.41
RMD-275	5180 Smith Cres.	17-Jan-11	0.45	<1	<2	6	<1	0.50
RMD-203	23260 Westminster Hwy.	17-Jan-11	0.58	<1	<2	5	<1	0.58
RMD-202	1500 Valemont Way	17-Jan-11	0.80	<1	<2	5	<1	0.17
RMD-214	11720 Westminster Hwy.	17-Jan-11	1.0	<1	<2	4	<1	0.12
RMD-251	5951McCallan Rd.	19-Jan-11	0.86	<1	<2	6	<1	0.15

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-273	Opp. 8331 Fairfax Place	19-Jan-11	0.78	<1	<2	8	<1	0.11
RMD-252	9751 Pendleton Rd.	19-Jan-11	0.76	<1	<2	7	<1	0.09
RMD-274	10920 Springwood Court	19-Jan-11	0.78	<1	<2	9	<1	0.17
RMD-250	6071 Azure Rd.	19-Jan-11	0.74	<1	<2	7	<1	0.14
RMD-271	3800 Cessna Drive	19-Jan-11	0.67	<1	2	8	<1	0.20
RMD-272	751 Catalina Cres.	19-Jan-11	0.82	<1	<2	6	<1	0.11
RMD-255	6000 Blk. Miller Rd.	19-Jan-11	0.83	<1	<2	6	<1	0.26
RMD-256	1000 Blk. McDonald Rd.	19-Jan-11	0.76	<1	<2	7	<1	0.10
RMD-254	5300 No. 3 Rd.	19-Jan-11	0.79	<1	2	6	<1	0.15
RMD-270	8200 Jones Rd.	19-Jan-11	0.81	<1	4	6	<1	0.13
RMD-253	11051 No 3 Rd.	19-Jan-11	0.82	<1	<2	7	<1	0.12
RMD-257	6640 Blundell Rd.	21-Jan-11	0.87	<1	<2	4	<1	0.12
RMD-266	9380 General Currie Rd.	21-Jan-11	0.85	<1	<2	4	<1	0.15
RMD-259	10020 Amethyst Ave.	21-Jan-11	0.85	<1	<2	5	<1	0.11
RMD-268	13800 No. 3 Rd. (off Garden City)	21-Jan-11	0.74	<1	<2	5	<1	0.14
RMD-258	7000 Blk. Dyke Rd.	21-Jan-11	0.72	<1	<2	5	<1	0.11
RMD-260	11111 Horseshoe Way	21-Jan-11	0.87	<1	<2	4	<1	0.10
RMD-261	9911 Sidaway Rd.	21-Jan-11	0.85	<1	<2	4	<1	0.14
RMD-263	12560 Cambie Rd.	21-Jan-11	0.69	<1	<2	5	<1	0.21
RMD-262	13799 Commerce Pkwy.	21-Jan-11	0.71	<1	<2	5	<1	0.14
RMD-278	6651 Fraserwood Place	21-Jan-11	0.05	<1	4	8	<1	0.41
RMD-279	Opp. 20371 Westminster Hwy.	21-Jan-11	0.26	<1	6	8	<1	0.37
RMD-277	Opp. 11280 Twigg Place	21-Jan-11	0.76	<1	<2	6	<1	0.12
RMD-264	13100 Mitchell Rd.	21-Jan-11	0.74	<1	<2	6	<1	0.18
RMD-204	3180 Granville Ave.	24-Jan-11	0.78	<1	<2	7	<1	0.12
RMD-206	4251 Moncton St.	24-Jan-11	0.60	<1	<2	8	<1	0.10
RMD-216	11080 No. 2 Rd.	24-Jan-11	0.80	<1	<2	7	<1	0.09
RMD-212	Opp. 8880 Williams Rd.	24-Jan-11	0.71	<1	4	8	<1	0.12
RMD-208	13200 No. 4 Rd.	24-Jan-11	0.85	<1	2	6	<1	0.09
RMD-205	13851 Steveston Hwy.	24-Jan-11	0.79	<1	<2	6	<1	0.09
RMD-267	17240 Fedoruk	24-Jan-11	0.86	<1	<2	6	<1	0.08
RMD-249	23000 Blk. Dyke Rd.	24-Jan-11	0.46	<1	2	7	<1	0.37
RMD-276	22271 Cochrane Drive	24-Jan-11	0.22	<1	<2	7	<1	0.25
RMD-275	5180 Smith Cres.	24-Jan-11	0.51	<1	<2	7	<1	0.39
RMD-203	23260 Westminster Hwy.	24-Jan-11	0.50	<1	<2	7	<1	0.39
RMD-202	1500 Valemont Way	24-Jan-11	0.74	<1	<2	6	<1	0.13
RMD-214	11720 Westminster Hwy.	24-Jan-11	0.79	<1	<2	7	<1	0.11
RMD-251	5951 McCallan Rd.	26-Jan-11	0.86	<1	<2	6	<1	0.11
RMD-273	Opp. 8331 Fairfax Place	26-Jan-11	0.70	<1	<2	8	<1	0.14
RMD-252	9751 Pendleton Rd.	26-Jan-11	0.77	<1	<2	7	<1	0.10

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mls	HPC CFU/mls	Temperature °C	Total Coliform MF/100mls	Turbidity NTU
RMD-274	10920 Springwood Court	26-Jan-11	0.74	<1	2	9	<1	0.17
RMD-253	11051 No 3 Rd.	26-Jan-11	0.70	<1	<2	7	<1	0.10
RMD-269	14951 Triangle Rd.	26-Jan-11	0.76	<1	<2	8	<1	0.11
RMD-270	8200 Jones Rd.	26-Jan-11	0.79	<1	<2	7	<1	0.11
RMD-254	5300 No. 3 Rd.	26-Jan-11	0.71	<1	<2	6	<1	0.09
RMD-250	6071 Azure Rd.	26-Jan-11	0.86	<1	<2	7	<1	0.11
RMD-271	3800 Cessna Drive	26-Jan-11	0.70	<1	<2	7	<1	0.19
RMD-272	751 Catalina Cres.	26-Jan-11	0.79	<1	<2	5	<1	0.11
RMD-255	6000 Blk. Miller Rd.	26-Jan-11	0.85	<1	<2	4	<1	0.60
RMD-256	1000 Blk. McDonald Rd.	26-Jan-11	0.65	<1	<2	6	<1	0.15
RMD-257	6640 Blundell Rd.	28-Jan-11	0.89	<1	<2	4	<1	0.13
RMD-258	7000 Blk. Dyke Rd.	28-Jan-11	0.60	<1	2	6	<1	0.15
RMD-268	13800 No. 3 Rd. (off Garden City)	28-Jan-11	0.76	<1	<2	6	<1	0.12
RMD-259	10020 Amethyst Ave.	28-Jan-11	0.79	<1	<2	5	<1	0.11
RMD-266	9380 General Currie Rd.	28-Jan-11	0.84	<1	<2	4	<1	0.11
RMD-260	11111 Horseshoe Way	28-Jan-11	0.80	<1	<2	4	<1	0.13
RMD-261	9911 Sidaway Rd.	28-Jan-11	0.82	<1	<2	5	<1	0.15
RMD-262	13799 Commerce Pkwy.	28-Jan-11	0.63	<1	<2	5	<1	0.17
RMD-263	12560 Cambie Rd.	28-Jan-11	0.74	<1	<2	5	<1	0.13
RMD-264	13100 Mitchell Rd.	28-Jan-11	0.73	<1	<2	6	<1	0.19
RMD-277	Opp. 11280 Twigg Place	28-Jan-11	0.55	<1	<2	7	<1	0.17
RMD-278	6651 Fraserwood Place	28-Jan-11	0.04	<1	20	8	<1	0.24
RMD-279	Opp. 20371 Westminster Hwy.	28-Jan-11	0.21	<1	2	7	<1	0.30
RMD-204	3180 Granville Ave.	31-Jan-11	0.84	<1	<2	6	<1	0.14
RMD-206	4251 Moncton St.	31-Jan-11	0.78	<1	<2	5	<1	0.11
RMD-216	11080 No. 2 Rd.	31-Jan-11	0.80	<1	<2	5	<1	0.15
RMD-212	Opp. 8880 Williams Rd.	31-Jan-11	0.67	<1	<2	6	<1	0.17
RMD-208	13200 No. 4 Rd.	31-Jan-11	0.79	<1	<2	5	<1	0.12
RMD-205	13851 Steveston Hwy.	31-Jan-11	0.61	<1	<2	5	<1	0.10
RMD-267	17240 Fedoruk	31-Jan-11	0.73	<1	<2	5	<1	0.17
RMD-249	23000 Blk. Dyke Rd.	31-Jan-11	0.48	<1	<2	6	<1	0.34
RMD-276	22271 Cochrane Drive	31-Jan-11	0.31	<1	<2	6	<1	0.23
RMD-275	5180 Smith Cres.	31-Jan-11	0.41	<1	<2	6	<1	0.27
RMD-203	23260 Westminster Hwy.	31-Jan-11	0.55	<1	<2	6	<1	0.28
RMD-202	1500 Valemont Way	31-Jan-11	0.75	<1	<2	5	<1	0.13
RMD-214	11720 Westminster Hwy.	31-Jan-11	0.90	<1	<2	5	<1	0.11
RMD-251	5951 McCallan Rd.	2-Feb-11	0.60	<1	<2	6	<1	0.14
RMD-273	Opp. 8331 Fairfax Place	2-Feb-11	0.72	<1	<2	6	<1	0.14
RMD-252	9751 Pendleton Rd.	2-Feb-11	0.67	<1	<2	5	<1	0.17
RMD-274	10920 Springwood Court	2-Feb-11	0.71	<1	<2	7	<1	0.15

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-250	6071 Azure Rd.	2-Feb-11	0.53	<1	<2	5	<1	0.14
RMD-271	3800 Cessna Drive	2-Feb-11	0.67	<1	<2	7	<1	0.14
RMD-272	751 Catalina Cres.	2-Feb-11	0.70	<1	<2	4	<1	0.14
RMD-255	6000 Blk. Miller Rd.	2-Feb-11	0.78	<1	<2	4	<1	0.18
RMD-256	1000 Blk. McDonald Rd.	2-Feb-11	0.65	<1	<2	5	<1	0.15
RMD-254	5300 No. 3 Rd.	2-Feb-11	0.72	<1	<2	5	<1	0.13
RMD-270	8200 Jones Rd.	2-Feb-11	0.70	<1	<2	5	<1	0.17
RMD-269	14951 Triangle Rd.	2-Feb-11	0.70	<1	<2	4	<1	0.13
RMD-253	11051 No 3 Rd.	2-Feb-11	0.75	<1	<2	5	<1	0.14
RMD-257	6640 Blundell Rd.	4-Feb-11	0.78	<1	<2	4	<1	0.07
RMD-266	9380 General Currie Rd.	4-Feb-11	0.68	<1	<2	5	<1	0.08
RMD-259	10020 Amethyst Ave.	4-Feb-11	0.71	<1	<2	5	<1	0.10
RMD-268	13800 No. 3 Rd. (off Garden City)	4-Feb-11	0.61	<1	<2	5	<1	0.09
RMD-258	7000 Blk. Dyke Rd.	4-Feb-11	0.66	<1	<2	6	<1	0.10
RMD-260	11111 Horseshoe Way	4-Feb-11	0.72	<1	<2	4	<1	0.08
RMD-261	9911 Sidaway Rd.	4-Feb-11	0.73	<1	<2	5	<1	0.08
RMD-263	12560 Cambie Rd.	4-Feb-11	0.60	<1	<2	5	<1	0.13
RMD-262	13799 Commerce Pkwy.	4-Feb-11	0.57	<1	<2	5	<1	0.11
RMD-278	6651 Fraserwood Place	4-Feb-11	0.03	<1	100	7	<1	0.27
RMD-279	Opp. 20371 Westminster Hwy.	4-Feb-11	0.26	<1	<2	7	<1	0.21
RMD-277	Opp. 11280 Twigg Place	4-Feb-11	0.56	<1	<2	7	<1	0.14
RMD-264	13100 Mitchell Rd.	4-Feb-11	0.56	<1	<2	6	<1	0.13
RMD-204	3180 Granville Ave.	7-Feb-11	0.64	<1	<2	7	<1	0.13
RMD-206	4251 Moncton St.	7-Feb-11	0.64	<1	<2	6	<1	0.18
RMD-212	Opp. 8880 Williams Rd.	7-Feb-11	0.61	<1	<2	8	<1	0.15
RMD-208	13200 No. 4 Rd.	7-Feb-11	0.63	<1	<2	6	<1	0.14
RMD-205	13851 Steveston Hwy.	7-Feb-11	0.65	<1	<2	6	<1	0.14
RMD-267	17240 Fedoruk	7-Feb-11	0.67	<1	<2	6	<1	0.13
RMD-249	23000 Blk. Dyke Rd.	7-Feb-11	0.54	<1	<2	7	<1	0.43
RMD-276	22271 Cochrane Drive	7-Feb-11	0.39	<1	<2	7	<1	0.32
RMD-275	5180 Smith Cres.	7-Feb-11	0.42	<1	<2	7	<1	0.12
RMD-203	23260 Westminster Hwy.	7-Feb-11	0.56	<1	<2	7	<1	0.46
RMD-202	1500 Valemont Way	7-Feb-11	0.62	<1	<2	6	<1	0.18
RMD-214	11720 Westminster Hwy.	7-Feb-11	0.74	<1	<2	6	<1	0.14
RMD-216	11080 No. 2 Rd.	7-Feb-11	0.53	<1	<2	7	<1	0.15
RMD-251	5951 McCallan Rd.	9-Feb-11	0.63	<1	<2	5	<1	0.13
RMD-273	Opp. 8331 Fairfax Place	9-Feb-11	0.65	<1	<2	7	<1	0.14
RMD-252	9751 Pendleton Rd.	9-Feb-11	0.63	<1	<2	6	<1	0.12
RMD-274	10920 Springwood Court	9-Feb-11	0.64	<1	2	6	<1	0.18
RMD-250	6071 Azure Rd.	9-Feb-11	0.59	<1	<2	5	<1	0.11

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-271	3800 Cessna Drive	9-Feb-11	0.61	<1	<2	7	<1	0.13
RMD-272	751 Catalina Cres.	9-Feb-11	0.64	<1	<2	5	<1	0.11
RMD-255	6000 Blk. Miller Rd.	9-Feb-11	0.71	<1	<2	4	<1	0.17
RMD-256	1000 Blk. McDonald Rd.	9-Feb-11	0.61	<1	<2	5	<1	0.15
RMD-254	5300 No. 3 Rd.	9-Feb-11	0.65	<1	<2	5	<1	0.11
RMD-270	8200 Jones Rd.	9-Feb-11	0.70	<1	<2	5	<1	0.12
RMD-269	14951 Triangle Rd.	9-Feb-11	0.65	<1	<2	5	<1	0.16
RMD-253	11051 No 3 Rd.	9-Feb-11	0.66	<1	<2	4	<1	0.14
RMD-257	6640 Blundell Rd.	11-Feb-11	0.77	<1	<2	6	<1	0.15
RMD-258	7000 Blk. Dyke Rd.	11-Feb-11	0.66	<1	<2	7	<1	0.15
RMD-268	13800 No. 3 Rd. (off Garden City)	11-Feb-11	0.73	<1	<2	7	<1	0.14
RMD-259	10020 Amethyst Ave.	11-Feb-11	0.73	<1	<2	7	<1	0.14
RMD-266	9380 General Currie Rd.	11-Feb-11	0.71	<1	<2	6	<1	0.16
RMD-260	11111 Horseshoe Way	11-Feb-11	0.76	<1	<2	6	<1	0.16
RMD-261	9911 Sidaway Rd.	11-Feb-11	0.86	<1	<2	6	<1	0.17
RMD-263	12560 Cambie Rd.	11-Feb-11	0.63	<1	<2	7	<1	0.17
RMD-262	13799 Commerce Pkwy.	11-Feb-11	0.6	<1	<2	6	<1	0.13
RMD-264	13100 Mitchell Rd.	11-Feb-11	0.65	<1	<2	7	<1	0.14
RMD-277	Opp. 11280 Twigg Place	11-Feb-11	0.57	<1	<2	9	<1	0.16
RMD-279	Opp. 20371 Westminster Hwy.	11-Feb-11	0.26	<1	<2	8	<1	0.31
RMD-278	6651 Fraserwood Place	11-Feb-11	0.05	<1	14	8	<1	0.25
RMD-204	3180 Granville Ave.	14-Feb-11	0.84	<1	2	5	<1	0.12
RMD-206	4251 Moncton St.	14-Feb-11	0.85	<1	<2	5	<1	0.11
RMD-216	11080 No. 2 Rd.	14-Feb-11	0.91	<1	<2	5	<1	0.10
RMD-212	Opp. 8880 Williams Rd.	14-Feb-11	0.85	<1	<2	5	<1	0.09
RMD-208	13200 No. 4 Rd.	14-Feb-11	0.89	<1	<2	5	<1	0.10
RMD-205	13851 Steveston Hwy.	14-Feb-11	0.83	<1	<2	5	<1	0.10
RMD-267	17240 Fedoruk	14-Feb-11	0.62	<1	<2	5	<1	0.16
RMD-249	23000 Blk. Dyke Rd.	14-Feb-11	0.51	<1	<2	5	<1	0.29
RMD-276	22271 Cochrane Drive	14-Feb-11	0.4	<1	<2	5	<1	0.21
RMD-275	5180 Smith Cres.	14-Feb-11	0.63	<1	<2	5	<1	0.28
RMD-203	23260 Westminster Hwy.	14-Feb-11	0.56	<1	<2	5	<1	0.26
RMD-202	1500 Valemont Way	14-Feb-11	0.49	<1	<2	5	<1	0.17
RMD-214	11720 Westminster Hwy.	14-Feb-11	0.79	<1	<2	4	<1	0.11
RMD-251	5951McCallan Rd.	16-Feb-11	0.92	<1	<2	5	<1	0.11
RMD-273	Opp. 8331 Fairfax Place	16-Feb-11	0.83	<1	<2	6	<1	0.13
RMD-252	9751 Pendleton Rd.	16-Feb-11	0.77	<1	<2	5	<1	0.15
RMD-274	10920 Springwood Court	16-Feb-11	0.97	<1	<2	6	<1	0.26
RMD-250	6071 Azure Rd.	16-Feb-11	0.88	<1	<2	5	<1	0.14
RMD-271	3800 Cessna Drive	16-Feb-11	0.61	<1	<2	7	<1	0.13



Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mls	HPC CFU/mls	Temperature °C	Total Coliform MF/100mls	Turbidity NTU
RMD-272	751 Catalina Cres.	16-Feb-11	0.81	<1	<2	5	<1	0.10
RMD-255	6000 Blk. Miller Rd.	16-Feb-11	0.76	<1	<2	4	<1	0.27
RMD-256	1000 Blk. McDonald Rd.	16-Feb-11	0.91	<1	<2	6	<1	0.11
RMD-254	5300 No. 3 Rd.	16-Feb-11	0.89	<1	<2	5	<1	0.16
RMD-270	8200 Jones Rd.	16-Feb-11	0.85	<1	<2	5	<1	0.11
RMD-269	14951 Triangle Rd.	16-Feb-11	0.79	<1	<2	6	<1	0.10
RMD-253	11051 No 3 Rd.	16-Feb-11	0.93	<1	<2	5	<1	0.6
RMD-258	7000 Blk. Dyke Rd.	17-Feb-11	0.66	<1	2	5	<1	0.33
RMD-259	10020 Amethyst Ave.	17-Feb-11	0.74	<1	<2	5	<1	0.11
RMD-257	6640 Blundell Rd.	18-Feb-11	0.77	<1	<2	5	<1	0.10
RMD-266	9380 General Currie Rd.	18-Feb-11	0.69	<1	<2	5	<1	0.21
RMD-260	11111 Horseshoe Way	18-Feb-11	0.71	<1	<2	5	<1	0.10
RMD-268	13800 No. 3 Rd. (off Garden City)	18-Feb-11	0.77	<1	<2	5	<1	0.13
RMD-261	9911 Sidaway Rd.	18-Feb-11	0.70	<1	<2	5	<1	0.13
RMD-263	12560 Cambie Rd.	18-Feb-11	0.63	<1	<2	5	<1	0.15
RMD-262	13799 Commerce Pkwy.	18-Feb-11	0.55	<1	<2	5	<1	0.14
RMD-278	6651 Fraserwood Place	18-Feb-11	0.09	<1	<2	7	<1	0.23
RMD-279	Opp. 20371 Westminster Hwy.	18-Feb-11	0.32	<1	2	6	<1	0.27
RMD-277	Opp. 11280 Twigg Place	18-Feb-11	0.75	<1	<2	6	<1	0.19
RMD-264	13100 Mitchell Rd.	18-Feb-11	0.62	<1	<2	6	<1	0.28
RMD-204	3180 Granville Ave.	21-Feb-11	0.93	<1	<2	5	<1	0.16
RMD-206	4251 Moncton St.	21-Feb-11	0.77	<1	<2	5	<1	0.13
RMD-216	11080 No. 2 Rd.	21-Feb-11	0.85	<1	<2	5	<1	0.08
RMD-212	Opp. 8880 Williams Rd.	21-Feb-11	0.87	<1	<2	5	<1	0.11
RMD-208	13200 No. 4 Rd.	21-Feb-11	0.91	<1	<2	5	<1	0.08
RMD-205	13851 Steveston Hwy.	21-Feb-11	0.78	<1	<2	5	<1	0.09
RMD-267	17240 Fedoruk	21-Feb-11	0.70	<1	<2	5	<1	0.07
RMD-249	23000 Blk. Dyke Rd.	21-Feb-11	0.67	<1	<2	5	<1	0.21
RMD-276	22271 Cochrane Drive	21-Feb-11	0.51	<1	<2	5	<1	0.25
RMD-275	5180 Smith Cres.	21-Feb-11	0.73	<1	<2	5	<1	0.25
RMD-203	23260 Westminster Hwy.	21-Feb-11	0.68	<1	<2	5	<1	0.24
RMD-202	1500 Valemont Way	21-Feb-11	0.56	<1	<2	5	<1	0.14
RMD-214	11720 Westminster Hwy.	21-Feb-11	1.1	<1	<2	5	<1	0.11
RMD-269	14951 Triangle Rd.	23-Feb-11	0.64	<1	<2	5	<1	0.10
RMD-253	11051 No 3 Rd.	23-Feb-11	0.66	<1	<2	5	<1	0.11
RMD-274	10920 Springwood Court	23-Feb-11	0.65	<1	<2	6	<1	0.51
RMD-252	9751 Pendleton Rd.	23-Feb-11	0.68	<1	<2	5	<1	0.09
RMD-273	Opp. 8331 Fairfax Place	23-Feb-11	0.73	<1	<2	6	<1	0.10
RMD-270	8200 Jones Rd.	23-Feb-11	0.66	<1	<2	5	<1	0.13
RMD-254	5300 No. 3 Rd.	23-Feb-11	0.61	<1	<2	5	<1	0.11

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-271	3800 Cessna Drive	23-Feb-11	0.70	<1	<2	6	<1	0.12
RMD-272	751 Catalina Cres.	23-Feb-11	0.64	<1	<2	5	<1	0.09
RMD-255	6000 Blk. Miller Rd.	23-Feb-11	0.67	<1	4	4	<1	0.26
RMD-256	1000 Blk. McDonald Rd.	23-Feb-11	0.73	<1	<2	5	<1	0.12
RMD-250	6071 Azure Rd.	23-Feb-11	0.69	<1	<2	5	<1	0.11
RMD-251	5951McCallan Rd.	23-Feb-11	0.64	<1	<2	5	<1	0.11
RMD-257	6640 Blundell Rd.	25-Feb-11	0.63	<1	<2	2	<1	0.09
RMD-258	7000 Blk. Dyke Rd.	25-Feb-11	0.64	<1	<2	5	<1	0.17
RMD-268	13800 No. 3 Rd. (off Garden City)	25-Feb-11	0.61	<1	<2	5	<1	0.09
RMD-259	10020 Amethyst Ave.	25-Feb-11	0.60	<1	<2	5	<1	0.26
RMD-266	9380 General Currie Rd.	25-Feb-11	0.62	<1	<2	4	<1	0.13
RMD-260	11111 Horseshoe Way	25-Feb-11	0.7	<1	<2	5	<1	0.09
RMD-261	9911 Sidaway Rd.	25-Feb-11	0.63	<1	<2	4	<1	0.17
RMD-262	13799 Commerce Pkwy.	25-Feb-11	0.63	<1	<2	4	<1	0.11
RMD-263	12560 Cambie Rd.	25-Feb-11	0.52	<1	<2	5	<1	0.15
RMD-264	13100 Mitchell Rd.	25-Feb-11	0.66	<1	<2	6	<1	0.13
RMD-277	Opp. 11280 Twigg Place	25-Feb-11	0.65	<1	<2	6	<1	0.12
RMD-278	6651 Fraserwood Place	25-Feb-11	0.20	<1	2	7	<1	0.24
RMD-279	Opp. 20371 Westminster Hwy.	25-Feb-11	0.32	<1	<2	6	<1	0.27
RMD-204	3180 Granville Ave.	28-Feb-11	0.67	<1	<2	5	<1	0.15
RMD-206	4251 Moncton St.	28-Feb-11	0.61	<1	<2	4	<1	0.11
RMD-216	11080 No. 2 Rd.	28-Feb-11	0.67	<1	<2	4	<1	0.10
RMD-212	Opp. 8880 Williams Rd.	28-Feb-11	0.63	<1	<2	4	<1	0.09
RMD-208	13200 No. 4 Rd.	28-Feb-11	0.67	<1	<2	4	<1	0.15
RMD-205	13851 Steveston Hwy.	28-Feb-11	0.64	<1	<2	4	<1	0.23
RMD-267	17240 Fedoruk	28-Feb-11	0.63	<1	<2	4	<1	0.10
RMD-249	23000 Blk. Dyke Rd.	28-Feb-11	0.48	<1	<2	4	<1	0.36
RMD-276	22271 Cochrane Drive	28-Feb-11	0.44	<1	<2	5	<1	0.28
RMD-275	5180 Smith Cres.	28-Feb-11	0.49	<1	2	5	<1	0.35
RMD-203	23260 Westminster Hwy.	28-Feb-11	0.63	<1	<2	4	<1	0.28
RMD-202	1500 Valemont Way	28-Feb-11	0.69	<1	<2	4	<1	0.15
RMD-214	11720 Westminster Hwy.	28-Feb-11	0.67	<1	<2	4	<1	0.43
RMD-251	5951McCallan Rd.	2-Mar-11	0.59	<1	<2	5	<1	0.15
RMD-252	9751 Pendleton Rd.	2-Mar-11	0.59	<1	<2	6	<1	0.13
RMD-273	Opp. 8331 Fairfax Place	2-Mar-11	0.55	<1	<2	7	<1	0.10
RMD-274	10920 Springwood Court	2-Mar-11	0.56	<1	2	8	<1	0.21
RMD-250	6071 Azure Rd.	2-Mar-11	0.57	<1	<2	6	<1	0.12
RMD-271	3800 Cessna Drive	2-Mar-11	0.49	<1	Contaminated NA	8	<1	0.12
RMD-272	751 Catalina Cres.	2-Mar-11	0.67	<1	<2	6	<1	0.08

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-255	6000 Blk. Miller Rd.	2-Mar-11	0.70	<1	<2	5	<1	0.19
RMD-256	1000 Blk. McDonald Rd.	2-Mar-11	0.39	<1	<2	8	<1	0.18
RMD-254	5300 No. 3 Rd.	2-Mar-11	0.58	<1	<2	5	<1	0.11
RMD-270	8200 Jones Rd.	2-Mar-11	0.54	<1	<2	6	<1	0.14
RMD-269	14951 Triangle Rd.	2-Mar-11	0.58	<1	<2	6	<1	0.12
RMD-253	11051 No 3 Rd.	2-Mar-11	0.58	<1	<2	5	<1	0.15
RMD-257	6640 Blundell Rd.	4-Mar-11	0.61	<1	<2	4	<1	0.13
RMD-266	9380 General Currie Rd.	4-Mar-11	0.65	<1	<2	3	<1	0.08
RMD-259	10020 Amethyst Ave.	4-Mar-11	0.56	<1	2	4	<1	0.10
RMD-268	13800 No. 3 Rd. (off Garden City)	4-Mar-11	0.55	<1	<2	4	<1	0.08
RMD-258	7000 Blk. Dyke Rd.	4-Mar-11	0.62	<1	<2	4	<1	0.15
RMD-260	11111 Horseshoe Way	4-Mar-11	0.60	<1	<2	3	<1	0.11
RMD-261	9911 Sidaway Rd.	4-Mar-11	0.55	<1	<2	4	<1	0.09
RMD-262	13799 Commerce Pkwy.	4-Mar-11	0.59	<1	2	4	<1	0.09
RMD-263	12560 Cambie Rd.	4-Mar-11	0.55	<1	<2	4	<1	0.12
RMD-264	13100 Mitchell Rd.	4-Mar-11	0.5	<1	<2	4	<1	0.11
RMD-277	Opp. 11280 Twigg Place	4-Mar-11	0.46	<1	<2	6	<1	0.14
RMD-278	6651 Fraserwood Place	4-Mar-11	0.16	<1	<2	6	<1	0.18
RMD-279	Opp. 20371 Westminster Hwy.	4-Mar-11	0.42	<1	2	5	<1	0.20
RMD-204	3180 Granville Ave.	7-Mar-11	0.57	<1	<2	5	<1	0.11
RMD-206	4251 Moncton St.	7-Mar-11	0.52	<1	<2	4	<1	0.15
RMD-216	11080 No. 2 Rd.	7-Mar-11	0.41	<1	<2	4	<1	0.10
RMD-212	Opp. 8880 Williams Rd.	7-Mar-11	0.53	<1	<2	5	<1	0.13
RMD-208	13200 No. 4 Rd.	7-Mar-11	0.45	<1	2	4	<1	0.13
RMD-205	13851 Steveston Hwy.	7-Mar-11	0.55	<1	<2	4	<1	0.13
RMD-267	17240 Fedoruk	7-Mar-11	0.61	<1	<2	4	<1	0.10
RMD-249	23000 Blk. Dyke Rd.	7-Mar-11	0.69	<1	<2	5	<1	0.32
RMD-276	22271 Cochrane Drive	7-Mar-11	0.48	<1	<2	5	<1	0.27
RMD-275	5180 Smith Cres.	7-Mar-11	0.70	<1	<2	5	<1	0.31
RMD-203	23260 Westminster Hwy.	7-Mar-11	0.67	<1	<2	5	<1	0.35
RMD-202	1500 Valemont Way	7-Mar-11	0.63	<1	2	4	<1	0.18
RMD-214	11720 Westminster Hwy.	7-Mar-11	0.55	<1	<2	3	<1	0.17
RMD-251	5951 McCallan Rd.	9-Mar-11	0.66	<1	<2	6	<1	0.13
RMD-273	Opp. 8331 Fairfax Place	9-Mar-11	0.66	<1	<2	8	<1	0.16
RMD-274	10920 Springwood Court	9-Mar-11	0.50	<1	<2	8	<1	0.15
RMD-250	6071 Azure Rd.	9-Mar-11	0.55	<1	<2	7	<1	0.10
RMD-252	9751 Pendleton Rd.	9-Mar-11	0.53	<1	<2	7	<1	0.12
RMD-271	3800 Cessna Drive	9-Mar-11	0.47	<1	<2	9	<1	0.15
RMD-255	6000 Blk. Miller Rd.	9-Mar-11	0.60	<1	<2	6	<1	0.28
RMD-272	751 Catalina Cres.	9-Mar-11	0.58	<1	2	6	<1	0.13

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-256	1000 Blk. McDonald Rd.	9-Mar-11	0.41	<1	<2	8	<1	0.17
RMD-254	5300 No. 3 Rd.	9-Mar-11	0.60	<1	<2	6	<1	0.11
RMD-270	8200 Jones Rd.	9-Mar-11	0.53	<1	<2	7	<1	0.13
RMD-269	14951 Triangle Rd.	9-Mar-11	0.56	<1	<2	8	<1	0.15
RMD-253	11051 No 3 Rd.	9-Mar-11	0.64	<1	<2	6	<1	0.10
RMD-257	6640 Blundell Rd.	11-Mar-11	0.60	<1	<2	5	<1	0.10
RMD-258	7000 Blk. Dyke Rd.	11-Mar-11	0.61	<1	<2	7	<1	0.10
RMD-268	13800 No. 3 Rd. (off Garden City)	11-Mar-11	0.57	<1	<2	6	<1	0.13
RMD-259	10020 Amethyst Ave.	11-Mar-11	0.65	<1	2	6	<1	0.12
RMD-266	9380 General Currie Rd.	11-Mar-11	0.70	<1	<2	5	<1	0.11
RMD-260	11111 Horseshoe Way	11-Mar-11	0.66	<1	<2	5	<1	0.10
RMD-261	9911 Sidaway Rd.	11-Mar-11	0.66	<1	<2	6	<1	0.09
RMD-278	6651 Fraserwood Place	11-Mar-11	0.23	<1	<2	9	<1	0.28
RMD-279	Opp. 20371 Westminster Hwy.	11-Mar-11	0.41	<1	<2	7	<1	0.31
RMD-262	13799 Commerce Pkwy.	11-Mar-11	0.69	<1	<2	6	<1	0.11
RMD-263	12560 Cambie Rd.	11-Mar-11	0.60	<1	<2	6	<1	0.10
RMD-264	13100 Mitchell Rd.	11-Mar-11	0.50	<1	<2	7	<1	0.12
RMD-277	Opp. 11280 Twigg Place	11-Mar-11	0.39	<1	<2	8	<1	0.15
RMD-204	3180 Granville Ave.	14-Mar-11	0.48	<1	<2	6	<1	0.08
RMD-206	4251 Moncton St.	14-Mar-11	0.50	<1	<2	6	<1	0.08
RMD-216	11080 No. 2 Rd.	14-Mar-11	0.61	<1	<2	6	<1	0.10
RMD-212	Opp. 8880 Williams Rd.	14-Mar-11	0.54	<1	<2	6	<1	0.08
RMD-208	13200 No. 4 Rd.	14-Mar-11	0.55	<1	<2	6	<1	0.08
RMD-205	13851 Steveston Hwy.	14-Mar-11	0.57	<1	<2	6	<1	0.09
RMD-267	17240 Fedoruk	14-Mar-11	0.51	<1	<2	6	<1	0.08
RMD-249	23000 Blk. Dyke Rd.	14-Mar-11	0.62	<1	<2	7	<1	0.49
RMD-276	22271 Cochrane Drive	14-Mar-11	0.49	<1	<2	7	<1	0.43
RMD-275	5180 Smith Cres.	14-Mar-11	0.78	<1	2	7	<1	0.46
RMD-203	23260 Westminster Hwy.	14-Mar-11	0.93	<1	<2	7	<1	0.47
RMD-202	1500 Valemont Way	14-Mar-11	0.62	<1	<2	6	<1	0.14
RMD-214	11720 Westminster Hwy.	14-Mar-11	0.55	<1	<2	5	<1	0.10
RMD-271	3800 Cessna Drive	16-Mar-11	0.44	<1	<2	7	<1	0.13
RMD-272	751 Catalina Cres.	16-Mar-11	0.53	<1	<2	5	<1	0.12
RMD-255	6000 Blk. Miller Rd.	16-Mar-11	0.61	<1	2	4	<1	0.32
RMD-256	1000 Blk. McDonald Rd.	16-Mar-11	0.38	<1	<2	7	<1	0.19
RMD-254	5300 No. 3 Rd.	16-Mar-11	0.55	<1	<2	5	<1	0.16
RMD-270	8200 Jones Rd.	16-Mar-11	0.55	<1	<2	5	<1	0.11
RMD-269	14951 Triangle Rd.	16-Mar-11	0.52	<1	<2	6	<1	0.11
RMD-253	11051 No 3 Rd.	16-Mar-11	0.58	<1	<2	5	<1	0.13
RMD-274	10920 Springwood Court	16-Mar-11	0.52	<1	<2	7	<1	4.50

**PWT - 62**

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-252	9751 Pendleton Rd.	16-Mar-11	0.50	<1	2	5	<1	0.35
RMD-273	Opp. 8331 Fairfax Place	16-Mar-11	0.51	<1	<2	7	<1	0.09
RMD-250	6071 Azure Rd.	16-Mar-11	0.43	<1	<2	5	<1	0.12
RMD-251	5951McCallan Rd.	16-Mar-11	0.54	<1	<2	5	<1	0.11
RMD-257	6640 Blundell Rd.	18-Mar-11	0.58	<1	<2	4	<1	0.13
RMD-266	9380 General Currie Rd.	18-Mar-11	0.55	<1	<2	4	<1	0.17
RMD-259	10020 Amethyst Ave.	18-Mar-11	0.54	<1	<2	4	<1	0.14
RMD-268	13800 No. 3 Rd. (off Garden City)	18-Mar-11	0.46	<1	<2	5	<1	0.14
RMD-258	7000 Blk. Dyke Rd.	18-Mar-11	0.49	<1	2	5	<1	0.10
RMD-260	11111 Horseshoe Way	18-Mar-11	0.58	<1	<2	4	<1	0.17
RMD-261	9911 Sidaway Rd.	18-Mar-11	0.51	<1	<2	4	<1	0.14
RMD-262	13799 Commerce Pkwy.	18-Mar-11	0.47	<1	<2	4	<1	0.21
RMD-263	12560 Cambie Rd.	18-Mar-11	0.51	<1	<2	5	<1	0.17
RMD-264	13100 Mitchell Rd.	18-Mar-11	0.49	<1	<2	5	<1	0.11
RMD-277	Opp. 11280 Twigg Place	18-Mar-11	0.44	<1	<2	7	<1	0.18
RMD-278	6651 Fraserwood Place	18-Mar-11	0.28	<1	2	7	<1	0.34
RMD-279	Opp. 20371 Westminster Hwy.	18-Mar-11	0.42	<1	<2	6	<1	0.47
RMD-204	3180 Granville Ave.	21-Mar-11	0.55	<1	<2	7	<1	0.11
RMD-206	4251 Moncton St.	21-Mar-11	0.51	<1	<2	6	<1	0.10
RMD-216	11080 No. 2 Rd.	21-Mar-11	0.57	<1	<2	6	<1	0.14
RMD-212	Opp. 8880 Williams Rd.	21-Mar-11	0.53	<1	<2	7	<1	0.15
RMD-208	13200 No. 4 Rd.	21-Mar-11	0.50	<1	<2	7	<1	0.11
RMD-205	13851 Steveston Hwy.	21-Mar-11	0.52	<1	<2	7	<1	0.12
RMD-267	17240 Fedoruk	21-Mar-11	0.52	<1	<2	7	<1	0.11
RMD-249	23000 Blk. Dyke Rd.	21-Mar-11	0.75	<1	<2	7	<1	0.40
RMD-276	22271 Cochrane Drive	21-Mar-11	0.45	<1	<2	8	<1	0.32
RMD-275	5180 Smith Cres.	21-Mar-11	0.71	<1	<2	8	<1	0.43
RMD-203	23260 Westminster Hwy.	21-Mar-11	0.83	<1	<2	7	<1	0.42
RMD-202	1500 Valemont Way	21-Mar-11	0.69	<1	<2	6	<1	0.15
RMD-214	11720 Westminster Hwy.	21-Mar-11	0.55	<1	<2	6	<1	0.12
RMD-251	5951McCallan Rd.	23-Mar-11	0.55	<1	4	7	<1	0.11
RMD-273	Opp. 8331 Fairfax Place	23-Mar-11	0.43	<1	<2	10	<1	0.12
RMD-274	10920 Springwood Court	23-Mar-11	0.49	<1	<2	9	<1	0.10
RMD-252	9751 Pendleton Rd.	23-Mar-11	0.50	<1	<2	7	<1	0.08
RMD-250	6071 Azure Rd.	23-Mar-11	0.51	<1	<2	7	<1	0.10
RMD-271	3800 Cessna Drive	23-Mar-11	0.37	<1	<2	9	<1	0.11
RMD-272	751 Catalina Cres.	23-Mar-11	0.56	<1	<2	7	<1	0.09
RMD-255	6000 Blk. Miller Rd.	23-Mar-11	0.57	<1	<2	6	<1	0.20
RMD-256	1000 Blk. McDonald Rd.	23-Mar-11	0.23	<1	<2	9	<1	0.20
RMD-254	5300 No. 3 Rd.	23-Mar-11	0.58	<1	<2	6	<1	0.08

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-270	8200 Jones Rd.	23-Mar-11	0.57	<1	<2	7	<1	0.12
RMD-269	14951 Triangle Rd.	23-Mar-11	0.42	<1	<2	8	<1	0.11
RMD-253	11051 No 3 Rd.	23-Mar-11	0.55	<1	<2	6	<1	0.09
RMD-257	6640 Blundell Rd.	25-Mar-11	0.56	<1	<2	6	<1	0.08
RMD-258	7000 Blk. Dyke Rd.	25-Mar-11	0.5	<1	2	8	<1	0.16
RMD-268	13800 No. 3 Rd. (off Garden City)	25-Mar-11	0.54	<1	<2	7	<1	0.18
RMD-259	10020 Amethyst Ave.	25-Mar-11	0.58	<1	<2	7	<1	0.12
RMD-266	9380 General Currie Rd.	25-Mar-11	0.50	<1	<2	6	<1	0.14
RMD-260	11111 Horseshoe Way	25-Mar-11	0.45	<1	<2	8	<1	0.13
RMD-261	9911 Sidaway Rd.	25-Mar-11	0.49	<1	<2	7	<1	0.10
RMD-262	13799 Commerce Pkwy.	25-Mar-11	0.51	<1	<2	7	<1	0.13
RMD-263	12560 Cambie Rd.	25-Mar-11	0.50	<1	<2	7	<1	0.13
RMD-264	13100 Mitchell Rd.	25-Mar-11	0.39	<1	<2	8	<1	0.12
RMD-277	Opp. 11280 Twigg Place	25-Mar-11	0.33	<1	<2	10	<1	0.18
RMD-279	Opp. 20371 Westminster Hwy.	25-Mar-11	0.18	<1	<2	8	<1	0.33
RMD-278	6651 Fraserwood Place	25-Mar-11	0.11	<1	<2	10	<1	0.26
RMD-204	3180 Granville Ave.	28-Mar-11	0.54	<1	<2	8	<1	0.12
RMD-206	4251 Moncton St.	28-Mar-11	0.54	<1	<2	8	<1	0.14
RMD-216	11080 No. 2 Rd.	28-Mar-11	0.59	<1	<2	7	<1	0.32
RMD-212	Opp. 8880 Williams Rd.	28-Mar-11	0.51	<1	<2	7	<1	0.11
RMD-208	13200 No. 4 Rd.	28-Mar-11	0.56	<1	<2	7	<1	0.10
RMD-205	13851 Steveston Hwy.	28-Mar-11	0.54	<1	<2	7	<1	0.11
RMD-267	17240 Fedoruk	28-Mar-11	0.58	<1	<2	7	<1	0.17
RMD-249	23000 Blk. Dyke Rd.	28-Mar-11	0.70	<1	<2	8	<1	0.29
RMD-276	22271 Cochrane Drive	28-Mar-11	0.55	<1	<2	8	<1	0.26
RMD-275	5180 Smith Cres.	28-Mar-11	0.76	<1	<2	8	<1	0.31
RMD-202	1500 Valemont Way	28-Mar-11	0.64	<1	<2	7	<1	0.17
RMD-214	11720 Westminster Hwy.	28-Mar-11	0.54	<1	<2	7	<1	0.15
RMD-203	23260 Westminster Hwy.	28-Mar-11	0.76	<1	<2	8	<1	0.31
RMD-251	5951 McCallan Rd.	30-Mar-11	0.64	<1	<2	8	<1	0.09
RMD-273	Opp. 8331 Fairfax Place	30-Mar-11	0.48	<1	<2	11	<1	0.15
RMD-274	10920 Springwood Court	30-Mar-11	0.59	<1	<2	9	<1	0.37
RMD-252	9751 Pendleton Rd.	30-Mar-11	0.54	<1	<2	8	<1	0.11
RMD-250	6071 Azure Rd.	30-Mar-11	0.55	<1	<2	8	<1	0.11
RMD-271	3800 Cessna Drive	30-Mar-11	0.50	<1	2	10	<1	0.17
RMD-272	751 Catalina Cres.	30-Mar-11	0.58	<1	<2	7	<1	0.11
RMD-255	6000 Blk. Miller Rd.	30-Mar-11	0.20	<1	<2	6	<1	0.29
RMD-256	1000 Blk. McDonald Rd.	30-Mar-11	0.94	<1	<2	10	<1	0.16
RMD-254	5300 No. 3 Rd.	30-Mar-11	0.65	<1	<2	7	<1	0.09
RMD-270	8200 Jones Rd.	30-Mar-11	0.46	<1	<2	9	<1	0.14

**PWT - 64**

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-269	14951 Triangle Rd.	30-Mar-11	0.43	<1	<2	10	<1	0.12
RMD-253	11051 No 3 Rd.	30-Mar-11	0.51	<1	2	7	<1	0.10
RMD-257	6640 Blundell Rd.	1-Apr-11	0.53	<1	<2	5	<1	0.11
RMD-266	9380 General Currie Rd.	1-Apr-11	0.56	<1	2	5	<1	0.09
RMD-259	10020 Amethyst Ave.	1-Apr-11	0.54	<1	<2	5	<1	0.08
RMD-268	13800 No. 3 Rd. (off Garden City)	1-Apr-11	0.52	<1	<2	5	<1	0.11
RMD-258	7000 Blk. Dyke Rd.	1-Apr-11	0.55	<1	<2	6	<1	0.09
RMD-260	11111 Horseshoe Way	1-Apr-11	0.57	<1	<2	5	<1	0.10
RMD-261	9911 Sidaway Rd.	1-Apr-11	0.49	<1	<2	5	<1	0.13
RMD-262	13799 Commerce Pkwy.	1-Apr-11	0.48	<1	<2	5	<1	0.27
RMD-263	12560 Cambie Rd.	1-Apr-11	0.53	<1	<2	5	<1	0.14
RMD-264	13100 Mitchell Rd.	1-Apr-11	0.48	<1	<2	6	<1	0.13
RMD-277	Opp. 11280 Twigg Place	1-Apr-11	0.46	<1	<2	6	<1	0.13
RMD-278	6651 Fraserwood Place	1-Apr-11	0.17	<1	<2	8	<1	0.22
RMD-279	Opp. 20371 Westminster Hwy.	1-Apr-11	0.59	<1	<2	7	<1	0.43
RMD-204	3180 Granville Ave.	4-Apr-11	0.52	<1	2	9	<1	0.14
RMD-206	4251 Moncton St.	4-Apr-11	0.53	<1	2	8	<1	0.09
RMD-216	11080 No. 2 Rd.	4-Apr-11	0.58	<1	<2	8	<1	0.09
RMD-212	Opp. 8880 Williams Rd.	4-Apr-11	0.52	<1	<2	8	<1	0.09
RMD-208	13200 No. 4 Rd.	4-Apr-11	0.62	<1	<2	8	<1	0.09
RMD-205	13851 Steveston Hwy.	4-Apr-11	0.56	<1	<2	8	<1	0.19
RMD-267	17240 Fedoruk	4-Apr-11	0.59	<1	<2	8	<1	0.13
RMD-249	23000 Blk. Dyke Rd.	4-Apr-11	1.0	<1	<2	8	<1	0.46
RMD-276	22271 Cochrane Drive	4-Apr-11	0.79	<1	<2	9	<1	0.40
RMD-275	5180 Smith Cres.	4-Apr-11	1.0	<1	<2	8	<1	0.44
RMD-203	23260 Westminster Hwy.	4-Apr-11	1.0	<1	<2	8	<1	0.42
RMD-202	1500 Valemont Way	4-Apr-11	0.72	<1	<2	8	<1	0.18
RMD-214	11720 Westminster Hwy.	4-Apr-11	0.59	<1	<2	7	<1	0.08
RMD-251	5951 McCallan Rd.	6-Apr-11	0.55	<1	<2	6	<1	0.10
RMD-273	Opp. 8331 Fairfax Place	6-Apr-11	0.45	<1	<2	8	<1	0.10
RMD-252	9751 Pendleton Rd.	6-Apr-11	0.53	<1	<2	6	<1	0.09
RMD-274	10920 Springwood Court	6-Apr-11	0.49	<1	<2	7	<1	0.20
RMD-253	11051 No 3 Rd.	6-Apr-11	0.57	<1	<2	6	<1	0.09
RMD-269	14951 Triangle Rd.	6-Apr-11	0.37	<1	<2	7	<1	0.17
RMD-270	8200 Jones Rd.	6-Apr-11	0.47	<1	<2	6	<1	0.11
RMD-254	5300 No. 3 Rd.	6-Apr-11	0.47	<1	<2	6	<1	0.18
RMD-271	3800 Cessna Drive	6-Apr-11	0.35	<1	<2	8	<1	0.11
RMD-272	751 Catalina Cres.	6-Apr-11	0.46	<1	<2	6	<1	0.11
RMD-255	6000 Blk. Miller Rd.	6-Apr-11	0.52	<1	<2	5	<1	0.34
RMD-256	1000 Blk. McDonald Rd.	6-Apr-11	0.29	<1	<2	8	<1	0.14

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-250	6071 Azure Rd.	6-Apr-11	0.29	<1	<2	6	<1	0.12
RMD-257	6640 Blundell Rd.	8-Apr-11	0.55	<1	<2	7	<1	0.10
RMD-258	7000 Blk. Dyke Rd.	8-Apr-11	0.38	<1	<2	9	<1	0.13
RMD-268	13800 No. 3 Rd. (off Garden City)	8-Apr-11	0.53	<1	<2	9	<1	0.13
RMD-259	10020 Amethyst Ave.	8-Apr-11	0.57	<1	<2	8	<1	0.10
RMD-266	9380 General Currie Rd.	8-Apr-11	0.55	<1	<2	7	<1	0.13
RMD-260	11111 Horseshoe Way	8-Apr-11	0.57	<1	<2	7	<1	0.09
RMD-261	9911 Sidaway Rd.	8-Apr-11	0.57	<1	<2	8	<1	0.11
RMD-263	12560 Cambie Rd.	8-Apr-11	0.50	<1	<2	8	<1	0.19
RMD-262	13799 Commerce Pkwy.	8-Apr-11	0.56	<1	<2	8	<1	0.23
RMD-264	13100 Mitchell Rd.	8-Apr-11	0.52	<1	<2	10	<1	0.13
RMD-277	Opp. 11280 Twigg Place	8-Apr-11	0.39	<1	<2	11	<1	0.13
RMD-278	6651 Fraserwood Place	8-Apr-11	0.19	<1	<2	11	<1	0.24
RMD-279	Opp. 20371 Westminster Hwy.	8-Apr-11	0.52	<1	2	8	<1	0.34
RMD-204	3180 Granville Ave.	11-Apr-11	0.48	<1	<2	8	<1	0.09
RMD-206	4251 Moncton St.	11-Apr-11	0.37	<1	<2	7	<1	0.09
RMD-216	11080 No. 2 Rd.	11-Apr-11	0.48	<1	<2	7	<1	0.15
RMD-212	Opp. 8880 Williams Rd.	11-Apr-11	0.51	<1	2	7	<1	0.09
RMD-208	13200 No. 4 Rd.	11-Apr-11	0.53	<1	<2	7	<1	0.12
RMD-205	13851 Steveston Hwy.	11-Apr-11	0.52	<1	<2	7	<1	0.24
RMD-267	17240 Fedoruk	11-Apr-11	0.60	<1	<2	7	<1	0.12
RMD-249	23000 Blk. Dyke Rd.	11-Apr-11	0.72	<1	2	6	<1	0.41
RMD-276	22271 Cochrane Drive	11-Apr-11	0.51	<1	<2	8	<1	0.31
RMD-275	5180 Smith Cres.	11-Apr-11	0.68	<1	<2	8	<1	0.39
RMD-203	23260 Westminster Hwy.	11-Apr-11	0.80	<1	<2	7	<1	0.42
RMD-202	1500 Valemont Way	11-Apr-11	0.44	<1	<2	6	<1	0.19
RMD-214	11720 Westminster Hwy.	11-Apr-11	0.62	<1	<2	6	<1	0.09
RMD-251	5951 McCallan Rd.	13-Apr-11	0.59	<1	<2	8	<1	0.15
RMD-273	Opp. 8331 Fairfax Place	13-Apr-11	0.49	<1	<2	11	<1	0.13
RMD-252	9751 Pendleton Rd.	13-Apr-11	0.54	<1	<2	9	<1	0.12
RMD-274	10920 Springwood Court	13-Apr-11	0.52	<1	2	10	<1	0.30
RMD-250	6071 Azure Rd.	13-Apr-11	0.54	<1	<2	9	<1	0.13
RMD-271	3800 Cessna Drive	13-Apr-11	0.51	<1	<2	10	<1	0.10
RMD-272	751 Catalina Cres.	13-Apr-11	0.57	<1	<2	8	<1	0.08
RMD-255	6000 Blk. Miller Rd.	13-Apr-11	0.58	<1	<2	8	<1	0.16
RMD-256	1000 Blk. McDonald Rd.	13-Apr-11	0.45	<1	<2	11	<1	0.11
RMD-254	5300 No. 3 Rd.	13-Apr-11	0.48	<1	<2	8	<1	0.10
RMD-270	8200 Jones Rd.	13-Apr-11	0.40	<1	<2	9	<1	0.12
RMD-269	14951 Triangle Rd.	13-Apr-11	0.45	<1	<2	10	<1	0.13
RMD-253	11051 No 3 Rd.	13-Apr-11	0.53	<1	<2	8	<1	0.12



Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-257	6640 Blundell Rd.	15-Apr-11	0.42	<1	<2	5	<1	0.08
RMD-266	9380 General Currie Rd.	15-Apr-11	0.57	<1	<2	6	<1	0.08
RMD-259	10020 Amethyst Ave.	15-Apr-11	0.52	<1	<2	6	<1	0.13
RMD-268	13800 No. 3 Rd. (off Garden City)	15-Apr-11	0.47	<1	<2	6	<1	0.12
RMD-258	7000 Blk. Dyke Rd.	15-Apr-11	0.51	<1	<2	7	<1	0.19
RMD-260	11111 Horseshoe Way	15-Apr-11	0.55	<1	<2	6	<1	0.08
RMD-261	9911 Sidaway Rd.	15-Apr-11	0.59	<1	<2	6	<1	0.09
RMD-262	13799 Commerce Pkwy.	15-Apr-11	0.49	<1	<2	7	<1	0.22
RMD-263	12560 Cambie Rd.	15-Apr-11	0.48	<1	<2	6	<1	0.15
RMD-264	13100 Mitchell Rd.	15-Apr-11	0.41	<1	<2	8	<1	0.13
RMD-277	Opp. 11280 Twigg Place	15-Apr-11	0.4	<1	<2	7	<1	0.12
RMD-278	6651 Fraserwood Place	15-Apr-11	0.23	<1	2	8	<1	0.23
RMD-279	Opp. 20371 Westminster Hwy.	15-Apr-11	0.42	<1	<2	7	<1	0.29
RMD-204	3180 Granville Ave.	18-Apr-11	0.53	<1	<2	10	<1	0.12
RMD-206	4251 Moncton St.	18-Apr-11	0.48	<1	<2	9	<1	0.08
RMD-216	11080 No. 2 Rd.	18-Apr-11	0.54	<1	<2	9	<1	0.11
RMD-212	Opp. 8600 Riyan Rd.	18-Apr-11	0.43	<1	<2	9	<1	0.09
RMD-208	13200 No. 4 Rd.	18-Apr-11	0.44	<1	<2	9	<1	0.09
RMD-205	13851 Steveston Hwy.	18-Apr-11	0.38	<1	<2	10	<1	0.15
RMD-267	17240 Fedoruk	18-Apr-11	0.53	<1	<2	9	<1	0.09
RMD-249	23000 Blk. Dyke Rd.	18-Apr-11	0.72	<1	<2	9	<1	0.33
RMD-203	23260 Westminster Hwy.	18-Apr-11	0.77	<1	<2	8	<1	0.33
RMD-275	5180 Smith Cres.	18-Apr-11	0.69	<1	<2	9	<1	0.34
RMD-276	22271 Cochrane Drive	18-Apr-11	0.51	<1	<2	9	<1	0.26
RMD-202	1500 Valemont Way	18-Apr-11	0.58	<1	<2	9	<1	0.14
RMD-214	11720 Westminster Hwy.	18-Apr-11	0.56	<1	<2	8	<1	0.08
RMD-251	5951 McCallan Rd.	20-Apr-11	0.61	<1	<2	6	<1	0.20
RMD-273	Opp. 8331 Fairfax Place	20-Apr-11	0.80	<1	<2	10	<1	0.15
RMD-252	9751 Pendleton Rd.	20-Apr-11	0.62	<1	<2	7	<1	0.10
RMD-274	10920 Springwood Court	20-Apr-11	0.73	<1	<2	7	<1	0.34
RMD-250	6071 Azure Rd.	20-Apr-11	0.76	<1	<2	7	<1	0.10
RMD-271	3800 Cessna Drive	20-Apr-11	0.39	<1	<2	7	<1	0.12
RMD-272	751 Catalina Cres.	20-Apr-11	0.56	<1	<2	7	<1	0.14
RMD-255	6000 Blk. Miller Rd.	20-Apr-11	1.4	<1	<2	6	<1	0.40
RMD-256	1000 Blk. McDonald Rd.	20-Apr-11	0.74	<1	<2	10	<1	0.17
RMD-254	5300 No. 3 Rd.	20-Apr-11	0.53	<1	2	6	<1	0.19
RMD-270	8200 Jones Rd.	20-Apr-11	0.55	<1	<2	7	<1	0.21
RMD-269	14951 Triangle Rd.	20-Apr-11	0.51	<1	<2	9	<1	0.19
RMD-253	11051 No 3 Rd.	20-Apr-11	0.59	<1	<2	6	<1	0.12
RMD-204	3180 Granville Ave.	26-Apr-11	0.48	<1	<2	10	<1	0.10

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-206	4251 Moncton St.	26-Apr-11	0.40	<1	<2	9	<1	0.11
RMD-216	11080 No. 2 Rd.	26-Apr-11	0.50	<1	<2	10	<1	0.15
RMD-212	Opp. 8600 Riyan Rd.	26-Apr-11	0.50	<1	<2	10	<1	0.15
RMD-205	13851 Steveston Hwy.	26-Apr-11	0.19	<1	<2	9	<1	0.22
RMD-208	13200 No. 4 Rd.	26-Apr-11	0.51	<1	<2	10	<1	0.12
RMD-267	17240 Fedoruk	26-Apr-11	0.58	<1	<2	10	<1	0.16
RMD-249	23000 Blk. Dyke Rd.	26-Apr-11	0.86	<1	8	9	<1	0.36
RMD-276	22271 Cochrane Drive	26-Apr-11	0.55	<1	<2	10	<1	0.24
RMD-275	5180 Smith Cres.	26-Apr-11	0.75	<1	<2	10	<1	0.37
RMD-203	23260 Westminster Hwy.	26-Apr-11	0.89	<1	<2	10	<1	0.34
RMD-202	1500 Valemont Way	26-Apr-11	0.61	<1	<2	9	<1	0.17
RMD-214	11720 Westminster Hwy.	26-Apr-11	0.51	<1	<2	9	<1	0.14
RMD-251	5951McCallan Rd.	27-Apr-11	0.45	<1	<2	9	<1	0.14
RMD-273	Opp. 8331 Fairfax Place	27-Apr-11	0.45	<1	<2	13	<1	0.12
RMD-252	9751 Pendleton Rd.	27-Apr-11	0.52	<1	<2	9	<1	0.10
RMD-274	10920 Springwood Court	27-Apr-11	0.46	<1	<2	11	<1	0.20
RMD-250	6071 Azure Rd.	27-Apr-11	0.52	<1	<2	10	<1	0.11
RMD-271	3800 Cessna Drive	27-Apr-11	0.49	<1	<2	11	<1	0.09
RMD-272	751 Catalina Cres.	27-Apr-11	0.49	<1	<2	10	<1	0.12
RMD-255	6000 Blk. Miller Rd.	27-Apr-11	0.52	<1	<2	9	<1	0.21
RMD-256	1000 Blk. McDonald Rd.	27-Apr-11	0.31	<1	<2	12	<1	0.14
RMD-254	5300 No. 3 Rd.	27-Apr-11	0.54	<1	<2	9	<1	0.24
RMD-270	8200 Jones Rd.	27-Apr-11	0.48	<1	<2	10	<1	0.12
RMD-269	14951 Triangle Rd.	27-Apr-11	0.52	<1	<2	11	<1	0.13
RMD-253	11051 No 3 Rd.	27-Apr-11	0.49	<1	<2	9	<1	0.13
RMD-257	6640 Blundell Rd.	29-Apr-11	0.65	<1	<2	6	<1	0.10
RMD-266	9380 General Currie Rd.	29-Apr-11	0.66	<1	<2	7	<1	0.09
RMD-259	10020 Amethyst Ave.	29-Apr-11	0.62	<1	<2	7	<1	0.09
RMD-268	13800 No. 3 Rd. (off Garden City)	29-Apr-11	0.52	<1	<2	7	<1	0.10
RMD-258	7000 Blk. Dyke Rd.	29-Apr-11	0.49	<1	4	7	<1	0.11
RMD-260	11111 Horseshoe Way	29-Apr-11	0.61	<1	<2	7	<1	0.09
RMD-261	9911 Sidaway Rd.	29-Apr-11	0.61	<1	<2	7	<1	0.12
RMD-262	13799 Commerce Pkwy.	29-Apr-11	0.42	<1	<2	7	<1	0.22
RMD-263	12560 Cambie Rd.	29-Apr-11	0.56	<1	<2	7	<1	0.11
RMD-278	6651 Fraserwood Place	29-Apr-11	0.29	<1	<2	9	<1	0.20
RMD-279	Opp. 20371 Westminster Hwy.	29-Apr-11	0.33	<1	<2	8	<1	0.26
RMD-264	13100 Mitchell Rd.	29-Apr-11	0.41	<1	<2	8	<1	0.12
RMD-277	Opp. 11280 Twigg Place	29-Apr-11	0.30	<1	<2	9	<1	0.11
RMD-204	3180 Granville Ave.	2-May-11	0.67	<1	<2	9	<1	0.13
RMD-206	4251 Moncton St.	2-May-11	0.58	<1	<2	8	<1	0.14

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-216	11080 No. 2 Rd.	2-May-11	0.69	<1	<2	8	<1	0.17
RMD-212	Opp. 8600 Riyan Rd.	2-May-11	0.69	<1	<2	8	<1	0.22
RMD-208	13200 No. 4 Rd.	2-May-11	0.69	<1	<2	8	<1	0.26
RMD-205	13851 Steveston Hwy.	2-May-11	0.55	<1	<2	9	<1	0.18
RMD-267	17240 Fedoruk	2-May-11	0.73	<1	<2	8	<1	0.10
RMD-249	23000 Blk. Dyke Rd.	2-May-11	0.75	<1	<2	7	<1	0.31
RMD-276	22271 Cochrane Drive	2-May-11	0.51	<1	2	8	<1	0.22
RMD-275	5180 Smith Cres.	2-May-11	0.78	<1	2	8	<1	0.31
RMD-203	23260 Westminster Hwy.	2-May-11	0.81	<1	<2	7	<1	0.28
RMD-202	1500 Valemont Way	2-May-11	0.49	<1	<2	8	<1	0.26
RMD-214	11720 Westminster Hwy.	2-May-11	0.72	<1	<2	8	<1	0.20
RMD-251	5951 McCallan Rd.	4-May-11	0.70	<1	2	8	<1	0.24
RMD-273	Opp. 8331 Fairfax Place	4-May-11	0.66	<1	2	12	<1	0.57
RMD-252	9751 Pendleton Rd.	4-May-11	0.65	<1	<2	9	<1	0.23
RMD-274	10920 Springwood Court	4-May-11	0.70	<1	<2	9	<1	6.60
RMD-253	11051 No 3 Rd.	4-May-11	0.65	<1	<2	8	<1	0.25
RMD-269	14951 Triangle Rd.	4-May-11	0.60	<1	<2	10	<1	0.21
RMD-270	8200 Jones Rd.	4-May-11	0.69	<1	<2	9	<1	0.25
RMD-254	5300 No. 3 Rd.	4-May-11	0.63	<1	<2	8	<1	0.43
RMD-271	3800 Cessna Drive	4-May-11	0.44	<1	<2	9	<1	0.20
RMD-272	751 Catalina Cres.	4-May-11	0.71	<1	<2	8	<1	0.21
RMD-255	6000 Blk. Miller Rd.	4-May-11	0.83	<1	<2	7	<1	0.78
RMD-256	1000 Blk. McDonald Rd.	4-May-11	0.41	<1	<2	10	<1	0.17
RMD-250	6071 Azure Rd.	4-May-11	0.71	<1	<2	8	<1	0.21
RMD-257	6640 Blundell Rd.	6-May-11	0.83	<1	<2	9	<1	0.19
RMD-258	7000 Blk. Dyke Rd.	6-May-11	0.65	<1	<2	11	<1	0.16
RMD-268	13800 No. 3 Rd. (off Garden City)	6-May-11	0.76	<1	2	10	<1	0.16
RMD-259	10020 Amethyst Ave.	6-May-11	0.89	<1	<2	10	<1	0.19
RMD-266	9380 General Currie Rd.	6-May-11	0.76	<1	<2	9	<1	0.19
RMD-260	11111 Horseshoe Way	6-May-11	0.86	<1	<2	9	<1	0.17
RMD-261	9911 Sidaway Rd.	6-May-11	0.89	<1	<2	10	<1	0.19
RMD-262	13799 Commerce Pkwy.	6-May-11	0.91	<1	<2	10	<1	0.19
RMD-263	12560 Cambie Rd.	6-May-11	0.68	<1	<2	10	<1	0.18
RMD-264	13100 Mitchell Rd.	6-May-11	0.65	<1	<2	11	<1	0.18
RMD-277	Opp. 11280 Twigg Place	6-May-11	0.35	<1	<2	13	<1	0.13
RMD-278	6651 Fraserwood Place	6-May-11	0.12	<1	<2	13	<1	0.22
RMD-279	Opp. 20371 Westminster Hwy.	6-May-11	0.48	<1	<2	11	<1	0.25
RMD-274	10920 Springwood Court	6-May-11	0.74	<1	<2	11	<1	0.23
RMD-204	3180 Granville Ave.	9-May-11	0.83	<1	<2	12	<1	0.12
RMD-206	4251 Moncton St.	9-May-11	0.82	<1	<2	11	<1	0.13

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-216	11080 No. 2 Rd.	9-May-11	0.88	<1	<2	11	<1	0.15
RMD-212	Opp. 8600 Riyan Rd.	9-May-11	0.85	<1	<2	11	<1	0.18
RMD-208	13200 No. 4 Rd.	9-May-11	0.82	<1	<2	11	<1	0.21
RMD-205	13851 Steveston Hwy.	9-May-11	0.71	<1	<2	11	<1	0.14
RMD-267	17240 Fedoruk	9-May-11	0.84	<1	<2	11	<1	0.12
RMD-249	23000 Blk. Dyke Rd.	9-May-11	0.77	<1	<2	11	<1	0.37
RMD-276	22271 Cochrane Drive	9-May-11	0.71	<1	<2	11	<1	0.29
RMD-275	5180 Smith Cres.	9-May-11	0.75	<1	<2	10	<1	0.36
RMD-203	23260 Westminster Hwy.	9-May-11	0.87	<1	<2	11	<1	0.30
RMD-202	1500 Valemont Way	9-May-11	0.80	<1	<2	10	<1	0.24
RMD-214	11720 Westminster Hwy.	9-May-11	0.92	<1	<2	10	<1	0.13
RMD-251	5951 McCallan Rd.	11-May-11	0.32	<1	4	10	<1	0.18
RMD-273	Opp. 8331 Fairfax Place	11-May-11	0.33	<1	<2	14	<1	0.17
RMD-274	10920 Springwood Court	11-May-11	0.22	<1	<2	12	<1	0.17
RMD-252	9751 Pendleton Rd.	11-May-11	0.54	<1	<2	11	<1	0.17
RMD-250	6071 Azure Rd.	11-May-11	0.50	<1	<2	10	<1	0.17
RMD-271	3800 Cessna Drive	11-May-11	0.71	<1	<2	12	<1	0.21
RMD-272	751 Catalina Cres.	11-May-11	0.96	<1	<2	10	<1	0.18
RMD-255	6000 Blk. Miller Rd.	11-May-11	0.97	<1	<2	9	<1	0.23
RMD-256	1000 Blk. McDonald Rd.	11-May-11	0.89	<1	<2	12	<1	0.20
RMD-254	5300 No. 3 Rd.	11-May-11	0.93	<1	<2	10	<1	0.16
RMD-270	8200 Jones Rd.	11-May-11	0.82	<1	<2	11	<1	0.14
RMD-253	11051 No 3 Rd.	11-May-11	0.88	<1	<2	10	<1	0.17
RMD-269	14951 Triangle Rd.	11-May-11	0.73	<1	2	13	<1	0.19
RMD-257	6640 Blundell Rd.	13-May-11	0.89	<1	<2	8	<1	0.16
RMD-266	9380 General Currie Rd.	13-May-11	0.86	<1	<2	8	<1	0.17
RMD-259	10020 Amethyst Ave.	13-May-11	0.83	<1	<2	8	<1	0.21
RMD-268	13800 No. 3 Rd. (off Garden City)	13-May-11	0.81	<1	<2	9	<1	0.15
RMD-258	7000 Blk. Dyke Rd.	13-May-11	0.85	<1	<2	9	<1	0.19
RMD-260	11111 Horseshoe Way	13-May-11	0.86	<1	<2	8	<1	0.15
RMD-261	9911 Sidaway Rd.	13-May-11	0.82	<1	<2	8	<1	0.16
RMD-262	13799 Commerce Pkwy.	13-May-11	0.73	<1	<2	8	<1	0.19
RMD-263	12560 Cambie Rd.	13-May-11	0.76	<1	<2	9	<1	0.17
RMD-264	13100 Mitchell Rd.	13-May-11	0.71	<1	<2	9	<1	0.18
RMD-277	Opp. 11280 Twigg Place	13-May-11	0.80	<1	<2	10	<1	0.15
RMD-278	6651 Fraserwood Place	13-May-11	0.09	<1	<2	11	<1	0.22
RMD-279	Opp. 20371 Westminster Hwy.	13-May-11	0.35	<1	<2	11	<1	0.28
RMD-212	Opp. 8600 Riyan Rd.	16-May-11	0.89	<1	2	9	<1	0.21
RMD-208	13200 No. 4 Rd.	16-May-11	0.86	<1	<2	9	<1	0.19
RMD-205	13851 Steveston Hwy.	16-May-11	0.37	<1	<2	9	<1	0.15

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-267	17240 Fedoruk	16-May-11	0.95	<1	<2	9	<1	0.11
RMD-249	23000 Blk. Dyke Rd.	16-May-11	0.86	<1	<2	8	<1	0.30
RMD-276	22271 Cochrane Drive	16-May-11	0.47	<1	<2	9	<1	0.22
RMD-275	5180 Smith Cres.	16-May-11	0.85	<1	<2	8	<1	0.33
RMD-203	23260 Westminster Hwy.	16-May-11	0.97	<1	<2	8	<1	0.29
RMD-202	1500 Valemont Way	16-May-11	0.75	<1	<2	8	<1	0.21
RMD-214	11720 Westminster Hwy.	16-May-11	0.96	<1	<2	8	<1	0.12
RMD-216	11080 No. 2 Rd.	16-May-11	0.82	<1	<2	9	<1	0.17
RMD-206	4251 Moncton St.	16-May-11	0.84	<1	<2	9	<1	0.18
RMD-204	3180 Granville Ave.	16-May-11	0.81	<1	<2	9	<1	0.27
RMD-251	5951McCallan Rd.	18-May-11	0.96	<1	<2	8	<1	0.15
RMD-273	Opp. 8331 Fairfax Place	18-May-11	0.77	<1	<2	13	<1	0.23
RMD-252	9751 Pendleton Rd.	18-May-11	0.83	<1	<2	9	<1	0.28
RMD-274	10920 Springwood Court	18-May-11	0.81	<1	<2	10	<1	0.16
RMD-253	11051 No 3 Rd.	18-May-11	0.96	<1	<2	8	<1	0.17
RMD-269	14951 Triangle Rd.	18-May-11	0.74	<1	<2	11	<1	0.23
RMD-270	8200 Jones Rd.	18-May-11	0.85	<1	<2	10	<1	0.16
RMD-254	5300 No. 3 Rd.	18-May-11	0.93	<1	<2	8	<1	0.21
RMD-271	3800 Cessna Drive	18-May-11	0.72	<1	<2	10	<1	0.23
RMD-272	751 Catalina Cres.	18-May-11	0.86	<1	<2	8	<1	0.22
RMD-255	6000 Blk. Miller Rd.	18-May-11	1.0	<1	<2	8	<1	0.31
RMD-256	1000 Blk. McDonald Rd.	18-May-11	0.81	<1	<2	10	<1	0.24
RMD-250	6071 Azure Rd.	18-May-11	0.92	<1	2	9	<1	0.23
RMD-257	6640 Blundell Rd.	20-May-11	0.99	<1	<2	9	<1	0.12
RMD-258	7000 Blk. Dyke Rd.	20-May-11	0.82	<1	<2	12	<1	0.15
RMD-268	13800 No. 3 Rd. (off Garden City)	20-May-11	0.77	<1	<2	10	<1	0.17
RMD-259	10020 Amethyst Ave.	20-May-11	0.82	<1	<2	10	<1	0.14
RMD-266	9380 General Currie Rd.	20-May-11	0.79	<1	<2	10	<1	0.14
RMD-260	11111 Horseshoe Way	20-May-11	1.2	<1	<2	10	<1	0.18
RMD-261	9911 Sidaway Rd.	20-May-11	0.74	<1	2	11	<1	0.13
RMD-262	13799 Commerce Pkwy.	20-May-11	0.78	<1	<2	10	<1	0.20
RMD-263	12560 Cambie Rd.	20-May-11	0.86	<1	<2	11	<1	0.18
RMD-264	13100 Mitchell Rd.	20-May-11	0.81	<1	<2	12	<1	0.13
RMD-277	Opp. 11280 Twigg Place	20-May-11	0.81	<1	<2	13	<1	0.15
RMD-278	6651 Fraserwood Place	20-May-11	0.1	<1	<2	14	<1	0.22
RMD-279	Opp. 20371 Westminster Hwy.	20-May-11	0.47	<1	<2	12	<1	0.26
RMD-204	3180 Granville Ave.	24-May-11	0.59	<1	<2	12	<1	0.12
RMD-206	4251 Moncton St.	24-May-11	0.85	<1	<2	12	<1	0.14
RMD-216	11080 No. 2 Rd.	24-May-11	0.85	<1	82	11	<1	0.27
RMD-212	Opp. 8600 Riyan Rd.	24-May-11	1.0	<1	<2	11	<1	0.15

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-208	13200 No. 4 Rd.	24-May-11	0.99	<1	2	11	<1	0.13
RMD-205	13851 Steveston Hwy.	24-May-11	0.76	<1	<2	11	<1	0.15
RMD-267	17240 Fedoruk	24-May-11	0.87	<1	<2	11	<1	[Two bottles labelled 267 no 249] LA
RMD-249	23000 Blk. Dyke Rd.	24-May-11	0.83	<1	<2	10	<1	[Two bottles labelled 267 no 249] LA
RMD-276	22271 Cochrane Drive	24-May-11	0.58	<1	<2	12	<1	0.24
RMD-275	5180 Smith Cres.	24-May-11	0.81	<1	<2	11	<1	0.35
RMD-203	23260 Westminster Hwy.	24-May-11	0.82	<1	<2	10	<1	0.38
RMD-202	1500 Valemont Way	24-May-11	0.92	<1	<2	10	<1	0.11
RMD-214	11720 Westminster Hwy.	24-May-11	1.0	<1	<2	10	<1	0.15
RMD-251	5951 McCallan Rd.	25-May-11	0.87	<1	2	11	<1	0.14
RMD-273	Opp. 8331 Fairfax Place	25-May-11	0.77	<1	<2	16	<1	0.18
RMD-274	10920 Springwood Court	25-May-11	0.79	<1	<2	13	<1	0.20
RMD-252	9751 Pendleton Rd.	25-May-11	0.85	<1	<2	11	<1	0.15
RMD-250	6071 Azure Rd.	25-May-11	0.93	<1	<2	11	<1	0.15
RMD-271	3800 Cessna Drive	25-May-11	0.71	<1	<2	11	<1	0.14
RMD-272	751 Catalina Cres.	25-May-11	0.94	<1	<2	10	<1	0.13
RMD-255	6000 Blk. Miller Rd.	25-May-11	0.89	<1	<2	9	<1	0.27
RMD-256	1000 Blk. McDonald Rd.	25-May-11	0.96	<1	<2	11	<1	0.14
RMD-254	5300 No. 3 Rd.	25-May-11	0.98	<1	<2	11	<1	0.16
RMD-270	8200 Jones Rd.	25-May-11	0.78	<1	<2	12	<1	0.24
RMD-269	14951 Triangle Rd.	25-May-11	0.75	<1	<2	14	<1	0.15
RMD-253	11051 No 3 Rd.	25-May-11	0.97	<1	<2	10	<1	0.13
RMD-257	6640 Blundell Rd.	27-May-11	1.0	<1	<2	8	<1	0.17
RMD-266	9380 General Currie Rd.	27-May-11	0.97	<1	<2	8	<1	0.25
RMD-259	10020 Amethyst Ave.	27-May-11	1.0	<1	2	9	<1	0.15
RMD-268	13800 No. 3 Rd. (off Garden City)	27-May-11	0.82	<1	<2	9	<1	0.20
RMD-258	7000 Blk. Dyke Rd.	27-May-11	0.9	<1	<2	10	<1	0.13
RMD-260	11111 Horseshoe Way	27-May-11	0.97	<1	<2	8	<1	0.13
RMD-261	9911 Sidaway Rd.	27-May-11	0.96	<1	<2	9	<1	0.13
RMD-262	13799 Commerce Pkwy.	27-May-11	0.75	<1	<2	9	<1	0.19
RMD-263	12560 Cambie Rd.	27-May-11	0.79	<1	<2	9	<1	0.14
RMD-278	6651 Fraserwood Place	27-May-11	0.21	<1	2	11	<1	0.21

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-279	Opp. 20371 Westminster Hwy.	27-May-11	0.32	<1	<2	10	<1	0.27
RMD-264	13100 Mitchell Rd.	27-May-11	0.85	<1	<2	10	<1	0.32
RMD-277	Opp. 11280 Twigg Place	27-May-11	0.58	<1	<2	13	<1	0.12
RMD-204	3180 Granville Ave.	30-May-11	0.84	<1	<2	12	<1	0.14
RMD-206	4251 Moncton St.	30-May-11	0.89	<1	<2	12	<1	0.14
RMD-216	11080 No. 2 Rd.	30-May-11	0.95	<1	<2	11	<1	0.16
RMD-212	Opp. 8600 Riyan Rd.	30-May-11	0.95	<1	<2	11	<1	0.14
RMD-208	13200 No. 4 Rd.	30-May-11	0.92	<1	2	11	<1	0.15
RMD-205	13851 Steveston Hwy.	30-May-11	0.91	<1	2	11	<1	0.22
RMD-267	17240 Fedoruk	30-May-11	0.76	<1	<2	12	<1	0.15
RMD-249	23000 Blk. Dyke Rd.	30-May-11	0.7	<1	4	10	<1	0.31
RMD-276	22271 Cochrane Drive	30-May-11	0.4	<1	<2	11	<1	0.34
RMD-275	5180 Smith Cres.	30-May-11	0.8	<1	<2	10	<1	0.27
RMD-203	23260 Westminster Hwy.	30-May-11	0.75	<1	<2	10	<1	0.33
RMD-202	1500 Valemont Way	30-May-11	0.54	<1	2	11	<1	0.14
RMD-214	11720 Westminster Hwy.	30-May-11	1.0	<1	<2	10	<1	0.16
RMD-251	5951McCallan Rd.	1-Jun-11	0.97	<1	<2	11	<1	0.19
RMD-273	Opp. 8331 Fairfax Place	1-Jun-11	0.84	<1	<2	16	<1	0.90
RMD-252	9751 Pendleton Rd.	1-Jun-11	0.93	<1	<2	12	<1	0.18
RMD-274	10920 Springwood Court	1-Jun-11	0.97	<1	2	13	<1	0.30
RMD-250	6071 Azure Rd.	1-Jun-11	1.0	<1	2	12	<1	0.19
RMD-271	3800 Cessna Drive	1-Jun-11	0.73	<1	2	13	<1	0.14
RMD-272	751 Catalina Cres.	1-Jun-11	0.96	<1	<2	11	<1	0.17
RMD-255	6000 Blk. Miller Rd.	1-Jun-11	0.99	<1	<2	10	<1	0.18
RMD-256	1000 Blk. McDonald Rd.	1-Jun-11	0.92	<1	<2	11	<1	0.15
RMD-254	5300 No. 3 Rd.	1-Jun-11	0.97	<1	<2	10	<1	0.14
RMD-270	8200 Jones Rd.	1-Jun-11	0.86	<1	<2	12	<1	0.14
RMD-269	14951 Triangle Rd.	1-Jun-11	0.82	<1	<2	13	<1	0.14
RMD-253	11051 No 3 Rd.	1-Jun-11	0.95	<1	<2	11	<1	0.14
RMD-257	6640 Blundell Rd.	3-Jun-11	0.91	<1	<2	9	<1	0.15
RMD-258	7000 Blk. Dyke Rd.	3-Jun-11	0.86	<1	<2	11	<1	0.17
RMD-268	13800 No. 3 Rd. (off Garden City)	3-Jun-11	0.7	<1	<2	10	<1	0.14
RMD-259	10020 Amethyst Ave.	3-Jun-11	0.84	<1	<2	10	<1	0.16
RMD-266	9380 General Currie Rd.	3-Jun-11	0.87	<1	<2	10	<1	0.15
RMD-260	11111 Horseshoe Way	3-Jun-11	0.95	<1	<2	10	<1	0.15
RMD-261	9911 Sidaway Rd.	3-Jun-11	0.86	<1	<2	10	<1	0.12
RMD-262	13799 Commerce Pkwy.	3-Jun-11	0.68	<1	<2	10	<1	0.16
RMD-263	12560 Cambie Rd.	3-Jun-11	0.64	<1	<2	10	<1	0.16
RMD-264	13100 Mitchell Rd.	3-Jun-11	0.87	<1	<2	11	<1	0.15
RMD-277	Opp. 11280 Twigg Place	3-Jun-11	0.9	<1	<2	13	<1	0.12

**PWT - 73**

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mls	HPC CFU/mls	Temperature °C	Total Coliform MF/100mls	Turbidity NTU
RMD-279	Opp. 20371 Westminster Hwy.	3-Jun-11	0.32	<1	<2	11	<1	0.21
RMD-278	6651 Fraserwood Place	3-Jun-11	0.13	<1	<2	14	<1	0.18
RMD-204	3180 Granville Ave.	6-Jun-11	0.79	<1	<2	10	<1	0.13
RMD-206	4251 Moncton St.	6-Jun-11	0.58	<1	2	10	<1	0.16
RMD-216	11080 No. 2 Rd.	6-Jun-11	0.8	<1	<2	9	<1	0.13
RMD-212	Opp. 8600 Riyan Rd.	6-Jun-11	0.93	<1	<2	9	<1	0.13
RMD-208	13200 No. 4 Rd.	6-Jun-11	0.87	<1	<2	9	<1	0.21
RMD-205	13851 Steveston Hwy.	6-Jun-11	0.82	<1	<2	9	<1	0.16
RMD-267	17240 Fedoruk	6-Jun-11	0.68	<1	2	9	<1	0.22
RMD-249	23000 Blk. Dyke Rd.	6-Jun-11	0.82	<1	<2	7	<1	0.35
RMD-276	22271 Cochrane Drive	6-Jun-11	0.50	<1	4	7	<1	0.27
RMD-275	5180 Smith Cres.	6-Jun-11	0.70	<1	<2	8	<1	0.32
RMD-203	23260 Westminster Hwy.	6-Jun-11	0.79	<1	6	7	<1	0.35
RMD-202	1500 Valemont Way	6-Jun-11	0.55	<1	<2	8	<1	0.12
RMD-214	11720 Westminster Hwy.	6-Jun-11	0.95	<1	<2	7	<1	0.15
RMD-251	5951 McCallan Rd.	8-Jun-11	0.73	<1	<2	8	<1	0.27
RMD-273	Opp. 8331 Fairfax Place	8-Jun-11	0.61	<1	<2	14	<1	0.15
RMD-252	9751 Pendleton Rd.	8-Jun-11	0.70	<1	<2	9	<1	0.19
RMD-274	10920 Springwood Court	8-Jun-11	0.61	<1	<2	10	<1	0.51
RMD-253	11051 No 3 Rd.	8-Jun-11	0.73	<1	<2	7	<1	0.18
RMD-269	14951 Triangle Rd.	8-Jun-11	0.66	<1	<2	10	<1	0.18
RMD-270	8200 Jones Rd.	8-Jun-11	0.62	<1	<2	7	<1	0.29
RMD-254	5300 No. 3 Rd.	8-Jun-11	0.72	<1	<2	7	<1	0.22
RMD-271	3800 Cessna Drive	8-Jun-11	0.52	<1	2	9	<1	0.13
RMD-272	751 Catalina Cres.	8-Jun-11	0.71	<1	<2	8	<1	0.16
RMD-255	6000 Blk. Miller Rd.	8-Jun-11	0.81	<1	2	7	<1	0.36
RMD-256	1000 Blk. McDonald Rd.	8-Jun-11	0.51	<1	<2	9	<1	0.15
RMD-250	6071 Azure Rd.	8-Jun-11	0.79	<1	<2	7	<1	0.31
RMD-257	6640 Blundell Rd.	10-Jun-11	0.75	<1	<2	9	<1	0.13
RMD-266	9380 General Currie Rd.	10-Jun-11	0.66	<1	<2	9	<1	0.17
RMD-259	10020 Amethyst Ave.	10-Jun-11	0.71	<1	2	9	<1	0.19
RMD-268	13800 No. 3 Rd. (off Garden City)	10-Jun-11	0.66	<1	2	10	<1	0.13
RMD-258	7000 Blk. Dyke Rd.	10-Jun-11	0.66	<1	<2	12	<1	0.16
RMD-260	11111 Horseshoe Way	10-Jun-11	0.73	<1	<2	9	<1	0.13
RMD-261	9911 Sidaway Rd.	10-Jun-11	0.68	<1	2	9	<1	0.12
RMD-262	13799 Commerce Pkwy.	10-Jun-11	0.52	<1	<2	10	<1	0.29
RMD-263	12560 Cambie Rd.	10-Jun-11	0.65	<1	<2	9	<1	0.22
RMD-264	13100 Mitchell Rd.	10-Jun-11	0.61	<1	2	11	<1	0.16
RMD-277	Opp. 11280 Twigg Place	10-Jun-11	0.56	<1	<2	15	<1	0.11
RMD-279	Opp. 20371 Westminster Hwy.	10-Jun-11	0.28	<1	2	11	<1	0.22



Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-278	6651 Fraserwood Place	10-Jun-11	0.20	<1	<2	12	<1	0.21
RMD-204	3180 Granville Ave.	13-Jun-11	0.47	<1	<2	13	<1	0.14
RMD-206	4251 Moncton St.	13-Jun-11	0.64	<1	<2	12	<1	0.15
RMD-216	11080 No. 2 Rd.	13-Jun-11	0.67	<1	<2	11	<1	0.16
RMD-212	Opp. 8600 Riyan Rd.	13-Jun-11	0.73	<1	2	12	<1	0.17
RMD-208	13200 No. 4 Rd.	13-Jun-11	0.73	<1	<2	11	<1	0.14
RMD-205	13851 Steveston Hwy.	13-Jun-11	0.73	<1	2	11	<1	0.16
RMD-267	17240 Fedoruk	13-Jun-11	0.92	<1	<2	11	<1	0.14
RMD-249	23000 Blk. Dyke Rd.	13-Jun-11	0.77	<1	<2	10	<1	0.31
RMD-276	22271 Cochrane Drive	13-Jun-11	0.65	<1	<2	11	<1	0.29
RMD-275	5180 Smith Cres.	13-Jun-11	0.62	<1	[Not recorded.] LA	11	<1	0.32
RMD-203	23260 Westminster Hwy.	13-Jun-11	0.76	<1	<2	10	<1	0.29
RMD-202	1500 Valemont Way	13-Jun-11	0.95	<1	<2	10	<1	0.14
RMD-214	11720 Westminster Hwy.	13-Jun-11	0.82	<1	<2	9	<1	0.18
RMD-251	5951 McCallan Rd.	15-Jun-11	0.45	<1	2	10	<1	0.15
RMD-273	Opp. 8331 Fairfax Place	15-Jun-11	0.54	<1	2	17	<1	0.46
RMD-274	10920 Springwood Court	15-Jun-11	0.54	<1	4	15	<1	0.64
RMD-252	9751 Pendleton Rd.	15-Jun-11	0.57	<1	<2	11	<1	0.19
RMD-250	6071 Azure Rd.	15-Jun-11	0.57	<1	<2	12	<1	0.17
RMD-271	3800 Cessna Drive	15-Jun-11	0.39	<1	<2	13	<1	0.15
RMD-272	751 Catalina Cres.	15-Jun-11	0.65	<1	<2	12	<1	0.16
RMD-255	6000 Blk. Miller Rd.	15-Jun-11	0.78	<1	<2	10	<1	0.22
RMD-256	1000 Blk. McDonald Rd.	15-Jun-11	0.46	<1	<2	14	<1	0.14
RMD-254	5300 No. 3 Rd.	15-Jun-11	0.75	<1	<2	11	<1	0.23
RMD-270	8200 Jones Rd.	15-Jun-11	0.61	<1	<2	13	<1	0.27
RMD-269	14951 Triangle Rd.	15-Jun-11	0.48	<1	<2	16	<1	0.18
RMD-253	11051 No 3 Rd.	15-Jun-11	0.73	<1	2	11	<1	0.17
RMD-257	6640 Blundell Rd.	17-Jun-11	0.78	<1	<2	10	<1	0.16
RMD-258	7000 Blk. Dyke Rd.	17-Jun-11	0.7	<1	<2	10	<1	0.17
RMD-268	13800 No. 3 Rd. (off Garden City)	17-Jun-11	0.81	<1	<2	10	<1	0.17
RMD-259	10020 Amethyst Ave.	17-Jun-11	0.71	<1	<2	10	<1	0.16
RMD-266	9380 General Currie Rd.	17-Jun-11	0.74	<1	<2	10	<1	0.18
RMD-260	11111 Horseshoe Way	17-Jun-11	0.75	<1	<2	10	<1	0.16
RMD-261	9911 Sidaway Rd.	17-Jun-11	0.74	<1	<2	10	<1	0.15
RMD-262	13799 Commerce Pkwy.	17-Jun-11	0.87	<1	<2	10	<1	0.14
RMD-263	12560 Cambie Rd.	17-Jun-11	0.66	<1	<2	11	<1	0.17
RMD-264	13100 Mitchell Rd.	17-Jun-11	0.61	<1	<2	11	<1	0.13
RMD-277	Opp. 11280 Twigg Place	17-Jun-11	0.32	<1	<2	14	<1	0.13
RMD-279	Opp. 20371 Westminster Hwy.	17-Jun-11	0.61	<1	<2	11	<1	0.23

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-278	6651 Fraserwood Place	17-Jun-11	0.13	<1	20	13	<1	0.22
RMD-204	3180 Granville Ave.	20-Jun-11	0.65	<1	<2	13	<1	0.13
RMD-206	4251 Moncton St.	20-Jun-11	0.62	<1	<2	14	<1	0.13
RMD-216	11080 No. 2 Rd.	20-Jun-11	0.71	<1	<2	11	<1	0.12
RMD-212	Opp. 8600 Riyan Rd.	20-Jun-11	0.67	<1	<2	11	<1	0.15
RMD-208	13200 No. 4 Rd.	20-Jun-11	0.74	<1	<2	11	<1	0.13
RMD-205	13851 Steveston Hwy.	20-Jun-11	0.66	<1	<2	12	<1	0.17
RMD-267	17240 Fedoruk	20-Jun-11	0.79	<1	<2	12	<1	0.15
RMD-249	23000 Blk. Dyke Rd.	20-Jun-11	0.88	<1	40	11	<1	0.25
RMD-276	22271 Cochrane Drive	20-Jun-11	0.67	<1	2	12	<1	0.22
RMD-275	5180 Smith Cres.	20-Jun-11	0.89	<1	<2	11	<1	0.24
RMD-203	23260 Westminster Hwy.	20-Jun-11	0.92	<1	<2	10	<1	0.21
RMD-202	1500 Valemont Way	20-Jun-11	0.88	<1	<2	11	<1	0.11
RMD-214	11720 Westminster Hwy.	20-Jun-11	0.81	<1	4	10	<1	0.16
RMD-251	5951McCallan Rd.	22-Jun-11	0.77	<1	<2	10	<1	0.18
RMD-273	Opp. 8331 Fairfax Place	22-Jun-11	0.51	<1	<2	18	<1	0.46
RMD-252	9751 Pendleton Rd.	22-Jun-11	0.68	<1	<2	13	<1	0.15
RMD-274	10920 Springwood Court	22-Jun-11	0.66	<1	16	14	<1	0.12
RMD-250	6071 Azure Rd.	22-Jun-11	0.78	<1	<2	13	<1	0.21
RMD-271	3800 Cessna Drive	22-Jun-11	0.46	<1	6	15	<1	0.12
RMD-272	751 Catalina Cres.	22-Jun-11	0.70	<1	<2	11	<1	0.35
RMD-255	6000 Blk. Miller Rd.	22-Jun-11	0.79	<1	<2	11	<1	0.46
RMD-254	5300 No. 3 Rd.	22-Jun-11	0.79	<1	2	11	<1	0.19
RMD-270	8200 Jones Rd.	22-Jun-11	0.71	<1	<2	14	<1	0.21
RMD-269	14951 Triangle Rd.	22-Jun-11	0.86	<1	<2	17	<1	0.19
RMD-253	11051 No 3 Rd.	22-Jun-11	0.76	<1	2	11	<1	0.18
RMD-266	9380 General Currie Rd.	24-Jun-11	0.68	<1	<2	8	<1	0.18
RMD-257	6640 Blundell Rd.	24-Jun-11	0.71	<1	<2	8	<1	0.13
RMD-258	7000 Blk. Dyke Rd.	24-Jun-11	0.61	<1	<2	12	<1	0.18
RMD-268	13800 No. 3 Rd. (off Garden City)	24-Jun-11	0.56	<1	2	10	<1	0.13
RMD-259	10020 Amethyst Ave.	24-Jun-11	0.66	<1	<2	9	<1	0.15
RMD-260	11111 Horseshoe Way	24-Jun-11	0.80	<1	<2	10	<1	0.10
RMD-261	9911 Sidaway Rd.	24-Jun-11	0.71	<1	<2	10	<1	0.10
RMD-262	13799 Commerce Pkwy.	24-Jun-11	0.80	<1	<2	10	<1	0.13
RMD-263	12560 Cambie Rd.	24-Jun-11	0.73	<1	2	10	<1	0.12
RMD-264	13100 Mitchell Rd.	24-Jun-11	0.49	<1	<2	11	<1	0.14
RMD-277	Opp. 11280 Twigg Place	24-Jun-11	0.26	<1	2	15	<1	0.13
RMD-278	6651 Fraserwood Place	24-Jun-11	0.04	<1	22	14	<1	0.21
RMD-279	Opp. 20371 Westminster Hwy.	24-Jun-11	0.16	<1	<2	12	<1	0.20

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-256	1000 Blk. McDonald Rd. before flushing	24-Jun-11	0.03	<1		15	<1	0.61
RMD-256	1000 Blk. McDonald Rd. after flushing	24-Jun-11	0.36	<1		15	<1	0.16
RMD-204	3180 Granville Ave.	27-Jun-11	0.67	<1	<2	13	<1	0.12
RMD-206	4251 Moncton St.	27-Jun-11	0.71	<1	<2	13	<1	0.16
RMD-216	11080 No. 2 Rd.	27-Jun-11	0.72	<1	<2	11	<1	0.14
RMD-212	Opp. 8600 Riyan Rd.	27-Jun-11	0.62	<1	2	11	<1	0.14
RMD-208	13200 No. 4 Rd.	27-Jun-11	0.72	<1	<2	12	<1	0.14
RMD-205	13851 Steveston Hwy.	27-Jun-11	0.93	<1	2	10	<1	0.16
RMD-267	17240 Fedoruk	27-Jun-11	0.94	<1	<2	10	<1	0.14
RMD-249	23000 Blk. Dyke Rd.	27-Jun-11	0.72	<1	<2	10	<1	0.26
RMD-276	22271 Cochrane Drive	27-Jun-11	0.33	<1	2	13	<1	0.17
RMD-275	5180 Smith Cres.	27-Jun-11	0.63	<1	<2	12	<1	0.22
RMD-203	23260 Westminster Hwy.	27-Jun-11	0.72	<1	<2	11	<1	0.27
RMD-202	1500 Valemont Way	27-Jun-11	0.86	<1	<2	11	<1	0.12
RMD-214	11720 Westminster Hwy.	27-Jun-11	0.79	<1	<2	10	<1	0.17
RMD-251	5951McCallan Rd.	29-Jun-11	0.73	<1	<2	11	<1	0.14
RMD-273	Opp. 8331 Fairfax Place	29-Jun-11	0.79	<1	<2	18	<1	1.70
RMD-274	10920 Springwood Court	29-Jun-11	0.62	<1	62	14	<1	0.80
RMD-252	9751 Pendleton Rd.	29-Jun-11	0.69	<1	<2	14	<1	0.18
RMD-250	6071 Azure Rd.	29-Jun-11	0.69	<1	2	12	<1	0.20
RMD-271	3800 Cessna Drive	29-Jun-11	0.68	<1	22	16	<1	0.13
RMD-255	6000 Blk. Miller Rd.	29-Jun-11	0.79	<1	<2	10	<1	0.19
RMD-272	751 Catalina Cres.	29-Jun-11	0.53	<1	<2	12	<1	0.15
RMD-254	5300 No. 3 Rd.	29-Jun-11	0.65	<1	<2	11	<1	0.13
RMD-270	8200 Jones Rd.	29-Jun-11	0.90	<1	<2	16	<1	0.21
RMD-269	14951 Triangle Rd.	29-Jun-11	0.90	<1	<2	16	<1	0.14
RMD-253	11051 No 3 Rd.	29-Jun-11	0.80	<1	<2	11	<1	0.13
RMD-251	5951McCallan Rd.	4-Jul-11	0.74	<1	<2	9	<1	0.22
RMD-273	Opp. 8331 Fairfax Place	4-Jul-11	0.50	<1	4	17	<1	1.80
RMD-252	9751 Pendleton Rd.	4-Jul-11	0.66	<1	<2	11	<1	0.16
RMD-274	10920 Springwood Court	4-Jul-11	0.57	<1	98	12	<1	1.40
RMD-250	6071 Azure Rd.	4-Jul-11	0.67	<1	<2	11	<1	0.30
RMD-271	3800 Cessna Drive	4-Jul-11	0.74	<1	<2	10	<1	0.15
RMD-272	751 Catalina Cres.	4-Jul-11	0.77	<1	<2	10	<1	0.13
RMD-255	6000 Blk. Miller Rd.	4-Jul-11	0.72	<1	2	9	<1	0.32
RMD-256	1000 Blk. McDonald Rd.	4-Jul-11	0.59	<1	4	10	<1	0.14
RMD-254	5300 No. 3 Rd.	4-Jul-11	0.74	<1	4	9	<1	0.18
RMD-270	8200 Jones Rd.	4-Jul-11	0.61	<1	<2	12	<1	0.14

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mls	HPC CFU/mls	Temperature °C	Total Coliform MF/100mls	Turbidity NTU
RMD-269	14951 Triangle Rd.	4-Jul-11	0.84	<1	<2	9	<1	0.12
RMD-253	11051 No 3 Rd.	4-Jul-11	0.76	<1	<2	9	<1	0.23
RMD-263	12560 Cambie Rd.	6-Jul-11	0.74	<1	<2	10	<1	0.34
RMD-264	13100 Mitchell Rd.	6-Jul-11	0.61	<1	<2	12	<1	0.18
RMD-277	Opp. 11280 Twigg Place	6-Jul-11	0.26	<1	<2	17	<1	0.13
RMD-262	13799 Commerce Pkwy.	6-Jul-11	0.83	<1	2	10	<1	0.17
RMD-278	6651 Fraserwood Place	6-Jul-11	0.26	<1	6	13	<1	0.24
RMD-279	Opp. 20371 Westminster Hwy.	6-Jul-11	0.20	<1	4	13	<1	0.23
RMD-261	9911 Sidaway Rd.	6-Jul-11	0.83	<1	<2	10	<1	0.12
RMD-260	11111 Horseshoe Way	6-Jul-11	0.62	<1	<2	10	<1	0.24
RMD-268	13800 No. 3 Rd. (off Garden City)	6-Jul-11	0.64	<1	<2	11	<1	0.18
RMD-258	7000 Blk. Dyke Rd.	6-Jul-11	0.62	<1	2	13	<1	0.18
RMD-257	6640 Blundell Rd.	6-Jul-11	0.7	<1	<2	9	<1	0.32
RMD-266	9380 General Currie Rd.	6-Jul-11	1.1	<1	<2	9	<1	0.34
RMD-259	10020 Amethyst Ave.	6-Jul-11	0.82	<1	<2	10	<1	0.28
RMD-204	3180 Granville Ave.	8-Jul-11	0.64	<1	<2	11	<1	0.16
RMD-206	4251 Moncton St.	8-Jul-11	0.61	<1	<2	11	<1	0.15
RMD-216	11080 No. 2 Rd.	8-Jul-11	0.7	<1	<2	11	<1	0.13
RMD-212	Opp. 8600 Riyan Rd.	8-Jul-11	0.59	<1	<2	11	<1	0.19
RMD-208	13200 No. 4 Rd.	8-Jul-11	0.69	<1	<2	11	<1	0.17
RMD-205	13851 Steveston Hwy.	8-Jul-11	0.92	<1	<2	10	<1	0.15
RMD-214	11720 Westminster Hwy.	8-Jul-11	0.79	<1	<2	9	<1	0.26
RMD-202	1500 Valemont Way	8-Jul-11	0.86	<1	2	10	<1	0.11
RMD-267	17240 Fedoruk	8-Jul-11	0.86	<1	<2	11	<1	0.09
RMD-249	23000 Blk. Dyke Rd.	8-Jul-11	0.11	<1	<2	15	<1	0.23
RMD-276	22271 Cochrane Drive	8-Jul-11	0.42	<1	2	11	<1	0.20
RMD-275	5180 Smith Cres.	8-Jul-11	0.57	<1	2	11	<1	0.21
RMD-203	23260 Westminster Hwy.	8-Jul-11	0.37	<1	<2	11	<1	0.25
RMD-251	5951 McCallan Rd.	11-Jul-11	0.66	<1	2	11	<1	0.17
RMD-273	Opp. 8331 Fairfax Place	11-Jul-11	0.46	<1	4	19	<1	1.20
RMD-274	10920 Springwood Court	11-Jul-11	0.64	<1	24	13	<1	0.23
RMD-252	9751 Pendleton Rd.	11-Jul-11	0.68	<1	<2	13	<1	0.11
RMD-250	6071 Azure Rd.	11-Jul-11	0.73	<1	<2	11	<1	0.19
RMD-271	3800 Cessna Drive	11-Jul-11	0.55	<1	<2	11	<1	0.12
RMD-272	751 Catalina Cres.	11-Jul-11	0.72	<1	2	11	<1	0.14
RMD-255	6000 Blk. Miller Rd.	11-Jul-11	0.70	<1	<2	10	<1	0.24
RMD-254	5300 No. 3 Rd.	11-Jul-11	0.73	<1	2	10	<1	0.14
RMD-270	8200 Jones Rd.	11-Jul-11	0.57	<1	<2	14	<1	0.13
RMD-269	14951 Triangle Rd.	11-Jul-11	0.76	<1	<2	10	<1	0.12
RMD-253	11051 No 3 Rd.	11-Jul-11	0.70	<1	<2	10	<1	0.18

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-257	6640 Blundell Rd.	13-Jul-11	0.67	<1	<2	11	<1	0.13
RMD-258	7000 Blk. Dyke Rd.	13-Jul-11	0.67	<1	2	14	<1	0.14
RMD-268	13800 No. 3 Rd. (off Garden City)	13-Jul-11	0.64	<1	4	12	<1	0.14
RMD-259	10020 Amethyst Ave.	13-Jul-11	0.71	<1	<2	12	<1	0.13
RMD-266	9380 General Currie Rd.	13-Jul-11	0.68	<1	<2	12	<1	0.13
RMD-260	11111 Horseshoe Way	13-Jul-11	0.61	<1	<2	12	<1	0.11
RMD-261	9911 Sidaway Rd.	13-Jul-11	0.75	<1	<2	12	<1	0.09
RMD-262	13799 Commerce Pkwy.	13-Jul-11	0.71	<1	<2	13	<1	0.13
RMD-263	12560 Cambie Rd.	13-Jul-11	0.69	<1	2	12	<1	0.14
RMD-264	13100 Mitchell Rd.	13-Jul-11	0.62	<1	<2	13	<1	0.15
RMD-277	Opp. 11280 Twigg Place	13-Jul-11	0.26	<1	2	19	<1	0.13
RMD-256-1	1000 Blk. McDonald Rd. before flushing	13-Jul-11	0.10	<1	260	19	<1	0.70
RMD-278	6651 Fraserwood Place	13-Jul-11	0.32	<1	<2	16	<1	0.19
RMD-279	Opp. 20371 Westminster Hwy.	13-Jul-11	0.31	<1	<2	14	<1	0.25
RMD-256-2	1000 Blk. McDonald Rd. after slushing	13-Jul-11	[Not taken] NA	<1	240	[Not taken] NA	<1	0.67
RMD-204	3180 Granville Ave.	15-Jul-11	0.66	<1	<2	14	<1	0.16
RMD-206	4251 Moncton St.	15-Jul-11	0.63	<1	<2	14	<1	0.14
RMD-216	11080 No. 2 Rd.	15-Jul-11	0.76	<1	<2	12	<1	0.13
RMD-212	Opp. 8600 Riyan Rd.	15-Jul-11	0.71	<1	<2	13	<1	0.12
RMD-208	13200 No. 4 Rd.	15-Jul-11	0.78	<1	<2	11	<1	0.11
RMD-205	13851 Steveston Hwy.	15-Jul-11	0.56	<1	<2	11	<1	0.12
RMD-214	11720 Westminster Hwy.	15-Jul-11	0.81	<1	<2	10	<1	0.13
RMD-202	1500 Valemont Way	15-Jul-11	0.62	<1	<2	11	<1	0.15
RMD-267	17240 Fedoruk	15-Jul-11	0.73	<1	6	13	<1	0.08
RMD-276	22271 Cochrane Drive	15-Jul-11	0.51	<1	<2	13	<1	0.20
RMD-275	5180 Smith Cres.	15-Jul-11	0.73	<1	<2	13	<1	0.20
RMD-203	23260 Westminster Hwy.	15-Jul-11	0.63	<1	<2	12	<1	0.27
RMD-249	23000 Blk. Dyke Rd.	15-Jul-11	0.32	<1	4	14	<1	0.25
RMD-251	5951 McCallan Rd.	18-Jul-11	0.64	<1	<2	10	<1	0.14
RMD-273	Opp. 8331 Fairfax Place	18-Jul-11	0.50	<1	2	18	<1	0.12
RMD-252	9751 Pendleton Rd.	18-Jul-11	0.61	<1	<2	12	<1	0.13
RMD-274	10920 Springwood Court	18-Jul-11	0.52	<1	280	14	<1	0.79
RMD-250	6071 Azure Rd.	18-Jul-11	0.59	<1	2	11	<1	0.16
RMD-271	3800 Cessna Drive	18-Jul-11	0.56	<1	<2	10	<1	0.16
RMD-272	751 Catalina Cres.	18-Jul-11	0.58	<1	<2	11	<1	0.15
RMD-255	6000 Blk. Miller Rd.	18-Jul-11	0.67	<1	<2	10	<1	0.74
RMD-256	1000 Blk. McDonald Rd.	18-Jul-11	0.47	<1	<2	11	<1	0.17

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-254	5300 No. 3 Rd.	18-Jul-11	0.59	<1	<2	10	<1	0.20
RMD-270	8200 Jones Rd.	18-Jul-11	0.55	<1	<2	12	<1	0.13
RMD-269	14951 Triangle Rd.	18-Jul-11	0.68	<1	<2	10	<1	0.16
RMD-253	11051 No 3 Rd.	18-Jul-11	0.64	<1	<2	10	<1	0.16
RMD-263	12560 Cambie Rd.	20-Jul-11	0.74	<1	<2	11	<1	0.14
RMD-264	13100 Mitchell Rd.	20-Jul-11	0.70	<1	<2	11	<1	0.64
RMD-277	Opp. 11280 Twigg Place	20-Jul-11	0.33	<1	8	18	<1	0.14
RMD-262	13799 Commerce Pkwy.	20-Jul-11	0.74	<1	2	10	<1	0.08
RMD-278	6651 Fraserwood Place	20-Jul-11	0.33	<1	4	15	<1	0.23
RMD-279	Opp. 20371 Westminster Hwy.	20-Jul-11	0.25	<1	2	15	<1	0.19
RMD-261	9911 Sidaway Rd.	20-Jul-11	0.45	<1	<2	13	<1	0.12
RMD-260	11111 Horseshoe Way	20-Jul-11	0.76	<1	<2	11	<1	0.09
RMD-259	10020 Amethyst Ave.	20-Jul-11	0.70	<1	<2	11	<1	0.14
RMD-268	13800 No. 3 Rd. (off Garden City)	20-Jul-11	0.73	<1	<2	11	<1	0.13
RMD-258	7000 Blk. Dyke Rd.	20-Jul-11	0.65	<1	<2	15	<1	0.14
RMD-257	6640 Blundell Rd.	20-Jul-11	0.76	<1	<2	10	<1	0.12
RMD-266	9380 General Currie Rd.	20-Jul-11	0.70	<1	<2	10	<1	0.14
RMD-204	3180 Granville Ave.	22-Jul-11	0.55	<1	<2	12	<1	0.49
RMD-206	4251 Moncton St.	22-Jul-11	0.50	<1	2	11	<1	0.36
RMD-216	11080 No. 2 Rd.	22-Jul-11	0.53	<1	<2	11	<1	0.25
RMD-212	Opp. 8600 Riyan Rd.	22-Jul-11	0.57	<1	2	11	<1	0.28
RMD-208	13200 No. 4 Rd.	22-Jul-11	0.53	<1	<2	11	<1	0.25
RMD-205	13851 Steveston Hwy.	22-Jul-11	0.69	<1	2	10	<1	0.31
RMD-214	11720 Westminster Hwy.	22-Jul-11	0.61	<1	<2	10	<1	0.20
RMD-202	1500 Valemont Way	22-Jul-11	0.57	<1	<2	10	<1	0.34
RMD-267	17240 Fedoruk	22-Jul-11	0.62	<1	<2	12	<1	0.09
RMD-249	23000 Blk. Dyke Rd.	22-Jul-11	0.04	<1	<2	14	<1	0.21
RMD-276	22271 Cochrane Drive	22-Jul-11	0.44	<1	<2	12	<1	0.26
RMD-275	5180 Smith Cres.	22-Jul-11	0.62	<1	<2	11	<1	0.23
RMD-203	23260 Westminster Hwy.	22-Jul-11	0.61	<1	<2	10	<1	0.38
RMD-251	5951 McCallan Rd.	25-Jul-11	0.59	<1	<2	11	<1	0.12
RMD-273	Opp. 8331 Fairfax Place	25-Jul-11	0.44	<1	2	17	<1	0.49
RMD-252	9751 Pendleton Rd.	25-Jul-11	0.52	<1	4	12	<1	0.14
RMD-274	10920 Springwood Court	25-Jul-11	0.50	<1	<2	12	<1	0.47
RMD-253	11051 No 3 Rd.	25-Jul-11	0.70	<1	<2	10	<1	0.14
RMD-270	8200 Jones Rd.	25-Jul-11	0.51	<1	<2	12	<1	0.18
RMD-250	6071 Azure Rd.	25-Jul-11	0.58	<1	2	12	<1	0.13
RMD-271	3800 Cessna Drive	25-Jul-11	0.59	<1	2	11	<1	0.11
RMD-272	751 Catalina Cres.	25-Jul-11	0.58	<1	<2	10	<1	0.13
RMD-255	6000 Blk. Miller Rd.	25-Jul-11	0.50	<1	<2	9	<1	0.23

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-256	1000 Blk. McDonald Rd.	25-Jul-11	0.46	<1	<2	12	<1	0.16
RMD-254	5300 No. 3 Rd.	25-Jul-11	0.49	<1	<2	10	<1	0.13
RMD-269	14951 Triangle Rd.	25-Jul-11	0.65	<1	2	9	<1	0.15
RMD-257	6640 Blundell Rd.	27-Jul-11	0.59	<1	<2	10	<1	0.16
RMD-266	9380 General Currie Rd.	27-Jul-11	0.16	<1	<2	10	<1	0.11
RMD-263	12560 Cambie Rd.	27-Jul-11	0.57	<1	<2	10	<1	0.12
RMD-264	13100 Mitchell Rd.	27-Jul-11	0.54	<1	<2	11	<1	0.17
RMD-277	Opp. 11280 Twigg Place	27-Jul-11	0.42	<1	<2	15	<1	0.16
RMD-262	13799 Commerce Pkwy.	27-Jul-11	0.62	<1	<2	11	<1	0.09
RMD-278	6651 Fraserwood Place	27-Jul-11	0.34	<1	<2	14	<1	0.24
RMD-279	Opp. 20371 Westminster Hwy.	27-Jul-11	0.48	<1	<2	12	<1	0.38
RMD-261	9911 Sidaway Rd.	27-Jul-11	0.64	<1	<2	11	<1	0.13
RMD-260	11111 Horseshoe Way	27-Jul-11	0.55	<1	<2	11	<1	0.14
RMD-259	10020 Amethyst Ave.	27-Jul-11	0.51	<1	<2	11	<1	0.15
RMD-268	13800 No. 3 Rd. (off Garden City)	27-Jul-11	0.39	<1	<2	12	<1	0.22
RMD-258	7000 Blk. Dyke Rd.	27-Jul-11	0.54	<1	<2	13	<1	0.18
RMD-204	3180 Granville Ave.	29-Jul-11	0.50	<1	<2	13	<1	0.11
RMD-206	4251 Moncton St.	29-Jul-11	0.50	<1	2	13	<1	0.11
RMD-216	11080 No. 2 Rd.	29-Jul-11	0.57	<1	<2	13	<1	0.12
RMD-212	Opp. 8600 Riyan Rd.	29-Jul-11	0.55	<1	<2	13	<1	0.10
RMD-208	13200 No. 4 Rd.	29-Jul-11	0.58	<1	180	12	<1	0.11
RMD-205	13851 Steveston Hwy.	29-Jul-11	0.63	<1	<2	14	<1	0.08
RMD-267	17240 Fedoruk	29-Jul-11	0.60	<1	<2	14	<1	0.08
RMD-202	1500 Valemont Way	29-Jul-11	0.62	<1	<2	13	<1	0.12
RMD-214	11720 Westminster Hwy.	29-Jul-11	0.52	<1	<2	11	<1	0.13
RMD-275	5180 Smith Cres.	29-Jul-11	0.73	<1	<2	14	<1	0.28
RMD-203	23260 Westminster Hwy.	29-Jul-11	0.60	<1	<2	13	<1	0.26
RMD-276	22271 Cochrane Drive	29-Jul-11	0.57	<1	<2	14	<1	0.23
RMD-249	23000 Blk. Dyke Rd.	29-Jul-11	0.11	<1	2	15	<1	0.28
RMD-257	6640 Blundell Rd.	3-Aug-11	0.29	<1	<2	12	<1	0.20
RMD-258	7000 Blk. Dyke Rd.	3-Aug-11	0.39	<1	2	16	<1	0.13
RMD-268	13800 No. 3 Rd. (off Garden City)	3-Aug-11	0.45	<1	2	13	<1	0.15
RMD-259	10020 Amethyst Ave.	3-Aug-11	0.49	<1	<2	12	<1	0.17
RMD-266	9380 General Currie Rd.	3-Aug-11	0.49	<1	<2	11	<1	0.18
RMD-260	11111 Horseshoe Way	3-Aug-11	0.48	<1	<2	13	<1	0.14
RMD-261	9911 Sidaway Rd.	3-Aug-11	0.54	<1	<2	13	<1	0.14
RMD-262	13799 Commerce Pkwy.	3-Aug-11	0.49	<1	<2	12	<1	0.12
RMD-263	12560 Cambie Rd.	3-Aug-11	0.42	<1	<2	12	<1	0.17
RMD-264	13100 Mitchell Rd.	3-Aug-11	0.40	<1	<2	12	<1	0.19
RMD-277	Opp. 11280 Twigg Place	3-Aug-11	0.14	<1	36	19	<1	0.14

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-278	6651 Fraserwood Place	3-Aug-11	0.29	<1	2	15	<1	0.24
RMD-279	Opp. 20371 Westminster Hwy.	3-Aug-11	0.29	<1	2	14	<1	0.21
RMD-204	3180 Granville Ave.	5-Aug-11	0.49	<1	<2	12	<1	0.14
RMD-206	4251 Moncton St.	5-Aug-11	0.54	<1	<2	11	<1	0.39
RMD-216	11080 No. 2 Rd.	5-Aug-11	0.55	<1	<2	11	<1	0.14
RMD-212	Opp. 8600 Riyan Rd.	5-Aug-11	0.59	<1	<2	12	<1	0.13
RMD-208	13200 No. 4 Rd.	5-Aug-11	0.56	<1	<2	11	<1	0.11
RMD-205	13851 Steveston Hwy.	5-Aug-11	0.64	<1	<2	11	<1	0.16
RMD-214	11720 Westminster Hwy.	5-Aug-11	0.65	<1	<2	10	<1	0.12
RMD-202	1500 Valemont Way	5-Aug-11	0.67	<1	<2	12	<1	0.09
RMD-267	17240 Fedoruk	5-Aug-11	0.65	<1	<2	13	<1	0.11
RMD-249	23000 Blk. Dyke Rd.	5-Aug-11	0.08	<1	<2	15	<1	0.19
RMD-276	22271 Cochrane Drive	5-Aug-11	0.44	<1	<2	12	<1	0.28
RMD-275	5180 Smith Cres.	5-Aug-11	0.52	<1	<2	13	<1	0.29
RMD-203	23260 Westminster Hwy.	5-Aug-11	0.47	<1	<2	12	<1	0.26
RMD-251	5951 McCallan Rd.	8-Aug-11	0.54	<1	2	13	<1	0.12
RMD-273	Opp. 8331 Fairfax Place	8-Aug-11	0.49	<1	<2	19	<1	1.20
RMD-274	10920 Springwood Court	8-Aug-11	0.57	<1	4	15	<1	0.85
RMD-252	9751 Pendleton Rd.	8-Aug-11	0.59	<1	<2	13	<1	0.16
RMD-250	6071 Azure Rd.	8-Aug-11	0.58	<1	2	13	<1	0.18
RMD-271	3800 Cessna Drive	8-Aug-11	0.57	<1	<2	15	<1	0.10
RMD-272	751 Catalina Cres.	8-Aug-11	0.56	<1	2	13	<1	0.12
RMD-255	6000 Blk. Miller Rd.	8-Aug-11	0.60	<1	<2	12	<1	0.26
RMD-256	1000 Blk. McDonald Rd.	8-Aug-11	0.50	<1	<2	14	<1	0.15
RMD-254	5300 No. 3 Rd.	8-Aug-11	0.52	<1	<2	12	<1	0.13
RMD-270	8200 Jones Rd.	8-Aug-11	0.59	<1	<2	14	<1	0.10
RMD-269	14951 Triangle Rd.	8-Aug-11	0.69	<1	<2	13	<1	0.13
RMD-253	11051 No 3 Rd.	8-Aug-11	0.59	<1	<2	13	<1	0.11
RMD-257	6640 Blundell Rd.	10-Aug-11	0.61	<1	<2	11	<1	0.12
RMD-258	7000 Blk. Dyke Rd.	10-Aug-11	0.60	<1	<2	15	<1	0.10
RMD-268	13800 No. 3 Rd. (off Garden City)	10-Aug-11	0.57	<1	<2	14	<1	0.10
RMD-259	10020 Amethyst Ave.	10-Aug-11	0.60	<1	<2	13	<1	0.10
RMD-266	9380 General Currie Rd.	10-Aug-11	0.56	<1	<2	14	<1	0.11
RMD-260	11111 Horseshoe Way	10-Aug-11	0.61	<1	<2	14	<1	0.10
RMD-261	9911 Sidaway Rd.	10-Aug-11	0.59	<1	<2	14	<1	0.10
RMD-264	13100 Mitchell Rd.	10-Aug-11	0.59	<1	6	14	<1	0.13
RMD-277	Opp. 11280 Twigg Place	10-Aug-11	0.23	<1	34	19	<1	0.11
RMD-263	12560 Cambie Rd.	10-Aug-11	0.61	<1	<2	13	<1	0.11
RMD-262	13799 Commerce Pkwy.	10-Aug-11	0.60	<1	<2	13	<1	0.09
RMD-279	Opp. 20371 Westminster Hwy.	10-Aug-11	0.26	<1	2	15	<1	0.22



Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-278	6651 Fraserwood Place	10-Aug-11	0.10	<1	100	16	<1	0.34
RMD-204	3180 Granville Ave.	12-Aug-11	0.19	<1	<2	13	<1	0.15
RMD-206	4251 Moncton St.	12-Aug-11	0.49	<1	<2	13	<1	0.19
RMD-216	11080 No. 2 Rd.	12-Aug-11	0.47	<1	<2	13	<1	0.14
RMD-212	Opp. 8600 Riyan Rd.	12-Aug-11	0.56	<1	<2	13	<1	0.15
RMD-208	13200 No. 4 Rd.	12-Aug-11	0.56	<1	<2	13	<1	0.15
RMD-205	13851 Steveston Hwy.	12-Aug-11	0.65	<1	<2	13	<1	0.11
RMD-202	1500 Valemont Way	12-Aug-11	0.61	<1	<2	15	<1	0.10
RMD-214	11720 Westminster Hwy.	12-Aug-11	0.65	<1	<2	14	<1	0.14
RMD-267	17240 Fedoruk	12-Aug-11	0.67	<1	<2	15	<1	0.14
RMD-249	23000 Blk. Dyke Rd.	12-Aug-11	0.05	<1	<2	16	<1	0.26
RMD-276	22271 Cochrane Drive	12-Aug-11	0.43	<1	<2	14	<1	0.24
RMD-275	5180 Smith Cres.	12-Aug-11	0.51	<1	190	15	<1	0.56
RMD-203	23260 Westminster Hwy.	12-Aug-11	0.48	<1	2	15	<1	0.27
RMD-251	5951 McCallan Rd.	15-Aug-11	0.57	<1	<2	13	<1	0.09
RMD-273	Opp. 8331 Fairfax Place	15-Aug-11	0.38	<1	2	19	<1	0.52
RMD-274	10920 Springwood Court	15-Aug-11	0.38	<1	42	16	<1	0.10
RMD-252	9751 Pendleton Rd.	15-Aug-11	0.50	<1	<2	14	<1	0.10
RMD-250	6071 Azure Rd.	15-Aug-11	0.56	<1	4	14	<1	0.18
RMD-271	3800 Cessna Drive	15-Aug-11	0.57	<1	2	13	<1	0.10
RMD-272	751 Catalina Cres.	15-Aug-11	0.54	<1	<2	13	<1	0.12
RMD-255	6000 Blk. Miller Rd.	15-Aug-11	0.57	<1	2	12	<1	0.27
RMD-256	1000 Blk. McDonald Rd.	15-Aug-11	0.54	<1	<2	14	<1	0.11
RMD-254	5300 No. 3 Rd.	15-Aug-11	0.54	<1	<2	12	<1	0.15
RMD-270	8200 Jones Rd.	15-Aug-11	0.48	<1	<2	15	<1	0.10
RMD-269	14951 Triangle Rd.	15-Aug-11	0.66	<1	2	14	<1	0.08
RMD-253	11051 No 3 Rd.	15-Aug-11	0.57	<1	<2	14	<1	0.13
RMD-257	6640 Blundell Rd.	17-Aug-11	0.54	<1	<2	14	<1	0.13
RMD-258	7000 Blk. Dyke Rd.	17-Aug-11	0.37	<1	<2	16	<1	0.11
RMD-268	13800 No. 3 Rd. (off Garden City)	17-Aug-11	0.51	<1	16	14	<1	0.09
RMD-259	10020 Amethyst Ave.	17-Aug-11	0.45	<1	<2	14	<1	0.12
RMD-266	9380 General Currie Rd.	17-Aug-11	0.59	<1	<2	14	<1	0.12
RMD-260	11111 Horseshoe Way	17-Aug-11	0.54	<1	<2	14	<1	0.14
RMD-261	9911 Sidaway Rd.	17-Aug-11	0.62	<1	<2	14	<1	0.09
RMD-264	13100 Mitchell Rd.	17-Aug-11	0.48	<1	<2	14	<1	0.13
RMD-277	Opp. 11280 Twigg Place	17-Aug-11	0.40	<1	2	17	<1	0.08
RMD-262	13799 Commerce Pkwy.	17-Aug-11	0.45	<1	2	14	<1	0.10
RMD-278	6651 Fraserwood Place	17-Aug-11	0.09	<1	2	15	<1	0.23
RMD-279	Opp. 20371 Westminster Hwy.	17-Aug-11	0.26	<1	<2	15	<1	0.22
RMD-263	12560 Cambie Rd.	17-Aug-11	0.49	<1	<2	14	<1	0.10

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-204	3180 Granville Ave.	19-Aug-11	0.48	<1	2	13	<1	0.12
RMD-206	4251 Moncton St.	19-Aug-11	0.54	<1	<2	13	<1	0.13
RMD-216	11080 No. 2 Rd.	19-Aug-11	0.57	<1	<2	13	<1	0.10
RMD-212	Opp. 8600 Riyan Rd.	19-Aug-11	0.57	<1	<2	13	<1	0.11
RMD-208	13200 No. 4 Rd.	19-Aug-11	0.62	<1	<2	13	<1	0.10
RMD-205	13851 Steveston Hwy.	19-Aug-11	0.62	<1	6	13	<1	0.08
RMD-214	11720 Westminster Hwy.	19-Aug-11	0.60	<1	4	12	<1	0.10
RMD-202	1500 Valemont Way	19-Aug-11	0.67	<1	2	13	<1	0.08
RMD-267	17240 Fedoruk	19-Aug-11	0.65	<1	<2	14	<1	0.09
RMD-249	23000 Blk. Dyke Rd.	19-Aug-11	0.49	<1	2	13	<1	0.22
RMD-276	22271 Cochrane Drive	19-Aug-11	0.32	<1	<2	13	<1	0.23
RMD-275	5180 Smith Cres.	19-Aug-11	0.49	<1	<2	13	<1	0.20
RMD-203	23260 Westminster Hwy.	19-Aug-11	0.62	<1	<2	13	<1	0.27
RMD-251	5951 McCallan Rd.	22-Aug-11	0.51	<1	2	12	<1	0.17
RMD-273	Opp. 8331 Fairfax Place	22-Aug-11	0.35	<1	16	20	<1	1.20
RMD-252	9751 Pendleton Rd.	22-Aug-11	0.40	<1	2	14	<1	0.19
RMD-274	10920 Springwood Court	22-Aug-11	0.34	<1	380	15	<1	0.29
RMD-253	11051 No 3 Rd.	22-Aug-11	0.47	<1	<2	12	<1	0.21
RMD-269	14951 Triangle Rd.	22-Aug-11	0.54	<1	2	13	<1	0.10
RMD-270	8200 Jones Rd.	22-Aug-11	0.39	<1	<2	14	<1	0.21
RMD-271	3800 Cessna Drive	22-Aug-11	0.46	<1	6	11	<1	0.17
RMD-272	751 Catalina Cres.	22-Aug-11	0.49	<1	<2	13	<1	0.19
RMD-255	6000 Blk. Miller Rd.	22-Aug-11	0.50	<1	8	11	<1	0.25
RMD-256	1000 Blk. McDonald Rd.	22-Aug-11	0.37	<1	2	14	<1	0.19
RMD-254	5300 No. 3 Rd.	22-Aug-11	0.46	<1	<2	12	<1	0.19
RMD-250	6071 Azure Rd.	22-Aug-11	0.41	<1	2	13	<1	0.21
RMD-263	12560 Cambie Rd.	24-Aug-11	0.60	<1	<2	13	<1	0.35
RMD-264	13100 Mitchell Rd.	24-Aug-11	0.55	<1	<2	13	<1	0.21
RMD-277	Opp. 11280 Twigg Place	24-Aug-11	0.08	<1	22	20	<1	0.11
RMD-262	13799 Commerce Pkwy.	24-Aug-11	0.71	<1	40	13	<1	0.36
RMD-278	6651 Fraserwood Place	24-Aug-11	0.08	<1	<2	15	<1	0.27
RMD-279	Opp. 20371 Westminster Hwy.	24-Aug-11	0.06	<1	6	15	<1	0.30
RMD-261	9911 Sidaway Rd.	24-Aug-11	0.14	<1	<2	15	<1	0.29
RMD-260	11111 Horseshoe Way	24-Aug-11	0.61	<1	<2	14	<1	0.31
RMD-259	10020 Amethyst Ave.	24-Aug-11	0.59	<1	2	13	<1	0.22
RMD-266	9380 General Currie Rd.	24-Aug-11	0.52	<1	<2	12	<1	0.28
RMD-268	13800 No. 3 Rd. (off Garden City)	24-Aug-11	0.44	<1	2	13	<1	0.23
RMD-258	7000 Blk. Dyke Rd.	24-Aug-11	0.52	<1	<2	14	<1	0.18
RMD-257	6640 Blundell Rd.	24-Aug-11	0.48	<1	<2	12	<1	0.27
RMD-204	3180 Granville Ave.	26-Aug-11	0.52	<1	<2	14	<1	0.18

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-206	4251 Moncton St.	26-Aug-11	0.54	<1	4	13	<1	0.23
RMD-216	11080 No. 2 Rd.	26-Aug-11	0.58	<1	<2	13	<1	0.16
RMD-212	Opp. 8600 Riyan Rd.	26-Aug-11	0.57	<1	<2	13	<1	0.17
RMD-208	13200 No. 4 Rd.	26-Aug-11	0.60	<1	<2	15	<1	0.17
RMD-205	13851 Steveston Hwy.	26-Aug-11	0.66	<1	2	15	<1	0.23
RMD-267	17240 Fedoruk	26-Aug-11	0.65	<1	<2	15	<1	0.22
RMD-214	11720 Westminster Hwy.	26-Aug-11	0.69	<1	<2	15	<1	0.21
RMD-202	1500 Valemont Way	26-Aug-11	0.67	<1	<2	13	<1	0.23
RMD-203	23260 Westminster Hwy.	26-Aug-11	0.56	<1	<2	14	<1	0.30
RMD-275	5180 Smith Cres.	26-Aug-11	0.24	<1	2	13	<1	0.30
RMD-276	22271 Cochrane Drive	26-Aug-11	0.30	<1	2	15	<1	0.28
RMD-249	23000 Blk. Dyke Rd.	26-Aug-11	0.07	<1	6	15	<1	0.23
RMD-251	5951McCallan Rd.	29-Aug-11	0.54	<1	2	15	<1	0.15
RMD-273	Opp. 8331 Fairfax Place	29-Aug-11	0.32	<1	<2	17	<1	0.16
RMD-252	9751 Pendleton Rd.	29-Aug-11	0.49	<1	<2	14	<1	0.11
RMD-274	10920 Springwood Court	29-Aug-11	0.48	<1	2	15	<1	0.15
RMD-250	6071 Azure Rd.	29-Aug-11	0.55	<1	<2	15	<1	0.16
RMD-271	3800 Cessna Drive	29-Aug-11	0.55	<1	<2	15	<1	0.12
RMD-272	751 Catalina Cres.	29-Aug-11	0.51	<1	<2	15	<1	0.15
RMD-255	6000 Blk. Miller Rd.	29-Aug-11	0.51	<1	<2	15	<1	0.19
RMD-256	1000 Blk. McDonald Rd.	29-Aug-11	0.51	<1	<2	15	<1	0.14
RMD-254	5300 No. 3 Rd.	29-Aug-11	0.56	<1	<2	14	<1	0.12
RMD-270	8200 Jones Rd.	29-Aug-11	0.42	<1	<2	15	<1	0.12
RMD-269	14951 Triangle Rd.	29-Aug-11	0.61	<1	<2	15	<1	0.14
RMD-253	11051 No 3 Rd.	29-Aug-11	0.57	<1	2	15	<1	0.12
RMD-257	6640 Blundell Rd.	31-Aug-11	0.56	<1	<2	14	<1	0.18
RMD-258	7000 Blk. Dyke Rd.	31-Aug-11	0.45	<1	<2	14	<1	0.10
RMD-268	13800 No. 3 Rd. (off Garden City)	31-Aug-11	0.47	<1	<2	14	<1	0.16
RMD-259	10020 Amethyst Ave.	31-Aug-11	0.54	<1	<2	14	<1	0.12
RMD-266	9380 General Currie Rd.	31-Aug-11	0.56	<1	2	14	<1	0.12
RMD-260	11111 Horseshoe Way	31-Aug-11	0.52	<1	2	14	<1	0.14
RMD-261	9911 Sidaway Rd.	31-Aug-11	0.49	<1	<2	14	<1	0.10
RMD-262	13799 Commerce Pkwy.	31-Aug-11	0.61	<1	6	15	<1	0.10
RMD-263	12560 Cambie Rd.	31-Aug-11	0.60	<1	<2	14	<1	0.10
RMD-264	13100 Mitchell Rd.	31-Aug-11	0.58	<1	<2	15	<1	0.11
RMD-277	Opp. 11280 Twigg Place	31-Aug-11	0.54	<1	2	16	<1	0.13
RMD-278	6651 Fraserwood Place	31-Aug-11	0.01	<1	110	15	<1	0.23
RMD-279	Opp. 20371 Westminster Hwy.	31-Aug-11	0.11	<1	16	18	<1	0.20
RMD-204	3180 Granville Ave.	2-Sep-11	0.49	<1	<2	15	<1	0.14
RMD-206	4251 Moncton St.	2-Sep-11	0.43	<1	<2	14	<1	0.17

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-216	11080 No. 2 Rd.	2-Sep-11	0.47	<1	<2	14	<1	0.17
RMD-212	Opp. 8600 Riyan Rd.	2-Sep-11	0.55	<1	<2	14	<1	0.14
RMD-208	13200 No. 4 Rd.	2-Sep-11	0.52	<1	<2	14	<1	0.11
RMD-205	13851 Steveston Hwy.	2-Sep-11	0.63	<1	<2	13	<1	0.17
RMD-214	11720 Westminster Hwy.	2-Sep-11	0.53	<1	<2	14	<1	0.12
RMD-202	1500 Valemont Way	2-Sep-11	0.45	<1	<2	15	<1	0.14
RMD-267	17240 Fedoruk	2-Sep-11	0.62	<1	2	15	<1	0.15
RMD-249	23000 Blk. Dyke Rd.	2-Sep-11	0.13	<1	<2	16	<1	0.19
RMD-276	22271 Cochrane Drive	2-Sep-11	0.19	<1	20	13	<1	0.21
RMD-275	5180 Smith Cres.	2-Sep-11	0.28	<1	6	13	<1	0.25
RMD-203	23260 Westminster Hwy.	2-Sep-11	0.36	<1	<2	13	<1	0.21
RMD-257	6640 Blundell Rd.	7-Sep-11	0.70	<1	<2	10	<1	0.37
RMD-251	5951McCallan Rd.	7-Sep-11	0.25	<1	<2	13	<1	0.37
RMD-266	9380 General Currie Rd.	7-Sep-11	0.67	<1	4	11	<1	0.25
RMD-273	Opp. 8331 Fairfax Place	7-Sep-11	0.28	<1	2	19	<1	0.26
RMD-274	10920 Springwood Court	7-Sep-11	0.38	<1	180	16	<1	0.28
RMD-263	12560 Cambie Rd.	7-Sep-11	0.65	<1	<2	12	<1	0.24
RMD-252	9751 Pendleton Rd.	7-Sep-11	0.49	<1	<2	14	<1	0.30
RMD-264	13100 Mitchell Rd.	7-Sep-11	0.54	<1	2	11	<1	0.33
RMD-250	6071 Azure Rd.	7-Sep-11	0.53	<1	4	14	<1	0.46
RMD-277	Opp. 11280 Twigg Place	7-Sep-11	0.13	<1	44	18	<1	0.16
RMD-271	3800 Cessna Drive	7-Sep-11	0.32	<1	2	16	<1	0.25
RMD-262	13799 Commerce Pkwy.	7-Sep-11	0.70	<1	2	14	<1	0.18
RMD-272	751 Catalina Cres.	7-Sep-11	0.54	<1	<2	12	<1	0.26
RMD-255	6000 Blk. Miller Rd.	7-Sep-11	0.61	<1	6	12	<1	0.38
RMD-278	6651 Fraserwood Place	7-Sep-11	0.26	<1	26	14	<1	0.30
RMD-256	1000 Blk. McDonald Rd.	7-Sep-11	<0.01	<1	28	19	<1	0.23
RMD-279	Opp. 20371 Westminster Hwy.	7-Sep-11	0.09	<1	20	15	<1	0.23
RMD-261	9911 Sidaway Rd.	7-Sep-11	0.26	<1	<2	14	<1	0.26
RMD-254	5300 No. 3 Rd.	7-Sep-11	0.64	<1	<2	12	<1	0.29
RMD-260	11111 Horseshoe Way	7-Sep-11	0.53	<1	<2	11	<1	0.28
RMD-270	8200 Jones Rd.	7-Sep-11	0.43	<1	<2	14	<1	0.30
RMD-269	14951 Triangle Rd.	7-Sep-11	0.89	<1	6	17	<1	0.40
RMD-259	10020 Amethyst Ave.	7-Sep-11	0.54	<1	4	11	<1	0.22
RMD-268	13800 No. 3 Rd. (off Garden City)	7-Sep-11	0.47	<1	<2	12	<1	0.49
RMD-253	11051 No 3 Rd.	7-Sep-11	0.55	<1	<2	13	<1	0.30
RMD-258	7000 Blk. Dyke Rd.	7-Sep-11	0.42	<1	4	14	<1	1.40
RMD-204	3180 Granville Ave.	9-Sep-11	0.77	<1	<2	14	<1	0.26
RMD-206	4251 Moncton St.	9-Sep-11	0.64	<1	<2	15	<1	0.32
RMD-216	11080 No. 2 Rd.	9-Sep-11	0.84	<1	<2	13	<1	0.25

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-212	Opp. 8600 Riyan Rd.	9-Sep-11	0.87	<1	<2	13	<1	0.26
RMD-208	13200 No. 4 Rd.	9-Sep-11	0.84	<1	<2	13	<1	0.28
RMD-205	13851 Steveston Hwy.	9-Sep-11	0.64	<1	4	17	<1	0.09
RMD-202	1500 Valemont Way	9-Sep-11	0.64	<1	<2	17	<1	0.11
RMD-214	11720 Westminster Hwy.	9-Sep-11	0.99	<1	<2	11	<1	0.28
RMD-267	17240 Fedoruk	9-Sep-11	0.62	<1	<2	17	<1	0.09
RMD-249	23000 Blk. Dyke Rd.	9-Sep-11	0.52	<1	<2	14	<1	0.22
RMD-276	22271 Cochrane Drive	9-Sep-11	0.26	<1	<2	15	<1	0.19
RMD-275	5180 Smith Cres.	9-Sep-11	0.37	<1	<2	16	<1	0.26
RMD-203	23260 Westminster Hwy.	9-Sep-11	0.48	<1	<2	15	<1	0.15
RMD-251	5951McCallan Rd.	12-Sep-11	0.90	<1	8	11	<1	0.31
RMD-273	Opp. 8331 Fairfax Place	12-Sep-11	0.57	<1	<2	18	<1	0.27
RMD-252	9751 Pendleton Rd.	12-Sep-11	0.74	<1	<2	15	<1	0.24
RMD-274	10920 Springwood Court	12-Sep-11	0.69	<1	<2	15	<1	0.34
RMD-250	6071 Azure Rd.	12-Sep-11	0.81	<1	<2	15	<1	0.32
RMD-271	3800 Cessna Drive	12-Sep-11	1.0	<1	<2	15	<1	0.33
RMD-272	751 Catalina Cres.	12-Sep-11	0.89	<1	2	14	<1	0.33
RMD-255	6000 Blk. Miller Rd.	12-Sep-11	0.9	<1	<2	12	<1	0.34
RMD-256	1000 Blk. McDonald Rd.	12-Sep-11	0.7	<1	<2	12	<1	0.38
RMD-254	5300 No. 3 Rd.	12-Sep-11	0.88	<1	<2	13	<1	0.35
RMD-270	8200 Jones Rd.	12-Sep-11	0.69	<1	2	12	<1	0.29
RMD-269	14951 Triangle Rd.	12-Sep-11	0.1	<1	480	15	<1	1.10
RMD-253	11051 No 3 Rd.	12-Sep-11	0.98	<1	<2	13	<1	0.30
RMD-257	6640 Blundell Rd.	14-Sep-11	0.91	<1	2	11	<1	0.31
RMD-258	7000 Blk. Dyke Rd.	14-Sep-11	0.80	<1	4	15	<1	0.38
RMD-268	13800 No. 3 Rd. (off Garden City)	14-Sep-11	0.74	<1	<2	12	<1	1.60
RMD-259	10020 Amethyst Ave.	14-Sep-11	0.92	<1	<2	13	<1	0.26
RMD-266	9380 General Currie Rd.	14-Sep-11	1.0	<1	<2	12	<1	0.29
RMD-260	11111 Horseshoe Way	14-Sep-11	0.9	<1	<2	13	<1	0.30
RMD-261	9911 Sidaway Rd.	14-Sep-11	0.74	<1	<2	15	<1	0.29
RMD-262	13799 Commerce Pkwy.	14-Sep-11	0.63	<1	2	17	<1	0.16
RMD-263	12560 Cambie Rd.	14-Sep-11	0.82	<1	<2	14	<1	0.22
RMD-264	13100 Mitchell Rd.	14-Sep-11	0.87	<1	4	13	<1	0.29
RMD-277	Opp. 11280 Twigg Place	14-Sep-11	0.83	<1	<2	14	<1	0.32
RMD-278	6651 Fraserwood Place	14-Sep-11	0.43	<1	<2	16	<1	0.25
RMD-279	Opp. 20371 Westminster Hwy.	14-Sep-11	0.25	<1	<2	16	<1	0.23
RMD-204	3180 Granville Ave.	16-Sep-11	0.75	<1	<2	12	<1	0.37
RMD-206	4251 Moncton St.	16-Sep-11	0.72	<1	<2	11	<1	0.27
RMD-216	11080 No. 2 Rd.	16-Sep-11	0.74	<1	<2	12	<1	0.22
RMD-212	Opp. 8600 Riyan Rd.	16-Sep-11	0.82	<1	<2	13	<1	0.25

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-208	13200 No. 4 Rd.	16-Sep-11	0.70	<1	<2	13	<1	0.22
RMD-205	13851 Steveston Hwy.	16-Sep-11	0.68	<1	<2	15	<1	0.10
RMD-214	11720 Westminster Hwy.	16-Sep-11	0.94	<1	<2	10	<1	0.21
RMD-202	1500 Valemont Way	16-Sep-11	0.67	<1	<2	15	<1	0.12
RMD-267	17240 Fedoruk	16-Sep-11	0.33	<1	<2	16	<1	0.14
RMD-249	23000 Blk. Dyke Rd.	16-Sep-11	0.44	<1	<2	15	<1	0.23
RMD-276	22271 Cochrane Drive	16-Sep-11	0.18	<1	<2	14	<1	0.23
RMD-275	5180 Smith Cres.	16-Sep-11	0.28	<1	<2	13	<1	0.26
RMD-203	23260 Westminster Hwy.	16-Sep-11	0.39	<1	<2	14	<1	0.22
RMD-251	5951 McCallan Rd.	19-Sep-11	1.0	<1	<2	13	<1	0.20
RMD-273	Opp. 8331 Fairfax Place	19-Sep-11	0.57	<1	6	19	<1	0.19
RMD-274	10920 Springwood Court	19-Sep-11	0.70	<1	<2	14	<1	0.50
RMD-252	9751 Pendleton Rd.	19-Sep-11	0.69	<1	<2	14	<1	0.22
RMD-250	6071 Azure Rd.	19-Sep-11	0.85	<1	2	14	<1	0.24
RMD-271	3800 Cessna Drive	19-Sep-11	0.77	<1	<2	13	<1	0.36
RMD-272	751 Catalina Cres.	19-Sep-11	0.80	<1	<2	14	<1	0.53
RMD-255	6000 Blk. Miller Rd.	19-Sep-11	0.84	<1	4	11	<1	0.29
RMD-256	1000 Blk. McDonald Rd.	19-Sep-11	0.51	<1	2	14	<1	0.26
RMD-254	5300 No. 3 Rd.	19-Sep-11	0.64	<1	<2	12	<1	0.27
RMD-270	8200 Jones Rd.	19-Sep-11	0.79	<1	<2	15	<1	0.20
RMD-269	14951 Triangle Rd.	19-Sep-11	0.68	<1	<2	15	<1	0.78
RMD-253	11051 No 3 Rd.	19-Sep-11	0.95	<1	96	12	<1	0.21
RMD-257	6640 Blundell Rd.	21-Sep-11	0.51	<1	<2	13	<1	0.19
RMD-258	7000 Blk. Dyke Rd.	21-Sep-11	0.84	<1	<2	14	<1	0.16
RMD-268	13800 No. 3 Rd. (off Garden City)	21-Sep-11	0.79	<1	<2	14	<1	0.22
RMD-259	10020 Amethyst Ave.	21-Sep-11	0.87	<1	<2	14	<1	0.19
RMD-266	9380 General Currie Rd.	21-Sep-11	0.89	<1	<2	13	<1	0.19
RMD-260	11111 Horseshoe Way	21-Sep-11	0.42	<1	<2	15	<1	0.23
RMD-261	9911 Sidaway Rd.	21-Sep-11	0.64	<1	<2	17	<1	0.14
RMD-262	13799 Commerce Pkwy.	21-Sep-11	0.66	<1	<2	15	<1	0.16
RMD-263	12560 Cambie Rd.	21-Sep-11	0.70	<1	<2	15	<1	0.15
RMD-264	13100 Mitchell Rd.	21-Sep-11	0.97	<1	2	15	<1	0.17
RMD-277	Opp. 11280 Twigg Place	21-Sep-11	0.95	<1	<2	15	<1	0.21
RMD-279	Opp. 20371 Westminster Hwy.	21-Sep-11	0.19	<1	<2	15	<1	0.22
RMD-278	6651 Fraserwood Place	21-Sep-11	0.19	<1	<2	15	<1	0.27
RMD-204	3180 Granville Ave.	23-Sep-11	0.79	<1	<2	14	<1	0.18
RMD-206	4251 Moncton St.	23-Sep-11	0.73	<1	<2	14	<1	0.17
RMD-216	11080 No. 2 Rd.	23-Sep-11	0.82	<1	2	14	<1	0.17
RMD-212	Opp. 8600 Riyan Rd.	23-Sep-11	0.88	<1	<2	14	<1	0.18
RMD-208	13200 No. 4 Rd.	23-Sep-11	0.89	<1	<2	14	<1	0.22

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-205	13851 Steveston Hwy.	23-Sep-11	0.66	<1	<2	16	<1	0.19
RMD-202	1500 Valemont Way	23-Sep-11	0.61	<1	<2	16	<1	0.12
RMD-214	11720 Westminster Hwy.	23-Sep-11	0.89	<1	<2	12	<1	0.20
RMD-267	17240 Fedoruk	23-Sep-11	0.47	<1	<2	16	<1	0.15
RMD-249	23000 Blk. Dyke Rd.	23-Sep-11	0.37	<1	2	14	<1	0.28
RMD-276	22271 Cochrane Drive	23-Sep-11	0.30	<1	<2	14	<1	0.25
RMD-275	5180 Smith Cres.	23-Sep-11	0.30	<1	2	14	<1	0.21
RMD-203	23260 Westminster Hwy.	23-Sep-11	0.30	<1	4	14	<1	0.21
RMD-251	5951 McCallan Rd.	26-Sep-11	0.88	<1	2	13	<1	0.22
RMD-273	Opp. 8331 Fairfax Place	26-Sep-11	0.63	<1	<2	18	<1	0.34
RMD-252	9751 Pendleton Rd.	26-Sep-11	0.88	<1	2	14	<1	0.22
RMD-274	10920 Springwood Court	26-Sep-11	0.74	<1	<2	14	<1	0.20
RMD-253	11051 No 3 Rd.	26-Sep-11	0.87	<1	<2	13	<1	0.19
RMD-270	8200 Jones Rd.	26-Sep-11	0.76	<1	<2	14	<1	0.18
RMD-254	5300 No. 3 Rd.	26-Sep-11	0.87	<1	<2	13	<1	0.22
RMD-271	3800 Cessna Drive	26-Sep-11	0.85	<1	<2	14	<1	0.20
RMD-272	751 Catalina Cres.	26-Sep-11	0.92	<1	<2	13	<1	0.19
RMD-255	6000 Blk. Miller Rd.	26-Sep-11	1.2	<1	<2	13	<1	0.29
RMD-256	1000 Blk. McDonald Rd.	26-Sep-11	0.83	<1	<2	14	<1	0.23
RMD-250	6071 Azure Rd.	26-Sep-11	0.90	<1	<2	14	<1	0.20
RMD-269	14951 Triangle Rd.	28-Sep-11	0.30	<1	<2	15	<1	[No turbidity bottle received.] NA
RMD-257	6640 Blundell Rd.	28-Sep-11	0.93	<1	<2	14	<1	0.32
RMD-266	9380 General Currie Rd.	28-Sep-11	0.68	<1	<2	14	<1	0.19
RMD-263	12560 Cambie Rd.	28-Sep-11	0.75	<1	<2	15	<1	0.24
RMD-264	13100 Mitchell Rd.	28-Sep-11	0.87	<1	<2	15	<1	0.17
RMD-277	Opp. 11280 Twigg Place	28-Sep-11	0.85	<1	<2	15	<1	0.21
RMD-262	13799 Commerce Pkwy.	28-Sep-11	0.62	<1	<2	15	<1	0.27
RMD-278	6651 Fraserwood Place	28-Sep-11	0.07	<1	<2	15	<1	0.34
RMD-279	Opp. 20371 Westminster Hwy.	28-Sep-11	0.04	<1	4	15	<1	0.29
RMD-261	9911 Sidaway Rd.	28-Sep-11	0.45	<1	<2	15	<1	0.25
RMD-260	11111 Horseshoe Way	28-Sep-11	0.62	<1	<2	15	<1	0.24
RMD-259	10020 Amethyst Ave.	28-Sep-11	0.81	<1	<2	15	<1	0.16
RMD-268	13800 No. 3 Rd. (off Garden City)	28-Sep-11	0.79	<1	2	15	<1	0.14
RMD-258	7000 Blk. Dyke Rd.	28-Sep-11	0.87	<1	2	15	<1	0.14
RMD-204	3180 Granville Ave.	30-Sep-11	0.68	<1	<2	15	<1	0.18
RMD-206	4251 Moncton St.	30-Sep-11	0.76	<1	<2	15	<1	0.17

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mls	HPC CFU/mls	Temperature °C	Total Coliform MF/100mls	Turbidity NTU
RMD-216	11080 No. 2 Rd.	30-Sep-11	0.57	<1	<2	14	<1	0.21
RMD-212	Opp. 8600 Riyan Rd.	30-Sep-11	0.58	<1	<2	15	<1	0.23
RMD-208	13200 No. 4 Rd.	30-Sep-11	0.57	<1	<2	14	<1	0.22
RMD-205	13851 Steveston Hwy.	30-Sep-11	0.71	<1	<2	15	<1	0.26
RMD-202	1500 Valemont Way	30-Sep-11	0.66	<1	<2	15	<1	0.30
RMD-214	11720 Westminster Hwy.	30-Sep-11	0.65	<1	<2	14	<1	0.24
RMD-267	17240 Fedoruk	30-Sep-11	0.36	<1	<2	15	<1	0.24
RMD-249	23000 Blk. Dyke Rd.	30-Sep-11	0.23	<1	<2	13	<1	0.36
RMD-276	22271 Cochrane Drive	30-Sep-11	0.08	<1	46	15	<1	0.29
RMD-275	5180 Smith Cres.	30-Sep-11	0.17	<1	42	15	<1	0.29
RMD-203	23260 Westminster Hwy.	30-Sep-11	0.22	<1	2	13	<1	0.41
RMD-251	5951 McCallan Rd.	3-Oct-11	0.47	<1	<2	14	<1	0.18
RMD-273	Opp. 8331 Fairfax Place	3-Oct-11	0.42	<1	2	17	<1	1.20
RMD-274	10920 Springwood Court	3-Oct-11	0.35	<1	<2	16	<1	0.17
RMD-252	9751 Pendleton Rd.	3-Oct-11	0.53	<1	<2	14	<1	0.18
RMD-250	6071 Azure Rd.	3-Oct-11	0.56	<1	<2	14	<1	0.16
RMD-271	3800 Cessna Drive	3-Oct-11	0.55	<1	4	14	<1	0.22
RMD-272	751 Catalina Cres.	3-Oct-11	0.45	<1	<2	14	<1	0.24
RMD-255	6000 Blk. Miller Rd.	3-Oct-11	0.54	<1	6	13	<1	0.24
RMD-256	1000 Blk. McDonald Rd.	3-Oct-11	0.52	<1	<2	14	<1	0.22
RMD-254	5300 No. 3 Rd.	3-Oct-11	0.54	<1	2	13	<1	0.22
RMD-270	8200 Jones Rd.	3-Oct-11	0.53	<1	<2	15	<1	0.23
RMD-269	14951 Triangle Rd.	3-Oct-11	0.76	<1	<2	14	<1	0.25
RMD-253	11051 No 3 Rd.	3-Oct-11	0.56	<1	<2	13	<1	0.20
RMD-257	6640 Blundell Rd.	5-Oct-11	0.66	<1	<2	13	<1	0.17
RMD-258	7000 Blk. Dyke Rd.	5-Oct-11	0.57	<1	4	14	<1	0.25
RMD-268	13800 No. 3 Rd. (off Garden City)	5-Oct-11	0.54	<1	<2	14	<1	0.16
RMD-259	10020 Amethyst Ave.	5-Oct-11	0.58	<1	<2	13	<1	0.16
RMD-266	9380 General Currie Rd.	5-Oct-11	0.63	<1	<2	13	<1	0.20
RMD-260	11111 Horseshoe Way	5-Oct-11	0.72	<1	<2	13	<1	0.26
RMD-261	9911 Sidaway Rd.	5-Oct-11	0.80	<1	<2	13	<1	0.30
RMD-264	13100 Mitchell Rd.	5-Oct-11	0.58	<1	<2	15	<1	0.22
RMD-277	Opp. 11280 Twigg Place	5-Oct-11	0.58	<1	<2	13	<1	0.26
RMD-263	12560 Cambie Rd.	5-Oct-11	0.59	<1	2	14	<1	0.21
RMD-262	13799 Commerce Pkwy.	5-Oct-11	0.70	<1	<2	13	<1	0.29
RMD-278	6651 Fraserwood Place	5-Oct-11	0.09	<1	<2	14	<1	0.33
RMD-279	Opp. 20371 Westminster Hwy.	5-Oct-11	0.08	<1	2	14	<1	0.43
RMD-204	3180 Granville Ave.	7-Oct-11	0.49	<1	2	13	<1	0.23
RMD-206	4251 Moncton St.	7-Oct-11	0.52	<1	<2	13	<1	0.17
RMD-216	11080 No. 2 Rd.	7-Oct-11	0.61	<1	<2	13	<1	0.18



Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-212	Opp. 8600 Riyan Rd.	7-Oct-11	0.53	<1	4	13	<1	0.20
RMD-208	13200 No. 4 Rd.	7-Oct-11	0.60	<1	2	13	<1	0.15
RMD-205	13851 Steveston Hwy.	7-Oct-11	0.88	<1	2	13	<1	0.26
RMD-202	1500 Valemont Way	7-Oct-11	0.58	<1	2	13	<1	0.25
RMD-214	11720 Westminster Hwy.	7-Oct-11	0.66	<1	<2	13	<1	0.19
RMD-267	17240 Fedoruk	7-Oct-11	0.13	<1	8	14	<1	0.29
RMD-249	23000 Blk. Dyke Rd.	7-Oct-11	0.25	<1	2	14	<1	0.33
RMD-276	22271 Cochrane Drive	7-Oct-11	0.10	<1	52	14	<1	0.26
RMD-275	5180 Smith Cres.	7-Oct-11	0.20	<1	2	14	<1	0.33
RMD-203	23260 Westminster Hwy.	7-Oct-11	0.26	<1	<2	13	<1	0.39
RMD-257	6640 Blundell Rd.	12-Oct-11	0.77	<1	<2	11	<1	0.24
RMD-258	7000 Blk. Dyke Rd.	12-Oct-11	0.64	<1	<2	13	<1	0.35
RMD-268	13800 No. 3 Rd. (off Garden City)	12-Oct-11	0.6	<1	<2	12	<1	0.17
RMD-259	10020 Amethyst Ave.	12-Oct-11	0.63	<1	<2	12	<1	0.16
RMD-266	9380 General Currie Rd.	12-Oct-11	0.73	<1	<2	12	<1	0.17
RMD-260	11111 Horseshoe Way	12-Oct-11	0.69	<1	<2	12	<1	0.31
RMD-261	9911 Sidaway Rd.	12-Oct-11	0.69	<1	<2	11	<1	0.23
RMD-264	13100 Mitchell Rd.	12-Oct-11	0.68	<1	<2	13	<1	0.19
RMD-277	Opp. 11280 Twigg Place	12-Oct-11	0.61	<1	<2	13	<1	0.21
RMD-263	12560 Cambie Rd.	12-Oct-11	0.53	<1	<2	13	<1	0.19
RMD-262	13799 Commerce Pkwy.	12-Oct-11	0.60	<1	<2	12	<1	0.24
RMD-278	6651 Fraserwood Place	12-Oct-11	0.20	<1	<2	11	<1	0.45
RMD-279	Opp. 20371 Westminster Hwy.	12-Oct-11	0.08	<1	<2	11	<1	0.45
RMD-204	3180 Granville Ave.	14-Oct-11	0.52	<1	<2	12	<1	0.17
RMD-206	4251 Moncton St.	14-Oct-11	0.57	<1	<2	13	<1	0.13
RMD-216	11080 No. 2 Rd.	14-Oct-11	0.80	<1	<2	12	<1	0.23
RMD-212	Opp. 8600 Riyan Rd.	14-Oct-11	0.74	<1	<2	12	<1	0.26
RMD-208	13200 No. 4 Rd.	14-Oct-11	0.82	<1	<2	11	<1	0.17
RMD-205	13851 Steveston Hwy.	14-Oct-11	0.74	<1	<2	11	<1	0.22
RMD-214	11720 Westminster Hwy.	14-Oct-11	0.57	<1	<2	11	<1	0.17
RMD-202	1500 Valemont Way	14-Oct-11	0.40	<1	<2	12	<1	0.21
RMD-267	17240 Fedoruk	14-Oct-11	0.13	<1	2	12	<1	0.21
RMD-249	23000 Blk. Dyke Rd.	14-Oct-11	0.25	<1	<2	12	<1	0.28
RMD-276	22271 Cochrane Drive	14-Oct-11	0.08	<1	6	13	<1	0.28
RMD-275	5180 Smith Cres.	14-Oct-11	0.13	<1	4	[Not taken] NA	<1	0.33
RMD-203	23260 Westminster Hwy.	14-Oct-11	0.28	<1	<2	12	<1	0.32
RMD-251	5951 McCallan Rd.	17-Oct-11	0.76	<1	<2	12	<1	0.17
RMD-273	Opp. 8331 Fairfax Place	17-Oct-11	0.52	<1	<2	14	<1	0.13

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-252	9751 Pendleton Rd.	17-Oct-11	0.57	<1	<2	13	<1	0.16
RMD-274	10920 Springwood Court	17-Oct-11	0.41	<1	46	14	<1	0.13
RMD-253	11051 No 3 Rd.	17-Oct-11	0.69	<1	<2	12	<1	0.19
RMD-269	14951 Triangle Rd.	17-Oct-11	0.77	<1	2	11	<1	0.25
RMD-270	8200 Jones Rd.	17-Oct-11	0.62	<1	<2	12	<1	0.18
RMD-254	5300 No. 3 Rd.	17-Oct-11	0.84	<1	<2	11	<1	0.17
RMD-271	3800 Cessna Drive	17-Oct-11	0.75	<1	<2	12	<1	0.14
RMD-272	751 Catalina Cres.	17-Oct-11	0.61	<1	2	12	<1	0.15
RMD-255	6000 Blk. Miller Rd.	17-Oct-11	0.8	<1	2	11	<1	0.25
RMD-256	1000 Blk. McDonald Rd.	17-Oct-11	0.41	<1	<2	12	<1	0.21
RMD-250	6071 Azure Rd.	17-Oct-11	0.68	<1	2	12	<1	0.14
RMD-263	12560 Cambie Rd.	19-Oct-11	0.52	<1	<2	11	<1	0.20
RMD-264	13100 Mitchell Rd.	19-Oct-11	0.29	<1	<2	12	<1	0.22
RMD-277	Opp. 11280 Twigg Place	19-Oct-11	0.38	<1	2	15	<1	0.15
RMD-262	13799 Commerce Pkwy.	19-Oct-11	0.58	<1	<2	12	<1	0.23
RMD-278	6651 Fraserwood Place	19-Oct-11	0.19	<1	4	13	<1	0.31
RMD-261	9911 Sidaway Rd.	19-Oct-11	0.69	<1	<2	12	<1	0.44
RMD-260	11111 Horseshoe Way	19-Oct-11	0.72	<1	<2	12	<1	0.19
RMD-259	10020 Amethyst Ave.	19-Oct-11	0.73	<1	<2	12	<1	0.21
RMD-266	9380 General Currie Rd.	19-Oct-11	0.77	<1	<2	11	<1	0.17
RMD-268	13800 No. 3 Rd. (off Garden City)	19-Oct-11	0.66	<1	<2	12	<1	0.31
RMD-258	7000 Blk. Dyke Rd.	19-Oct-11	0.64	<1	2	12	<1	0.16
RMD-257	6640 Blundell Rd.	19-Oct-11	0.74	<1	<2	11	<1	0.18
RMD-279	Opp. 20371 Westminster Hwy.	20-Oct-11	0.50	<1	2	11	<1	0.28
RMD-204	3180 Granville Ave.	21-Oct-11	0.70	<1	4	15	<1	0.14
RMD-206	4251 Moncton St.	21-Oct-11	0.58	<1	<2	15	<1	0.17
RMD-216	11080 No. 2 Rd.	21-Oct-11	0.56	<1	<2	15	<1	0.20
RMD-212	Opp. 8600 Riyan Rd.	21-Oct-11	0.73	<1	<2	14	<1	0.18
RMD-208	13200 No. 4 Rd.	21-Oct-11	0.8	<1	<2	14	<1	0.15
RMD-205	13851 Steveston Hwy.	21-Oct-11	0.75	<1	<2	14	<1	0.24
RMD-214	11720 Westminster Hwy.	21-Oct-11	0.76	<1	2	14	<1	0.18
RMD-202	1500 Valemont Way	21-Oct-11	0.50	<1	2	15	<1	0.31
RMD-267	17240 Fedoruk	21-Oct-11	0.46	<1	<2	15	<1	0.19
RMD-249	23000 Blk. Dyke Rd.	21-Oct-11	0.33	<1	2	14	<1	0.34
RMD-275	5180 Smith Cres.	21-Oct-11	0.28	<1	<2	15	<1	0.27
RMD-276	22271 Cochrane Drive	21-Oct-11	0.22	<1	<2	15	<1	0.25
RMD-203	23260 Westminster Hwy.	21-Oct-11	0.33	<1	<2	15	<1	0.33
RMD-251	5951 McCallan Rd.	24-Oct-11	0.40	<1	8	12	9	0.22
RMD-273	Opp. 8331 Fairfax Place	24-Oct-11	0.62	<1	<2	15	<1	0.13
RMD-274	10920 Springwood Court	24-Oct-11	0.45	<1	<2	14	<1	0.16

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-252	9751 Pendleton Rd.	24-Oct-11	0.61	<1	<2	12	<1	0.14
RMD-250	6071 Azure Rd.	24-Oct-11	0.69	<1	<2	12	<1	0.23
RMD-271	3800 Cessna Drive	24-Oct-11	0.81	<1	<2	11	<1	0.13
RMD-272	751 Catalina Cres.	24-Oct-11	0.61	<1	<2	12	<1	0.19
RMD-255	6000 Blk. Miller Rd.	24-Oct-11	0.58	<1	<2	11	<1	0.24
RMD-256	1000 Blk. McDonald Rd.	24-Oct-11	0.64	<1	<2	13	<1	0.18
RMD-254	5300 No. 3 Rd.	24-Oct-11	0.79	<1	<2	11	<1	2.60
RMD-270	8200 Jones Rd.	24-Oct-11	0.65	<1	<2	12	<1	0.18
RMD-269	14951 Triangle Rd.	24-Oct-11	0.69	<1	2	12	<1	0.30
RMD-253	11051 No 3 Rd.	24-Oct-11	0.76	<1	4	11	<1	0.18
RMD-257	6640 Blundell Rd.	26-Oct-11	0.79	<1	<2	11	<1	0.15
RMD-258	7000 Blk. Dyke Rd.	26-Oct-11	0.68	<1	<2	11	<1	0.18
RMD-268	13800 No. 3 Rd. (off Garden City)	26-Oct-11	0.64	<1	<2	11	<1	0.17
RMD-259	10020 Amethyst Ave.	26-Oct-11	0.83	<1	<2	11	<1	0.17
RMD-266	9380 General Currie Rd.	26-Oct-11	0.84	<1	<2	10	<1	0.17
RMD-261	9911 Sidaway Rd.	26-Oct-11	0.74	<1	<2	11	<1	0.22
RMD-260	11111 Horseshoe Way	26-Oct-11	0.76	<1	<2	11	<1	0.21
RMD-262	13799 Commerce Pkwy.	26-Oct-11	0.57	<1	<2	11	<1	0.21
RMD-264	13100 Mitchell Rd.	26-Oct-11	0.62	<1	<2	11	<1	0.14
RMD-277	Opp. 11280 Twigg Place	26-Oct-11	0.84	<1	<2	11	<1	0.17
RMD-263	12560 Cambie Rd.	26-Oct-11	0.68	<1	2	11	<1	0.20
RMD-279	Opp. 20371 Westminster Hwy.	26-Oct-11	0.16	<1	<2	11	<1	0.51
RMD-278	6651 Fraserwood Place	26-Oct-11	0.05	<1	14	12	<1	0.32
RMD-204	3180 Granville Ave.	28-Oct-11	0.70	<1	<2	11	<1	0.12
RMD-206	4251 Moncton St.	28-Oct-11	0.59	<1	<2	12	<1	0.13
RMD-216	11080 No. 2 Rd.	28-Oct-11	0.60	<1	10	11	<1	0.17
RMD-212	Opp. 8600 Riyan Rd.	28-Oct-11	0.74	<1	2	11	<1	0.16
RMD-208	13200 No. 4 Rd.	28-Oct-11	0.68	<1	4	10	<1	0.15
RMD-205	13851 Steveston Hwy.	28-Oct-11	0.69	<1	2	10	<1	0.22
RMD-202	1500 Valemont Way	28-Oct-11	0.42	<1	<2	11	<1	0.24
RMD-214	11720 Westminster Hwy.	28-Oct-11	0.84	<1	<2	10	<1	0.16
RMD-267	17240 Fedoruk	28-Oct-11	0.18	<1	2	11	<1	0.24
RMD-249	23000 Blk. Dyke Rd.	28-Oct-11	0.24	<1	2	11	<1	0.28
RMD-276	22271 Cochrane Drive	28-Oct-11	0.19	<1	24	11	<1	0.25
RMD-275	5180 Smith Cres.	28-Oct-11	0.30	<1	<2	11	<1	0.24
RMD-203	23260 Westminster Hwy.	28-Oct-11	0.38	<1	<2	11	<1	0.27
RMD-251	5951 McCallan Rd.	31-Oct-11	0.80	<1	<2	10	<1	0.13
RMD-273	Opp. 8331 Fairfax Place	31-Oct-11	0.60	<1	4	13	<1	0.11
RMD-274	10920 Springwood Court	31-Oct-11	0.61	<1	<2	13	<1	0.14
RMD-252	9751 Pendleton Rd.	31-Oct-11	0.60	<1	<2	11	<1	0.13

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-250	6071 Azure Rd.	31-Oct-11	0.75	<1	<2	11	<1	0.13
RMD-271	3800 Cessna Drive	31-Oct-11	0.79	<1	2	11	<1	0.15
RMD-272	751 Catalina Cres.	31-Oct-11	0.59	<1	<2	10	<1	0.15
RMD-255	6000 Blk. Miller Rd.	31-Oct-11	0.67	<1	<2	10	<1	0.15
RMD-256	1000 Blk. McDonald Rd.	31-Oct-11	0.69	<1	<2	10	<1	0.15
RMD-254	5300 No. 3 Rd.	31-Oct-11	0.74	<1	<2	10	<1	0.15
RMD-270	8200 Jones Rd.	31-Oct-11	0.65	<1	6	10	<1	0.13
RMD-269	14951 Triangle Rd.	31-Oct-11	0.80	<1	<2	11	<1	0.16
RMD-253	11051 No 3 Rd.	31-Oct-11	0.74	<1	<2	10	<1	0.14
RMD-257	6640 Blundell Rd.	2-Nov-11	0.64	<1	<2	10	<1	0.13
RMD-266	9380 General Currie Rd.	2-Nov-11	0.86	<1	<2	10	<1	0.14
RMD-263	12560 Cambie Rd.	2-Nov-11	0.59	<1	<2	10	<1	0.15
RMD-264	13100 Mitchell Rd.	2-Nov-11	0.59	<1	<2	10	<1	0.2
RMD-277	Opp. 11280 Twigg Place	2-Nov-11	0.69	<1	<2	10	<1	0.26
RMD-262	13799 Commerce Pkwy.	2-Nov-11	0.50	<1	<2	10	<1	0.17
RMD-278	6651 Fraserwood Place	2-Nov-11	0.19	<1	<2	10	<1	0.27
RMD-279	Opp. 20371 Westminster Hwy.	2-Nov-11	0.11	<1	<2	10	<1	0.31
RMD-261	9911 Sidaway Rd.	2-Nov-11	0.71	<1	<2	10	<1	0.16
RMD-260	11111 Horseshoe Way	2-Nov-11	0.69	<1	<2	10	<1	0.15
RMD-259	10020 Amethyst Ave.	2-Nov-11	0.82	<1	<2	10	<1	0.11
RMD-268	13800 No. 3 Rd. (off Garden City)	2-Nov-11	0.57	<1	<2	10	<1	0.12
RMD-258	7000 Blk. Dyke Rd.	2-Nov-11	0.65	<1	<2	10	<1	0.10
RMD-204	3180 Granville Ave.	4-Nov-11	0.65	<1	<2	10	<1	0.18
RMD-206	4251 Moncton St.	4-Nov-11	0.54	<1	2	10	<1	0.14
RMD-216	11080 No. 2 Rd.	4-Nov-11	0.63	<1	<2	10	<1	0.17
RMD-212	Opp. 8600 Riyan Rd.	4-Nov-11	0.66	<1	<2	10	<1	0.13
RMD-208	13200 No. 4 Rd.	4-Nov-11	0.70	<1	<2	9	<1	0.17
RMD-205	13851 Steveston Hwy.	4-Nov-11	0.72	<1	<2	10	<1	0.20
RMD-202	1500 Valemont Way	4-Nov-11	0.26	<1	<2	11	<1	0.33
RMD-214	11720 Westminster Hwy.	4-Nov-11	0.77	<1	<2	9	<1	0.20
RMD-267	17240 Fedoruk	4-Nov-11	0.12	<1	<2	11	<1	0.26
RMD-249	23000 Blk. Dyke Rd.	4-Nov-11	0.33	<1	<2	10	<1	0.30
RMD-276	22271 Cochrane Drive	4-Nov-11	0.13	<1	<2	11	<1	0.27
RMD-275	5180 Smith Cres.	4-Nov-11	0.22	<1	<2	10	<1	0.32
RMD-203	23260 Westminster Hwy.	4-Nov-11	0.41	<1	<2	10	<1	0.34
RMD-251	5951 McCallan Rd.	7-Nov-11	0.64	<1	2	10	<1	0.19
RMD-273	Opp. 8331 Fairfax Place	7-Nov-11	0.56	<1	<2	11	<1	0.12
RMD-252	9751 Pendleton Rd.	7-Nov-11	0.47	<1	<2	11	<1	0.13
RMD-274	10920 Springwood Court	7-Nov-11	0.59	<1	<2	12	<1	0.15
RMD-253	11051 No 3 Rd.	7-Nov-11	0.70	<1	<2	9	<1	0.13

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mls	HPC CFU/mls	Temperature °C	Total Coliform MF/100mls	Turbidity NTU
RMD-269	14951 Triangle Rd.	7-Nov-11	0.63	<1	<2	10	<1	0.32
RMD-270	8200 Jones Rd.	7-Nov-11	0.60	<1	<2	10	<1	0.15
RMD-254	5300 No. 3 Rd.	7-Nov-11	0.66	<1	<2	9	<1	0.12
RMD-272	751 Catalina Cres.	7-Nov-11	0.64	<1	<2	9	<1	0.13
RMD-271	3800 Cessna Drive	7-Nov-11	0.61	<1	2	9	<1	0.13
RMD-255	6000 Blk. Miller Rd.	7-Nov-11	0.79	<1	12	9	<1	0.45
RMD-256	1000 Blk. McDonald Rd.	7-Nov-11	0.47	<1	4	9	<1	0.14
RMD-250	6071 Azure Rd.	7-Nov-11	0.68	<1	<2	10	<1	0.15
RMD-263	12560 Cambie Rd.	9-Nov-11	0.61	<1	<2	10	<1	0.14
RMD-264	13100 Mitchell Rd.	9-Nov-11	0.52	<1	<2	10	<1	0.25
RMD-277	Opp. 11280 Twigg Place	9-Nov-11	0.55	<1	<2	10	<1	0.39
RMD-262	13799 Commerce Pkwy.	9-Nov-11	0.58	<1	<2	9	<1	0.29
RMD-278	6651 Fraserwood Place	9-Nov-11	0.23	<1	<2	11	<1	0.18
RMD-279	Opp. 20371 Westminster Hwy.	9-Nov-11	0.15	<1	<2	11	<1	0.26
RMD-261	9911 Sidaway Rd.	9-Nov-11	0.57	<1	<2	9	<1	0.19
RMD-260	11111 Horseshoe Way	9-Nov-11	0.73	<1	<2	9	<1	0.49
RMD-259	10020 Amethyst Ave.	9-Nov-11	0.75	<1	<2	10	<1	0.11
RMD-266	9380 General Currie Rd.	9-Nov-11	0.84	<1	<2	9	<1	0.11
RMD-268	13800 No. 3 Rd. (off Garden City)	9-Nov-11	0.73	<1	<2	10	<1	0.22
RMD-258	7000 Blk. Dyke Rd.	9-Nov-11	0.88	<1	2	10	<1	0.17
RMD-257	6640 Blundell Rd.	9-Nov-11	0.83	<1	<2	9	<1	0.16
RMD-251	5951McCallan Rd.	14-Nov-11	0.74	<1	<2	9	<1	0.09
RMD-273	Opp. 8331 Fairfax Place	14-Nov-11	0.68	<1	<2	11	<1	0.10
RMD-274	10920 Springwood Court	14-Nov-11	0.63	<1	18	11	<1	0.14
RMD-252	9751 Pendleton Rd.	14-Nov-11	0.77	<1	<2	10	<1	0.15
RMD-250	6071 Azure Rd.	14-Nov-11	0.76	<1	<2	9	<1	0.15
RMD-271	3800 Cessna Drive	14-Nov-11	0.72	<1	<2	9	<1	0.19
RMD-272	751 Catalina Cres.	14-Nov-11	0.86	<1	<2	9	<1	0.15
RMD-255	6000 Blk. Miller Rd.	14-Nov-11	0.78	<1	<2	9	<1	0.24
RMD-256	1000 Blk. McDonald Rd.	14-Nov-11	0.64	<1	<2	8	<1	0.12
RMD-254	5300 No. 3 Rd.	14-Nov-11	0.86	<1	<2	8	<1	0.10
RMD-253	11051 No 3 Rd.	14-Nov-11	0.82	<1	<2	8	<1	0.10
RMD-269	14951 Triangle Rd.	14-Nov-11	0.79	<1	<2	7	<1	0.18
RMD-270	8200 Jones Rd.	14-Nov-11	0.82	<1	<2	8	<1	0.11
RMD-257	6640 Blundell Rd.	16-Nov-11	0.85	<1	<2	8	<1	0.15
RMD-258	7000 Blk. Dyke Rd.	16-Nov-11	0.60	<1	<2	9	<1	0.15
RMD-268	13800 No. 3 Rd. (off Garden City)	16-Nov-11	0.74	<1	<2	9	<1	0.15
RMD-259	10020 Amethyst Ave.	16-Nov-11	0.82	<1	<2	9	<1	0.16
RMD-266	9380 General Currie Rd.	16-Nov-11	0.76	<1	<2	9	<1	0.17
RMD-260	11111 Horseshoe Way	16-Nov-11	0.73	<1	<2	9	<1	0.22

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-261	9911 Sidaway Rd.	16-Nov-11	0.73	<1	<2	9	<1	0.38
RMD-264	13100 Mitchell Rd.	16-Nov-11	0.68	<1	<2	8	<1	0.15
RMD-277	Opp. 11280 Twigg Place	16-Nov-11	0.79	<1	<2	9	<1	0.24
RMD-263	12560 Cambie Rd.	16-Nov-11	0.59	<1	<2	9	<1	0.24
RMD-262	13799 Commerce Pkwy.	16-Nov-11	0.55	<1	<2	9	<1	0.24
RMD-278	6651 Fraserwood Place	16-Nov-11	0.25	<1	10	10	<1	0.61
RMD-279	Opp. 20371 Westminster Hwy.	16-Nov-11	0.09	<1	12	10	<1	0.37
RMD-204	3180 Granville Ave.	18-Nov-11	0.66	<1	<2	9	<1	0.13
RMD-206	4251 Moncton St.	18-Nov-11	0.59	<1	<2	10	<1	0.21
RMD-216	11080 No. 2 Rd.	18-Nov-11	0.68	<1	<2	9	<1	0.14
RMD-212	Opp. 8600 Riyan Rd.	18-Nov-11	0.73	<1	2	9	<1	0.15
RMD-208	13200 No. 4 Rd.	18-Nov-11	0.68	<1	<2	10	<1	0.14
RMD-205	13851 Steveston Hwy.	18-Nov-11	0.79	<1	<2	9	<1	0.19
RMD-202	1500 Valemont Way	18-Nov-11	0.21	<1	4	10	<1	0.27
RMD-214	11720 Westminster Hwy.	18-Nov-11	0.74	<1	<2	9	<1	0.14
RMD-267	17240 Fedoruk	18-Nov-11	0.14	<1	<2	11	<1	0.20
RMD-249	23000 Blk. Dyke Rd.	18-Nov-11	0.29	<1	2	9	<1	0.17
RMD-276	22271 Cochrane Drive	18-Nov-11	0.27	<1	<2	10	<1	0.16
RMD-275	5180 Smith Cres.	18-Nov-11	0.28	<1	2	10	<1	0.19
RMD-203	23260 Westminster Hwy.	18-Nov-11	0.33	<1	<2	9	<1	0.22
RMD-251	5951 McCallan Rd.	21-Nov-11	0.66	<1	2	7	<1	0.11
RMD-273	Opp. 8331 Fairfax Place	21-Nov-11	0.64	<1	<2	8	<1	0.16
RMD-252	9751 Pendleton Rd.	21-Nov-11	0.48	<1	<2	8	<1	0.16
RMD-274	10920 Springwood Court	21-Nov-11	0.57	<1	14	9	<1	0.17
RMD-253	11051 No 3 Rd.	21-Nov-11	0.66	<1	<2	7	<1	0.15
RMD-269	14951 Triangle Rd.	21-Nov-11	0.75	<1	<2	7	<1	0.24
RMD-270	8200 Jones Rd.	21-Nov-11	0.68	<1	10	8	<1	0.17
RMD-254	5300 No. 3 Rd.	21-Nov-11	0.73	<1	<2	7	<1	0.14
RMD-271	3800 Cessna Drive	21-Nov-11	0.68	<1	<2	8	<1	0.15
RMD-272	751 Catalina Cres.	21-Nov-11	0.62	<1	<2	8	<1	0.16
RMD-255	6000 Blk. Miller Rd.	21-Nov-11	0.65	<1	<2	7	<1	0.24
RMD-256	1000 Blk. McDonald Rd.	21-Nov-11	0.52	<1	<2	7	<1	0.11
RMD-250	6071 Azure Rd.	21-Nov-11	0.63	<1	<2	8	<1	0.11
RMD-263	12560 Cambie Rd.	23-Nov-11	0.48	<1	4	7	<1	0.27
RMD-262	13799 Commerce Pkwy.	23-Nov-11	0.40	<1	<2	7	<1	0.29
RMD-278	6651 Fraserwood Place	23-Nov-11	0.06	<1	24	9	<1	0.28
RMD-279	Opp. 20371 Westminster Hwy.	23-Nov-11	0.21	<1	<2	8	<1	0.21
RMD-264	13100 Mitchell Rd.	23-Nov-11	0.53	<1	6	7	<1	0.18
RMD-277	Opp. 11280 Twigg Place	23-Nov-11	0.47	<1	<2	8	<1	0.17
RMD-261	9911 Sidaway Rd.	23-Nov-11	0.67	<1	<2	7	<1	0.42

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-260	11111 Horseshoe Way	23-Nov-11	0.72	<1	<2	7	<1	0.29
RMD-259	10020 Amethyst Ave.	23-Nov-11	0.71	<1	<2	8	<1	0.19
RMD-266	9380 General Currie Rd.	23-Nov-11	0.75	<1	<2	7	<1	0.15
RMD-268	13800 No. 3 Rd. (off Garden City)	23-Nov-11	0.65	<1	<2	8	<1	1.60
RMD-258	7000 Blk. Dyke Rd.	23-Nov-11	0.66	<1	<2	8	<1	1.00
RMD-257	6640 Blundell Rd.	23-Nov-11	0.75	<1	<2	7	<1	1.40
RMD-204	3180 Granville Ave.	25-Nov-11	0.89	<1	<2	8	<1	0.15
RMD-206	4251 Moncton St.	25-Nov-11	0.82	<1	<2	9	<1	0.16
RMD-216	11080 No. 2 Rd.	25-Nov-11	0.94	<1	<2	8	<1	0.22
RMD-212	Opp. 8600 Riyan Rd.	25-Nov-11	0.82	<1	<2	8	<1	0.17
RMD-208	13200 No. 4 Rd.	25-Nov-11	1.0	<1	<2	7	<1	0.16
RMD-205	13851 Steveston Hwy.	25-Nov-11	0.73	<1	28	8	<1	0.10
RMD-202	1500 Valemont Way	25-Nov-11	0.32	<1	<2	7	<1	0.28
RMD-214	11720 Westminster Hwy.	25-Nov-11	0.91	<1	<2	8	<1	0.21
RMD-267	17240 Fedoruk	25-Nov-11	0.24	<1	<2	8	<1	0.23
RMD-249	23000 Blk. Dyke Rd.	25-Nov-11	0.32	<1	2	8	<1	0.41
RMD-276	22271 Cochrane Drive	25-Nov-11	0.30	<1	<2	9	<1	0.32
RMD-275	5180 Smith Cres.	25-Nov-11	0.50	<1	6	10	<1	0.41
RMD-203	23260 Westminster Hwy.	25-Nov-11	0.65	<1	<2	9	<1	0.48
RMD-251	5951 McCallan Rd.	28-Nov-11	1.1	<1	<2	8	<1	0.11
RMD-273	Opp. 8331 Fairfax Place	28-Nov-11	0.90	<1	<2	8	<1	0.13
RMD-252	9751 Pendleton Rd.	28-Nov-11	0.86	<1	<2	9	<1	0.14
RMD-274	10920 Springwood Court	28-Nov-11	0.80	<1	<2	9	<1	0.13
RMD-250	6071 Azure Rd.	28-Nov-11	0.93	<1	<2	9	<1	0.12
RMD-271	3800 Cessna Drive	28-Nov-11	0.82	<1	<2	9	<1	0.17
RMD-272	751 Catalina Cres.	28-Nov-11	0.88	<1	<2	8	<1	0.14
RMD-255	6000 Blk. Miller Rd.	28-Nov-11	0.95	<1	2	9	<1	0.17
RMD-256	1000 Blk. McDonald Rd.	28-Nov-11	0.84	<1	<2	9	<1	0.12
RMD-254	5300 No. 3 Rd.	28-Nov-11	0.98	<1	<2	9	<1	0.15
RMD-270	8200 Jones Rd.	28-Nov-11	0.85	<1	<2	8	<1	0.20
RMD-269	14951 Triangle Rd.	28-Nov-11	0.76	<1	<2	9	<1	0.11
RMD-253	11051 No 3 Rd.	28-Nov-11	0.94	<1	<2	8	<1	0.13
RMD-263	12560 Cambie Rd.	30-Nov-11	0.71	<1	2	6	<1	0.14
RMD-264	13100 Mitchell Rd.	30-Nov-11	0.72	<1	<2	6	<1	0.21
RMD-277	Opp. 11280 Twigg Place	30-Nov-11	0.62	<1	<2	7	<1	0.12
RMD-262	13799 Commerce Pkwy.	30-Nov-11	0.73	<1	<2	6	<1	0.14
RMD-278	6651 Fraserwood Place	30-Nov-11	0.80	<1	<2	7	<1	0.56
RMD-279	Opp. 20371 Westminster Hwy.	30-Nov-11	0.61	<1	<2	7	<1	0.49
RMD-261	9911 Sidaway Rd.	30-Nov-11	0.80	<1	<2	5	<1	0.12
RMD-260	11111 Horseshoe Way	30-Nov-11	0.73	<1	<2	6	<1	0.11

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mls	HPC CFU/mls	Temperature °C	Total Coliform MF/100mls	Turbidity NTU
RMD-259	10020 Amethyst Ave.	30-Nov-11	0.84	<1	<2	6	<1	0.17
RMD-266	9380 General Currie Rd.	30-Nov-11	0.75	<1	<2	5	<1	0.14
RMD-268	13800 No. 3 Rd. (off Garden City)	30-Nov-11	0.66	<1	<2	6	<1	0.47
RMD-258	7000 Blk. Dyke Rd.	30-Nov-11	0.63	<1	<2	7	<1	0.88
RMD-257	6640 Blundell Rd.	30-Nov-11	0.74	<1	<2	5	<1	0.15
RMD-204	3180 Granville Ave.	2-Dec-11	0.70	<1	2	6	<1	0.70
RMD-206	4251 Moncton St.	2-Dec-11	0.45	<1	2	8	<1	0.24
RMD-216	11080 No. 2 Rd.	2-Dec-11	0.60	<1	4	7	<1	0.16
RMD-212	Opp. 8600 Riyan Rd.	2-Dec-11	0.66	<1	<2	8	<1	0.25
RMD-208	13200 No. 4 Rd.	2-Dec-11	0.70	<1	<2	7	<1	0.17
RMD-205	13851 Steveston Hwy.	2-Dec-11	0.78	<1	<2	7	<1	0.17
RMD-202	1500 Valemont Way	2-Dec-11	0.61	<1	2	8	<1	0.35
RMD-214	11720 Westminster Hwy.	2-Dec-11	0.64	<1	<2	8	<1	0.15
RMD-267	17240 Fedoruk	2-Dec-11	0.38	<1	<2	9	<1	0.31
RMD-249	23000 Blk. Dyke Rd.	2-Dec-11	0.70	<1	<2	7	<1	0.43
RMD-276	22271 Cochrane Drive	2-Dec-11	0.58	<1	2	8	<1	0.41
RMD-275	5180 Smith Cres.	2-Dec-11	0.65	<1	2	7	<1	0.38
RMD-203	23260 Westminster Hwy.	2-Dec-11	0.73	<1	2	7	<1	0.39
RMD-251	5951 McCallan Rd.	5-Dec-11	0.77	<1	2	6	<1	0.15
RMD-273	Opp. 8331 Fairfax Place	5-Dec-11	0.75	<1	<2	8	<1	0.17
RMD-252	9751 Pendleton Rd.	5-Dec-11	0.77	<1	<2	7	<1	0.16
RMD-274	10920 Springwood Court	5-Dec-11	0.59	<1	4	9	<1	0.19
RMD-253	11051 No 3 Rd.	5-Dec-11	0.73	<1	<2	6	<1	0.22
RMD-269	14951 Triangle Rd.	5-Dec-11	0.75	<1	<2	6	<1	0.11
RMD-270	8200 Jones Rd.	5-Dec-11	0.77	<1	<2	6	<1	0.14
RMD-254	5300 No. 3 Rd.	5-Dec-11	0.79	<1	<2	6	<1	0.16
RMD-250	6071 Azure Rd.	5-Dec-11	0.71	<1	<2	6	<1	0.20
RMD-271	3800 Cessna Drive	5-Dec-11	0.62	<1	<2	7	<1	0.19
RMD-272	751 Catalina Cres.	5-Dec-11	0.70	<1	<2	6	<1	0.21
RMD-256	1000 Blk. McDonald Rd.	5-Dec-11	0.61	<1	4	6	<1	0.22
RMD-255	6000 Blk. Miller Rd.	5-Dec-11	0.94	<1	<2	5	<1	3.60
RMD-263	12560 Cambie Rd.	7-Dec-11	0.70	<1	<2	5	<1	0.77
RMD-264	13100 Mitchell Rd.	7-Dec-11	0.65	<1	<2	6	<1	0.23
RMD-277	Opp. 11280 Twigg Place	7-Dec-11	0.48	<1	2	7	<1	0.22
RMD-262	13799 Commerce Pkwy.	7-Dec-11	0.62	<1	<2	6	<1	0.18
RMD-278	6651 Fraserwood Place	7-Dec-11	0.67	<1	<2	7	<1	0.30
RMD-279	Opp. 20371 Westminster Hwy.	7-Dec-11	0.56	<1	<2	7	<1	0.27
RMD-261	9911 Sidaway Rd.	7-Dec-11	0.70	<1	<2	6	<1	0.17
RMD-260	11111 Horseshoe Way	7-Dec-11	0.76	<1	<2	6	<1	0.19
RMD-259	10020 Amethyst Ave.	7-Dec-11	0.76	<1	<2	6	<1	0.16



Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-266	9380 General Currie Rd.	7-Dec-11	0.74	<1	<2	6	<1	0.25
RMD-268	13800 No. 3 Rd. (off Garden City)	7-Dec-11	0.68	<1	<2	6	<1	0.21
RMD-258	7000 Blk. Dyke Rd.	7-Dec-11	0.86	<1	2	6	<1	0.17
RMD-257	6640 Blundell Rd.	7-Dec-11	0.85	<1	2	5	<1	0.15
RMD-204	3180 Granville Ave.	9-Dec-11	0.74	<1	2	6	<1	0.47
RMD-206	4251 Moncton St.	9-Dec-11	0.71	<1	<2	6	<1	0.16
RMD-216	11080 No. 2 Rd.	9-Dec-11	0.82	<1	2	4	<1	0.17
RMD-212	Opp. 8600 Riyan Rd.	9-Dec-11	0.83	<1	<2	5	<1	0.18
RMD-208	13200 No. 4 Rd.	9-Dec-11	0.91	<1	6	4	<1	0.16
RMD-205	13851 Steveston Hwy.	9-Dec-11	0.73	<1	<2	4	<1	0.24
RMD-214	11720 Westminster Hwy.	9-Dec-11	0.79	<1	<2	4	<1	0.16
RMD-202	1500 Valemont Way	9-Dec-11	0.55	<1	<2	5	<1	0.28
RMD-267	17240 Fedoruk	9-Dec-11	0.55	<1	2	5	<1	0.23
RMD-249	23000 Blk. Dyke Rd.	9-Dec-11	0.60	<1	4	5	<1	0.33
RMD-276	22271 Cochrane Drive	9-Dec-11	0.49	<1	4	5	<1	0.25
RMD-275	5180 Smith Cres.	9-Dec-11	0.56	<1	<2	5	<1	0.25
RMD-203	23260 Westminster Hwy.	9-Dec-11	0.66	<1	<2	5	<1	0.29
RMD-251	5951 McCallan Rd.	12-Dec-11	0.79	<1	<2	6	<1	0.18
RMD-273	Opp. 8331 Fairfax Place	12-Dec-11	0.73	<1	<2	7	<1	0.24
RMD-274	10920 Springwood Court	12-Dec-11	0.66	<1	<2	8	<1	0.26
RMD-252	9751 Pendleton Rd.	12-Dec-11	0.68	<1	<2	7	<1	0.20
RMD-250	6071 Azure Rd.	12-Dec-11	0.78	<1	4	7	<1	0.21
RMD-271	3800 Cessna Drive	12-Dec-11	0.39	<1	<2	8	<1	0.22
RMD-272	751 Catalina Cres.	12-Dec-11	0.82	<1	2	5	<1	0.19
RMD-255	6000 Blk. Miller Rd.	12-Dec-11	0.85	<1	<2	5	<1	0.34
RMD-256	1000 Blk. McDonald Rd.	12-Dec-11	0.81	<1	6	5	<1	0.22
RMD-254	5300 No. 3 Rd.	12-Dec-11	0.87	<1	<2	5	<1	0.25
RMD-270	8200 Jones Rd.	12-Dec-11	0.76	<1	<2	7	<1	0.21
RMD-269	14951 Triangle Rd.	12-Dec-11	0.72	<1	<2	5	<1	0.30
RMD-253	11051 No 3 Rd.	12-Dec-11	0.78	<1	<2	5	<1	0.23
RMD-257	6640 Blundell Rd.	14-Dec-11	0.66	<1	2	6	<1	0.23
RMD-258	7000 Blk. Dyke Rd.	14-Dec-11	0.75	<1	<2	7	<1	0.25
RMD-268	13800 No. 3 Rd. (off Garden City)	14-Dec-11	0.68	<1	<2	7	<1	0.35
RMD-259	10020 Amethyst Ave.	14-Dec-11	0.77	<1	2	7	<1	0.21
RMD-266	9380 General Currie Rd.	14-Dec-11	1.1	<1	<2	6	<1	0.21
RMD-260	11111 Horseshoe Way	14-Dec-11	0.68	<1	<2	7	<1	0.27
RMD-261	9911 Sidaway Rd.	14-Dec-11	0.67	<1	<2	7	<1	0.29
RMD-262	13799 Commerce Pkwy.	14-Dec-11	0.64	<1	<2	7	<1	0.28
RMD-264	13100 Mitchell Rd.	14-Dec-11	0.90	<1	<2	6	<1	0.27
RMD-277	Opp. 11280 Twigg Place	14-Dec-11	0.51	<1	<2	9	<1	0.18

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-263	12560 Cambie Rd.	14-Dec-11	0.67	<1	<2	6	<1	0.24
RMD-278	6651 Fraserwood Place	14-Dec-11	0.08	<1	70	8	<1	0.22
RMD-279	Opp. 20371 Westminster Hwy.	14-Dec-11	0.54	<1	<2	7	<1	0.26
RMD-204	3180 Granville Ave.	16-Dec-11	0.75	<1	<2	5	<1	0.28
RMD-206	4251 Moncton St.	16-Dec-11	0.64	<1	<2	6	<1	0.18
RMD-216	11080 No. 2 Rd.	16-Dec-11	0.59	<1	<2	6	<1	0.21
RMD-212	Opp. 8600 Riyan Rd.	16-Dec-11	0.66	<1	<2	6	<1	0.29
RMD-208	13200 No. 4 Rd.	16-Dec-11	0.70	<1	<2	5	<1	0.21
RMD-205	13851 Steveston Hwy.	16-Dec-11	0.59	<1	<2	7	<1	0.27
RMD-202	1500 Valemont Way	16-Dec-11	0.59	<1	<2	7	<1	0.25
RMD-214	11720 Westminster Hwy.	16-Dec-11	0.65	<1	<2	6	<1	0.22
RMD-267	17240 Fedoruk	16-Dec-11	0.39	<1	<2	7	<1	0.24
RMD-249	23000 Blk. Dyke Rd.	16-Dec-11	0.54	<1	<2	6	<1	0.28
RMD-276	22271 Cochrane Drive	16-Dec-11	0.35	<1	<2	7	<1	0.23
RMD-275	5180 Smith Cres.	16-Dec-11	0.57	<1	<2	6	<1	0.24
RMD-203	23260 Westminster Hwy.	16-Dec-11	0.61	<1	<2	6	<1	0.29
RMD-251	5951McCallan Rd.	19-Dec-11	0.75	<1	2	6	<1	0.19
RMD-273	Opp. 8331 Fairfax Place	19-Dec-11	0.62	<1	<2	7	<1	0.16
RMD-274	10920 Springwood Court	19-Dec-11	0.58	<1	2	7	<1	0.48
RMD-252	9751 Pendleton Rd.	19-Dec-11	0.68	<1	<2	7	<1	0.17
RMD-250	6071 Azure Rd.	19-Dec-11	0.82	<1	<2	7	<1	0.18
RMD-271	3800 Cessna Drive	19-Dec-11	0.76	<1	<2	6	<1	0.21
RMD-272	751 Catalina Cres.	19-Dec-11	0.77	<1	<2	6	<1	0.20
RMD-255	6000 Blk. Miller Rd.	19-Dec-11	0.78	<1	<2	5	<1	0.48
RMD-256	1000 Blk. McDonald Rd.	19-Dec-11	0.75	<1	<2	5	<1	0.20
RMD-254	5300 No. 3 Rd.	19-Dec-11	0.82	<1	<2	6	<1	0.23
RMD-270	8200 Jones Rd.	19-Dec-11	0.80	<1	<2	6	<1	0.20
RMD-269	14951 Triangle Rd.	19-Dec-11	0.72	<1	<2	5	<1	0.21
RMD-253	11051 No 3 Rd.	19-Dec-11	0.81	<1	<2	5	<1	0.21
RMD-257	6640 Blundell Rd.	21-Dec-11	0.49	<1	<2	5	<1	0.31
RMD-258	7000 Blk. Dyke Rd.	21-Dec-11	0.47	<1	<2	6	<1	0.22
RMD-268	13800 No. 3 Rd. (off Garden City)	21-Dec-11	0.49	<1	<2	6	<1	0.18
RMD-259	10020 Amethyst Ave.	21-Dec-11	0.62	<1	<2	5	<1	0.19
RMD-266	9380 General Currie Rd.	21-Dec-11	0.70	<1	<2	5	<1	0.21
RMD-260	11111 Horseshoe Way	21-Dec-11	0.64	<1	<2	6	<1	0.20
RMD-261	9911 Sidaway Rd.	21-Dec-11	0.67	<1	<2	5	<1	0.18
RMD-262	13799 Commerce Pkwy.	21-Dec-11	0.67	<1	<2	6	<1	0.23
RMD-264	13100 Mitchell Rd.	21-Dec-11	0.73	<1	<2	5	<1	0.17
RMD-277	Opp. 11280 Twigg Place	21-Dec-11	0.42	<1	<2	8	<1	0.16
RMD-263	12560 Cambie Rd.	21-Dec-11	0.62	<1	2	6	<1	0.20

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-278	6651 Fraserwood Place	21-Dec-11	0.40	<1	<2	7	<1	0.28
RMD-279	Opp. 20371 Westminster Hwy.	21-Dec-11	0.54	<1	<2	6	<1	0.34
RMD-204	3180 Granville Ave.	22-Dec-11	0.46	<1	<2	5	<1	0.27
RMD-206	4251 Moncton St.	22-Dec-11	0.41	<1	<2	4.5	<1	0.17
RMD-216	11080 No. 2 Rd.	22-Dec-11	0.47	<1	<2	5	<1	0.16
RMD-212	Opp. 8600 Riyan Rd.	22-Dec-11	0.50	<1	2	5	<1	0.17
RMD-208	13200 No. 4 Rd.	22-Dec-11	0.49	<1	<2	4.5	<1	0.18
RMD-205	13851 Steveston Hwy.	22-Dec-11	0.38	<1	<2	5.5	<1	0.22
RMD-202	1500 Valemont Way	22-Dec-11	0.42	<1	<2	6	<1	0.29
RMD-214	11720 Westminster Hwy.	22-Dec-11	0.63	<1	<2	4.5	<1	0.18
RMD-267	17240 Fedoruk	22-Dec-11	0.39	<1	<2	6	<1	0.24
RMD-249	23000 Blk. Dyke Rd.	22-Dec-11	0.41	<1	2	6	<1	0.24
RMD-276	22271 Cochrane Drive	22-Dec-11	0.29	<1	<2	6	<1	0.24
RMD-275	5180 Smith Cres.	22-Dec-11	0.48	<1	<2	5.5	<1	0.25
RMD-203	23260 Westminster Hwy.	22-Dec-11	0.59	<1	<2	4.5	<1	0.28
RMD-257	6640 Blundell Rd.	28-Dec-11	0.80	<1	NA	5	<1	0.18
RMD-258	7000 Blk. Dyke Rd.	28-Dec-11	0.58	<1	NA	6	<1	0.18
RMD-268	13800 No. 3 Rd. (off Garden City)	28-Dec-11	0.48	<1	NA	7	<1	0.18
RMD-259	10020 Amethyst Ave.	28-Dec-11	0.51	<1	NA	6	<1	0.20
RMD-266	9380 General Currie Rd.	28-Dec-11	0.53	<1	NA	5	<1	0.22
RMD-260	11111 Horseshoe Way	28-Dec-11	0.56	<1	NA	5	<1	0.22
RMD-261	9911 Sidaway Rd.	28-Dec-11	0.59	<1	NA	6	<1	0.26
RMD-262	13799 Commerce Pkwy.	28-Dec-11	0.54	<1	NA	6	<1	0.26
RMD-264	13100 Mitchell Rd.	28-Dec-11	0.65	<1	NA	6	<1	0.20
RMD-277	Opp. 11280 Twigg Place	28-Dec-11	0.23	<1	NA	8	<1	0.16
RMD-263	12560 Cambie Rd.	28-Dec-11	0.53	<1	NA	6	<1	0.25
RMD-278	6651 Fraserwood Place	28-Dec-11	0.03	<1	NA	6	<1	0.21
RMD-279	Opp. 20371 Westminster Hwy.	28-Dec-11	0.54	<1	NA	6	<1	0.30
RMD-204	3180 Granville Ave.	30-Dec-11	0.37	<1	NA	7	<1	0.20
RMD-206	4251 Moncton St.	30-Dec-11	0.40	<1	NA	7	<1	0.19
RMD-216	11080 No. 2 Rd.	30-Dec-11	0.52	<1	NA	7	<1	0.19
RMD-212	Opp. 8600 Riyan Rd.	30-Dec-11	0.51	<1	NA	7	<1	0.22
RMD-208	13200 No. 4 Rd.	30-Dec-11	0.55	<1	NA	6	<1	0.17
RMD-205	13851 Steveston Hwy.	30-Dec-11	0.60	<1	NA	5	<1	0.24
RMD-202	1500 Valemont Way	30-Dec-11	0.61	<1	NA	6	<1	0.40
RMD-214	11720 Westminster Hwy.	30-Dec-11	0.50	<1	NA	5	<1	0.20
RMD-267	17240 Fedoruk	30-Dec-11	0.52	<1	NA	6	<1	0.36
RMD-249	23000 Blk. Dyke Rd.	30-Dec-11	0.11	<1	NA	6	<1	0.29
RMD-276	22271 Cochrane Drive	30-Dec-11	0.58	<1	NA	5	<1	0.35
RMD-275	5180 Smith Cres.	30-Dec-11	0.61	<1	NA	6	<1	0.33

Sample Name	Sample Reported Name	Sampled Date	Chlorine Free mg/L	Ecoli MF/100mLs	HPC CFU/mls	Temperature °C	Total Coliform MF/100mLs	Turbidity NTU
RMD-203	23260 Westminster Hwy.	30-Dec-11	0.77	<1	NA	6	<1	0.36

### APPENDIX 3 : CITY OF RICHMOND S.C.A.D.A AND PREASURE TESTING SITES

	STATION NAME	STATION TYPE	INSTALLATION
216	SHELL & STEVESTON PRV	WATER PRV	PERMANENT
217	NELSON & BLUNDELL PRV	WATER PRV	PERMANENT
218	SHELL & BLUNDELL PRV	WATER PRV	PERMANENT
219	SHELL & WILLIAMS PRV	WATER PRV	PERMANENT
220	SHELL & BIRD PRV	WATER PRV	PERMANENT
251	NELSON & WESTMINSTER PRV	WATER PRV	WIP
252	FERGUSON PRV	WATER PRV	PERMANENT
253	GRAUER PRV	WATER PRV	PERMANENT
254	OAKSTREET PRV	WATER PRV	PERMANENT
	NELSON NORTH PRV	WATER PRV	PERMANENT
	CAMBIE PRV	WATER PRV	NO SCADA
	OAK & RIVER	WATER PRV	NO SCADA
	SHELL & MONTEITH	WATER PRV	NO SCADA
	SHELL & WESTMINSTER	WATER PRV	NO SCADA
1	<b>PRESSURE SITES</b>		
5	QUEENSBOROUGH	DRAINAGE	PERMANENT
40	NO 6 ROAD SOUTH	DRAINAGE	PERMANENT
48	STEVESTON	SANI PUMPS	PERMANENT
80	BARNARD	SANI PUMPS	PERMANENT
106	LYNAS	SANI PUMPS	PERMANENT
167	BRIGHOUSE	SANI PUMPS	PERMANENT
206	EDGEMERE	SANI PUMPS	PERMANENT
42	GRAYBAR	SANI PUMPS	PERMANENT
110	RICHMOND PARK	SANI PUMPS	PERMANENT
174	LESLIE	SANI PUMPS	PERMANENT
189	SIMPSON	SANI PUMPS	PERMANENT
193	BURROWS	SANI PUMPS	PERMANENT
190	BURKEVILLE	SANI PUMPS	PERMANENT
119	TWIGG	SANI PUMPS	PERMANENT
180	RICHMOND CENTRE	SANI PUMPS	PERMANENT
89	WOODHEADEAST	SANI PUMPS	PERMANENT
122	MAPLE	SANI PUMPS	PERMANENT
	ROBINSON	SANI PUMPS	PERMANENT

## APPENDIX 4 – CITY OF RICHMOND WATER SAMPLING SITES

	Water Sampling Sites		Sampling Station Number
Monday	Valmont & Knox Way	1500 Valmont Way	202
	Westminster Hwy & Willett Ave.	23260 Westminster Hwy.	203
	3180 Granville Ave.	3180 Granville Ave.	204
	Fraser Wharves	13851 Steveston Hwy.	205
	Steveston Ball Park	4251 Moncton Street	206
	13200 No. 4 Rd	13200 No. 4 Rd.	208
	South Arm Park	Opp. 8880 Williams Rd.	212
	Opp. Richmond Nature Park	11720 Westminster Hwy.	214
	11080 No. 2 Rd.	11080 No. 2 Rd.	216
	17240 Fedoruk Rd.	17240 Fedoruk Rd.	267
Tuesday	No. 2 Rd. & Blundell Rd.	6640 Blundell Rd.	257
	Gilbert Rd. & Dyke Rd.	7000 Blk Dyke Rd.	258
	10020 Amethyst Ave.	10020 Amethyst Ave.	259
	11111 Horseshoe Way	11111 Horseshoe Way	260
	Mylora Golf Course	9911 Sidaway Rd.	261
	13799 Commerce Pkwy.	13799 Commerce Pkwy.	262
	Cambie Community Centre	12560 Cambie Rd.	263
	13100 Mitchell Rd.	13100 Mitchell Rd.	264
	Ash St & General Currie	9380 General Currie Rd.	266
	13000 Blk. Garden City Rd.	13800 No. 3 Rd.	268
Wednesday	Shell & Dyke Rd.	11000Blk Dyke Rd.	249
	6071 Azure Rd.	6071 Azure Rd.	250
	Opp. Works Yard	5951 McCallan Rd.	251
	Hugh Boyd School	9751 Pendleton Rd.	252
	No.3 Rd.& Steveston Hwy	11051 No.3 Rd.	253
	8000 Blk. Alderbridge Way	5300 No. 3 Rd.	254
	Miller Rd. Sample Station	6000 Blk. Miller Rd.	255
	McDonald Beach	1000 Blk. McDonald Rd.	256
	14951 Triangle Rd.	14951 Triangle Rd.	269
	8200 Jones Rd.	8200 Jones Rd.	270

# APPENDIX 5: 2011 THM AND HAA TEST RESULTS

Sample	Date Sampled	THM (ppb)					Total THM Quarterly Average	HAA (ppb)						
		Bromodichloromethane	Bromoform	Chlorodibromomethane	Chloroform	Total Trihalomethanes		Dibromoacetic Acid	Dichloroacetic Acid	Monobromoacetic Acid	Monochloroacetic Acid	Trichloroacetic Acid	Total Haloacetic Acid	Total HAA Quarterly Average
RMD-250	5/18/2010	<1	<1	<1	76	76		<0.5	48	>1	9	48	105	
RMD-250	9/15/2010	<1	<1	<1	39	39		<0.5	38	<1	4	61	103	
RMD-250	11/24/2010	<1	<1	<1	26	26		<0.5	18	<1	15	29	62	
RMD-250	2/17/2011	<1	<1	<1	18	18	40	<0.5	8	<1	5	12	25	74
RMD-250	5/11/2011	<1	<1	<1	29	29.1	28	<0.5	14	<1	16	15	45	59
RMD-250	9/12/2011	<1	<1	<1	47	46.7	30	<0.5	23	<1	16	26	66	49
RMD-250	11/14/2011	<1	<1	<1	27	26.7	30	<0.5	14	<1	19	10	44	45
RMD-251	5/18/2010	<1	<1	<1	76	77		<0.5	49	<1	16	49	114	
RMD-251	9/15/2010	<1	<1	<1	39	39		<0.5	37	<1	5	61	103	
RMD-251	11/24/2010	<1	<1	<1	26	26		<0.5	20	<1	22	27	69	
RMD-251	2/17/2011	<1	<1	<1	16	16	40	<0.5	9	<1	6	8	24	78
RMD-251	5/11/2011	<1	<1	<1	25	25.3	27	<0.5	16	<1	17	17	50	61
RMD-251	9/12/2011	<1	<1	<1	35	35	26	<0.5	26	<1	27	28	81	56
RMD-251	11/14/2011	<1	<1	<1	26	26.1	26	<0.5	12	<1	12	11	34	47
RMD-258	5/18/2010	<1	<1	<1	79	79		<0.5	45	<1	13	49	107	
RMD-258	9/15/2010	<1	<1	<1	38	38		<0.5	38	<1	6	58	102	
RMD-258	11/29/2010	<1	<1	<1	25	25		<0.5	13	<1	5	22	39	
RMD-258	2/17/2011	<1	<1	<1	18	18	40	<0.5	7	<1	4	9	20	67
RMD-258	5/11/2011	<1	<1	<1	29	28.7	27	<0.5	13	<1	10	17	40	50
RMD-258	9/12/2011	<1	<1	<1	45	45	29	<0.5	32	<1	12	42	87	47
RMD-258	11/14/2011	<1	<1	<1	27	26.8	30	<0.5	12	<1	14	12	38	46
RMD-259	5/18/2010	<1	<1	<1	78	78		<0.5	45	<1	6	43	94	
RMD-259	9/15/2010	<1	<1	<1	39	39		<0.5	33	<1	5	51	89	
RMD-259	11/24/2010	<1	<1	<1	26	26		<0.5	19	<1	17	29	65	
RMD-259	2/17/2011	<1	<1	<1	16	16	40	<0.5	9	<1	6	9	24	68
RMD-259	5/11/2011	<1	<1	<1	28	28.1	27	<0.5	14	<1	19	15	49	57
RMD-259	9/12/2011	<1	<1	<1	38	38.2	27	<0.5	29	<1	7	42	78	54
RMD-259	11/14/2011	<1	<1	<1	23	23.3	26	<0.5	12	<1	13	10	35	46

Sample	Address	Date Sampled	THM (ppb)				HAA (ppb)					Extras		
			Bromodichloromethane	Bromoform	Chlorodibromomethane	Chloroform	Total Trihalomethanes	Dibromoacetic Acid	Dichloroacetic Acid	Monobromoacetic Acid	Monochloroacetic Acid		Trichloroacetic Acid	Total Haloacetic Acid
RMD-250	6071 Azure Rd.	11/14/2011	<1	<1	<1	27	26.7	<0.5	14	>1	19	10	43.5	
RMD-251	5951 McCallan Rd.	11/14/2011	<1	<1	<1	26	26.1	<0.5	12	<1	12	11	34.1	
RMD-258	7000 Blk. Dyke Rd.	11/14/2011	<1	<1	<1	27	26.8	<0.5	12	<1	14	12	37.8	
RMD-259	10020 Amethyst Ave.	11/14/2011	<1	<1	<1	23	23.3	>0.5	12	>1	13	10	35.0	7.3

**APPENDIX 6 : CITY OF RICHMOND : 2011 HEAVEY METAL TESTING RESULTS**

<b>Sample Name</b>	<b>Sample Description</b>	<b>Sampled Date</b>	<b>Sample Type</b>	<b>Copper Total</b>	<b>Iron Total</b>	<b>Lead Total</b>	<b>Zinc Total</b>
				µg/L	µg/L	µg/L	µg/L
RMD-250	6071 Azure Rd.	11/7/2011 15:55	GRAB	2.8	11	<0.5	<3
RMD-257	6640 Blundell Rd.	11/7/2011 16:05	GRAB	3.5	12	0.7	<3
RMD-263	12560 Cambie Rd.	11/7/2011 14:30	GRAB	3.9	23	0.5	<3



**CANADA LINE WATERMAIN CONSTRUCTION  
CLOUDY WATER NOTICE**

To accommodate Canada Line construction and passage along Cambie Street, the Greater Vancouver Water District (GVWD) must re-align the Cambie - Richmond watermain at 41st and 49th Avenues in Vancouver. This watermain is the major source of drinking water to West Richmond.

In preparation of the re-alignment work and in collaboration with the City of Richmond, the GVWD will be conducting a supply and capacity test on the night of February 17, 2007 from 10:00 p.m. to 7:00 a.m. This Test may result in turbidity (or cloudy water), discolouration or low pressure at your water taps.

These impacts are purely aesthetic. Either run taps until water becomes clear, or refrigerate drinking water ahead of time.

During this time the City of Richmond will conduct monitoring to ensure water quality. We appreciate your understanding throughout this test.

**For further information on water quality or water supply, please contact the City of Richmond's Public Works Control Centre at 604-244-1262.**

**For general information on Canada Line construction visit [www.canadaline.ca](http://www.canadaline.ca), or call 604-608-0200.**

## **APPENDIX 8 : SPECIFIC EMERGENCY RESPONSE PLANS**

### **Fecal or E. coli, Positive Response**

If a water sample tests positive for fecal coliform, the following response plan will occur;

- The municipality's water quality personnel and the MHO will be notified via the Metro Vancouver laboratory.
- Interim samples from the site will be examined. (Interim samples are samples in the period between when the fecal positive sample was taken, and when it was determined to be fecal positive).
- Arrangements will be made for the immediate collection of a repeat sample (including, where possible, samples from upstream and downstream of the fecal positive sample).
- The chlorine residual for the sample noted on the sampler's Water Sample Data Sheet will be reviewed to determine if a localized loss of disinfectant occurred.
- All water utility personnel will be contacted to determine if there was any loss of pressure, or other unusual events, that may have led to contaminants entering the system.
- The need for a boil water advisory will be evaluated by the City and the MHO. If a boil water advisory is deemed necessary, the municipality will carry out various means to inform the public. The Metro Vancouver will be informed of this public advisory.
- The City in consultation with the MHO will determine the need and extent for a boil water advisory.
- The Metro Vancouver Laboratory will initiate procedures to identify species of the fecal positive organism with standard biochemical tests.
- The MHO will be contacted with the repeat sample results and the results of the species identification on the fecal positive sample when these tests are complete.

In the event of possible E. coli or Fecal Coliform contamination all steps to ensure public health and safety will be taken including, if necessary, banning water usage.

### **Chemical or Biological Contamination Response**

In the event of chemical or biological contamination, in source waters or the city's distribution system, the following actions will be taken, by both the City of Richmond and Metro Vancouver:

- immediately notify the regional health authority.
- identify the chemical and any public health risk factors associated with its presence in potable water.
- isolate the contaminated zone area and determine the level of contamination
- issue a public advisory in consultation with the MHO.

In the even of possible biological or chemical contamination all steps to safety will be taken to ensure public health including, if necessary, banning water usage.

## **Turbidity Response**

Turbidity (cloudy water) occurs during periods of heavy rain at/around GVWD water sources. Following completion of the Seymour-Capilano Filtration project the number of turbidity events should be reduced. The City of Richmond in conjunction with the Regional Health Authority has developed a turbidity response plan, which considers the City's responsibility for due diligence without unreasonably constraining the water utility's ability to operate the system.

During turbidity events of >1 NTU the staff will.

- begin a rigorous sampling program for microbiological activity and residual chlorine
- monitored the City's S.C.A.D.A. system with updates sent to the regional Health Authority on a predetermined schedule
- issue a public communication in consultation with the regional Health Authority
- if necessary issue a boil water advisory will be issued to residents receiving turbid water.

## **Response to Interruption of Primary and/or Secondary Disinfection**

Upon notification by Metro Vancouver Operations that an interruption in disinfection has occurred:

- Staff will monitor residual levels of chlorine at strategic locations in the Metro Vancouver supply area,
- The city's S.C.A.D.A. system will be monitored with updates sent to the regional Health Authority on a predetermined schedule, as set by the Health Authority,
- In cases where chlorine residual is less than 0.2 ppm, city crews will flush the affected area until an acceptable level is achieved.
- These actions will continue until disinfection is resumed and adequate levels of residual chlorine have been reached in the distribution system

## **Response to Loss of Pressure Due to High Demand**

In the event of a pressure loss due to high demand;

- City staff will attempt to rectify the problem as soon as possible using various demands management techniques and by supplementing supply to problem areas.
- The Metro Vancouver and the MHO will be notified, and updated concerning any water quality issues.
- City staff will perform chlorine residual tests at various locations to determine if adequate disinfectant is present in the distribution.
- All water quality complaints from the public will be thoroughly investigated due to the potential for water contamination during low water pressure.

## **Response to Water Main Breaks with Suspected Contamination**

All water main breaks where chemical or microbiological contamination of the system is suspected will be immediately reported to the MHO. The municipality will isolate the contaminated section from the rest of the distribution system. Once the water main has been repaired, chlorine residual testing will be conducted at various locations affected by the main break. If low chlorine residuals are found, necessary actions to increase the levels of free chlorine will be carried out. If bacterial contamination is suspected, water samples will be taken and appropriate action taken.